


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id CLA MLU2 Component Inboard Pump

NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

	Mar2023 Mar2023 Jul2023 Nov2023						
SAMPLE INFORM	NOITA	method	limit/base	current	history1	history2	
Sample Number		Client Info		RP0032642	RP0027498	RP0032753	
Sample Date		Client Info		16 Nov 2023	21 Jul 2023	21 Mar 2023	
Machine Age	hrs	Client Info		0	0	75479	
Oil Age	hrs	Client Info		0	0	0	
Oil Changed		Client Info		N/A	N/A	N/A	
Sample Status				NORMAL	NORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>90	0	<1	0	
Chromium	ppm	ASTM D5185m	>5	0	0	0	
Nickel	ppm	ASTM D5185m	>5	0	0	0	
Titanium	ppm	ASTM D5185m	>3	<1	0	0	
Silver	ppm	ASTM D5185m	>3	0	0	0	
Aluminum	ppm	ASTM D5185m	>7	0	0	<1	
Lead	ppm	ASTM D5185m	>12	0	1	0	
Copper	ppm	ASTM D5185m	>30	<1	12	9	
Tin	ppm	ASTM D5185m	>9	0	1	1	
Vanadium	ppm	ASTM D5185m		<1	0	0	
Cadmium	ppm	ASTM D5185m		0	0	0	
ADDITIVES		method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		0	0	0	
Barium	ppm	ASTM D5185m		0	0	0	
Molybdenum	ppm	ASTM D5185m		0	0	0	
Manganese	ppm	ASTM D5185m		0	0	0	
Magnesium	ppm	ASTM D5185m		70	83	84	
Calcium	ppm	ASTM D5185m		0	<1	2	
Phosphorus	ppm	ASTM D5185m		0	0	44	
Zinc	ppm	ASTM D5185m		0	0	0	
			Para Maria and				
CONTAMINANTS		method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>60	<1	<1	3	
Sodium	ppm	ASTM D5185m		2	0	0	
Potassium	ppm	ASTM D5185m	>20	0	<1	0	
Water	%	ASTM D6304		0.032	0.027	0.014	
ppm Water	ppm	ASTM D6304	>1000	321	276.8	141.6	
FLUID DEGRADA		method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045		0.29	0.34	0.37	
VISUAL		method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE	
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE	
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE	
Silt	scalar	*Visual	NONE	NONE	NONE	NONE	
Debris	scalar	*Visual	NONE	LIGHT	LIGHT	LIGHT	
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE	
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML	
Odor	scalar	*Visual	NORML	NORML	NORML	NORML	
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG	
					0	- ENERGIA	


scalar *Visual

on: Sterdice Manage NECNECLA

NEG



OIL ANALYSIS REPORT

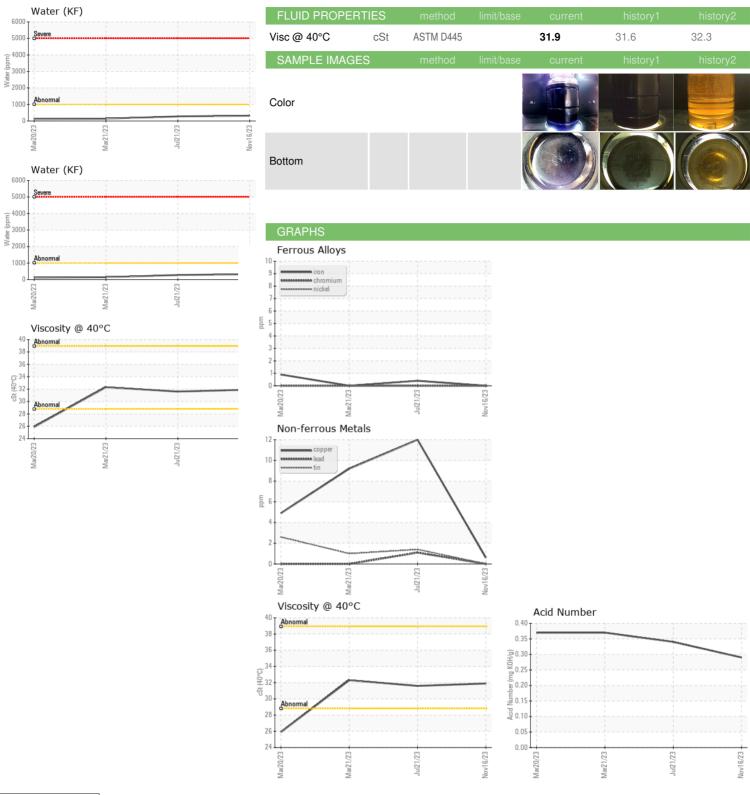





Laboratory Sample No. Lab Number **Unique Number** Test Package : IND 2

: RP0032642 : 06026556 : 10776347

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 06 Dec 2023

: 08 Dec 2023 Diagnosed Diagnostician : Jonathan Hester **ENERGY TRANSFER - CLARKSON STATION**

1958 PEONIA RD CLARKSON, KY US 42726

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: