

# **PROBLEM SUMMARY**

Sample Rating Trend

VIS DEBRIS



# **COMPONENT CONDITION SUMMARY**

No relevant graphs to display

## RECOMMENDATION

We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC T	EST RE	SULTS				
Sample Status				ABNORMAL	NORMAL	ABNORMAL
Debris	scalar	*Visual	NONE	MODER	LIGHT	▲ MODER

Customer Id: ENEROL Sample No.: RP0036181 Lab Number: 06026580 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

# **RECOMMENDED ACTIONS**

There are no recommended actions for this sample.

# HISTORICAL DIAGNOSIS

# 25 Jul 2023 Diag: Don Baldridge

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.



## 27 Feb 2023 Diag: Don Baldridge

VIS DEBRIS




We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**







# **MAY MLU2** Component

**Inboard Pump** 

**NOT GIVEN (--- GAL)** 

# DIAGNOSIS

### Recommendation

We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil. The water content is negligible.

## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


		Feb	2023	Jul2023 Nov20		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		RP0036181	RP0032166	RP0032787
Sample Date		Client Info		28 Nov 2023	25 Jul 2023	27 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	9	2	1
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m	>5	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	<1	0	<1
_ead	ppm	ASTM D5185m	>12	0	2	2
Copper	ppm	ASTM D5185m	>30	14	14	26
Tin	ppm	ASTM D5185m	>9	<1	4	3
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		70	85	87
Calcium	ppm	ASTM D5185m		0	<1	<1
Phosphorus	ppm	ASTM D5185m		0	0	3
Zinc	ppm	ASTM D5185m		0	<1	0
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	<1	2	2
Sodium	ppm	ASTM D5185m		<1	0	0
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>.1	0.017	0.019	0.020
opm Water	ppm	ASTM D6304	>1000	172	192.8	207.0
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
FLUID DEGRADA Acid Number (AN)	ATION mg KOH/g	method ASTM D8045	limit/base			history2 0.43
			limit/base	current	history1	
Acid Number (AN)  VISUAL		ASTM D8045		current 0.31 current NONE	history1 0.35	0.43 history2 NONE
Acid Number (AN)  VISUAL  White Metal	mg KOH/g scalar scalar	ASTM D8045 method	limit/base	current 0.31 current	history1 0.35 history1	0.43  history2  NONE  NONE
Acid Number (AN)  VISUAL  White Metal  Yellow Metal	mg KOH/g	ASTM D8045  method  *Visual	limit/base	current 0.31 current NONE NONE NONE	history1 0.35 history1 NONE	0.43  history2  NONE
Acid Number (AN)  VISUAL  White Metal  Yellow Metal  Precipitate	mg KOH/g scalar scalar	ASTM D8045  method  *Visual  *Visual	limit/base NONE NONE	current 0.31 current NONE NONE	history1 0.35 history1 NONE NONE	0.43  history2  NONE  NONE
Acid Number (AN)  VISUAL  White Metal  Yellow Metal  Precipitate  Silt	mg KOH/g scalar scalar scalar	astm D8045  method  *Visual  *Visual  *Visual	limit/base NONE NONE NONE	current 0.31 current NONE NONE NONE	history1 0.35 history1 NONE NONE NONE	0.43  history2  NONE  NONE  NONE
VISUAL White Metal Yellow Metal Precipitate Silt Debris	scalar scalar scalar scalar scalar	method  *Visual  *Visual  *Visual  *Visual	limit/base NONE NONE NONE NONE	current 0.31  current NONE NONE NONE NONE NONE	history1 0.35 history1 NONE NONE NONE NONE	0.43  history2  NONE  NONE  NONE  NONE
Acid Number (AN)	scalar scalar scalar scalar scalar	method  *Visual  *Visual  *Visual  *Visual  *Visual  *Visual  *Visual	limit/base NONE NONE NONE NONE NONE	current 0.31  current NONE NONE NONE NONE NONE NONE NONE MODER	history1 0.35 history1 NONE NONE NONE NONE LIGHT	0.43  history2  NONE  NONE  NONE  NONE  NONE  MODER
VISUAL White Metal Yellow Metal Precipitate Silt Debris Sand/Dirt	scalar scalar scalar scalar scalar scalar scalar	method  *Visual  *Visual  *Visual  *Visual  *Visual  *Visual  *Visual  *Visual	limit/base NONE NONE NONE NONE NONE NONE NONE	Current  0.31  Current  NONE  NONE  NONE  NONE  MODER  NONE	history1 0.35 history1 NONE NONE NONE NONE LIGHT NONE	0.43  history2  NONE  NONE  NONE  NONE  MODER  NONE

NEG

ationeGraig MorganNEGNEROL



# **OIL ANALYSIS REPORT**

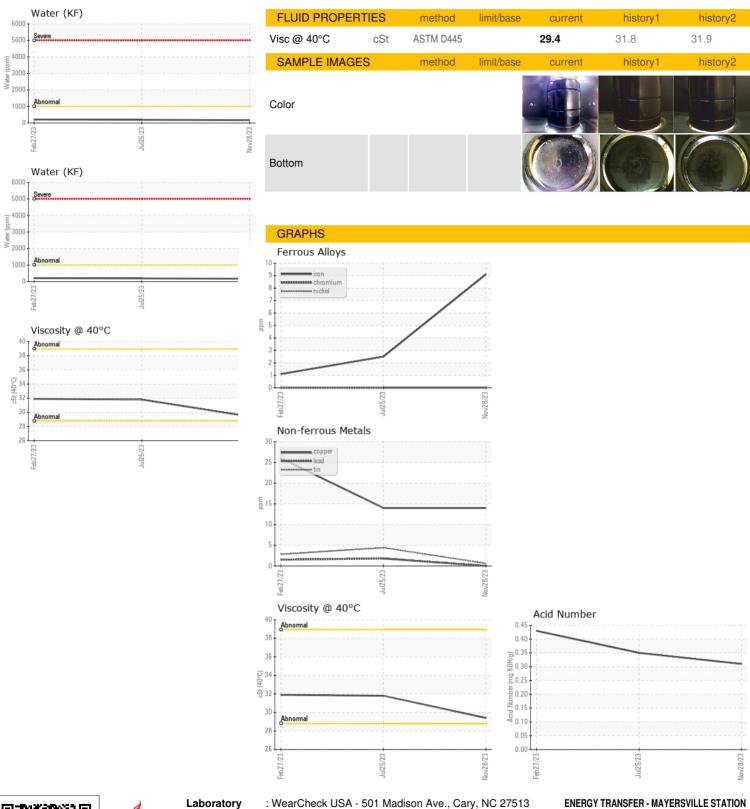





Laboratory Sample No. Lab Number

Unique Number : 10776371 Test Package : IND 2

: RP0036181 : 06026580

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 06 Dec 2023 : 08 Dec 2023 Diagnosed

Diagnostician : Jonathan Hester

21123 HWY 1 ROLLING FORK, MS US 39159

Contact: Craig Morgan

craig.morgan@energytransfer.com T: 1(662)816-8346

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (833)944-0464