




# PROBLEM SUMMARY

Sample Rating Trend

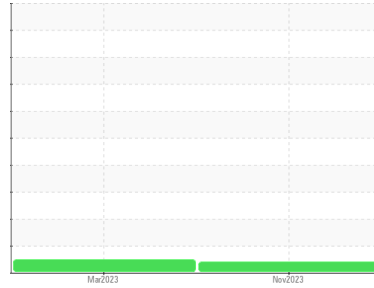

## VIS DEBRIS



Machine Id  
**CYG\_MLU6**  
 Component  
**Inboard Pump**  
 Fluid  
**NOT GIVEN (--- GAL)**

### COMPONENT CONDITION SUMMARY

No relevant graphs to display

### RECOMMENDATION

We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### PROBLEMATIC TEST RESULTS

| Sample Status |                | ABNORMAL | NORMAL | --- |
|---------------|----------------|----------|--------|-----|
| Debris        | scalar *Visual | ▲ MODER  | LIGHT  | --- |

**Customer Id:** ENECYG  
**Sample No.:** RP0032981  
**Lab Number:** 06026586  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 22 Mar 2023 Diag: Angela Borella

NORMAL




Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. There is no indication of any contamination in the oil. Viscosity of sample indicates oil is within ISO 32 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

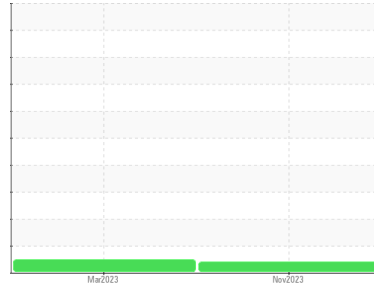

VIS DEBRIS



Machine Id  
**CYG\_MLU6**  
Component  
**Inboard Pump**  
Fluid  
**NOT GIVEN (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

We suspect abnormal contamination may be due to sampling method. No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

Moderate concentration of visible dirt/debris present in the oil. The water content is negligible.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|----------|
| Sample Number      | Client Info |             |            | <b>RP0032981</b>   | RP0032860   | ---      |
| Sample Date        | Client Info |             |            | <b>14 Nov 2023</b> | 22 Mar 2023 | ---      |
| Machine Age        | hrs         | Client Info |            | <b>0</b>           | 73321       | ---      |
| Oil Age            | hrs         | Client Info |            | <b>0</b>           | 0           | ---      |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | N/A         | ---      |
| Sample Status      |             |             |            | <b>ABNORMAL</b>    | NORMAL      | ---      |

| WEAR METALS |     | method      | limit/base | current      | history1 | history2 |
|-------------|-----|-------------|------------|--------------|----------|----------|
| Iron        | ppm | ASTM D5185m | >90        | <b>5</b>     | 0        | ---      |
| Chromium    | ppm | ASTM D5185m | >5         | <b>0</b>     | 0        | ---      |
| Nickel      | ppm | ASTM D5185m | >5         | <b>0</b>     | 0        | ---      |
| Titanium    | ppm | ASTM D5185m | >3         | <b>&lt;1</b> | 0        | ---      |
| Silver      | ppm | ASTM D5185m | >3         | <b>0</b>     | 0        | ---      |
| Aluminum    | ppm | ASTM D5185m | >7         | <b>0</b>     | <1       | ---      |
| Lead        | ppm | ASTM D5185m | >12        | <b>&lt;1</b> | 0        | ---      |
| Copper      | ppm | ASTM D5185m | >30        | <b>2</b>     | 0        | ---      |
| Tin         | ppm | ASTM D5185m | >9         | <b>2</b>     | <1       | ---      |
| Vanadium    | ppm | ASTM D5185m |            | <b>&lt;1</b> | 0        | ---      |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b>     | 0        | ---      |




| ADDITIVES  |     | method      | limit/base | current   | history1 | history2 |
|------------|-----|-------------|------------|-----------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>0</b>  | 0        | ---      |
| Barium     | ppm | ASTM D5185m |            | <b>0</b>  | 0        | ---      |
| Molybdenum | ppm | ASTM D5185m |            | <b>0</b>  | 0        | ---      |
| Manganese  | ppm | ASTM D5185m |            | <b>0</b>  | 0        | ---      |
| Magnesium  | ppm | ASTM D5185m |            | <b>61</b> | 80       | ---      |
| Calcium    | ppm | ASTM D5185m |            | <b>0</b>  | 9        | ---      |
| Phosphorus | ppm | ASTM D5185m |            | <b>0</b>  | 64       | ---      |
| Zinc       | ppm | ASTM D5185m |            | <b>10</b> | 16       | ---      |

| CONTAMINANTS |     | method      | limit/base | current      | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >60        | <b>&lt;1</b> | 3        | ---      |
| Sodium       | ppm | ASTM D5185m |            | <b>2</b>     | 0        | ---      |
| Potassium    | ppm | ASTM D5185m | >20        | <b>0</b>     | 0        | ---      |
| Water        | %   | ASTM D6304  | >.1        | <b>0.015</b> | 0.011    | ---      |
| ppm Water    | ppm | ASTM D6304  | >1000      | <b>156</b>   | 114.5    | ---      |

| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 |            | <b>0.31</b> | 0.35     | ---      |

| VISUAL           |        | method  | limit/base | current        | history1 | history2 |
|------------------|--------|---------|------------|----------------|----------|----------|
| White Metal      | scalar | *Visual | NONE       | <b>NONE</b>    | NONE     | ---      |
| Yellow Metal     | scalar | *Visual | NONE       | <b>NONE</b>    | NONE     | ---      |
| Precipitate      | scalar | *Visual | NONE       | <b>NONE</b>    | NONE     | ---      |
| Silt             | scalar | *Visual | NONE       | <b>NONE</b>    | NONE     | ---      |
| Debris           | scalar | *Visual | NONE       | <b>▲ MODER</b> | LIGHT    | ---      |
| Sand/Dirt        | scalar | *Visual | NONE       | <b>NONE</b>    | NONE     | ---      |
| Appearance       | scalar | *Visual | NORML      | <b>NORML</b>   | NORML    | ---      |
| Odor             | scalar | *Visual | NORML      | <b>NORML</b>   | NORML    | ---      |
| Emulsified Water | scalar | *Visual | >.1        | <b>NEG</b>     | NEG      | ---      |
| Free Water       | scalar | *Visual |            | <b>NEG</b>     | ---      | ---      |

# OIL ANALYSIS REPORT

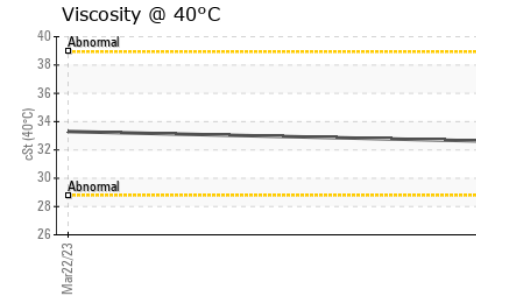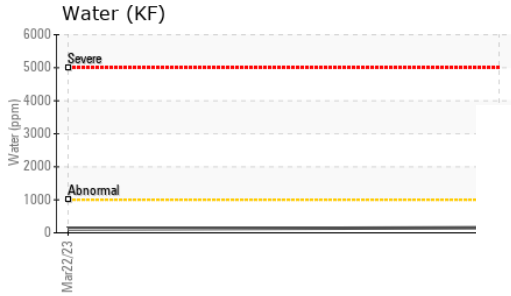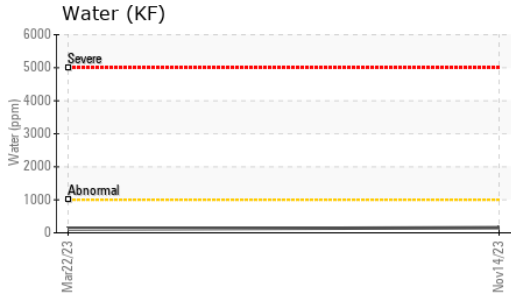





| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
|------------------|--------|------------|---------|----------|----------|

|             |     |           |      |      |     |
|-------------|-----|-----------|------|------|-----|
| Visc @ 40°C | cSt | ASTM D445 | 32.6 | 33.3 | --- |
|-------------|-----|-----------|------|------|-----|

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

|        |  |  |  |  |          |
|--------|--|--|--|--|----------|
| Color  |  |  |  |  | no image |
| Bottom |  |  |  |  | no image |

## GRAPHS

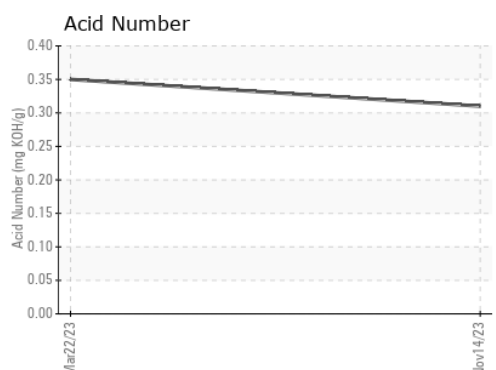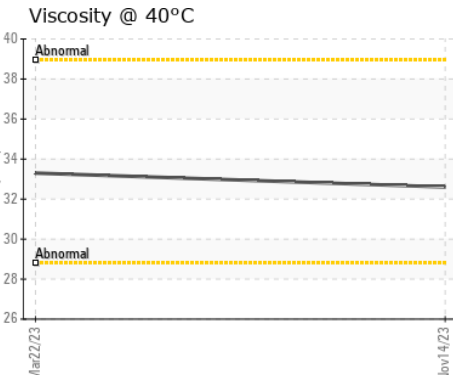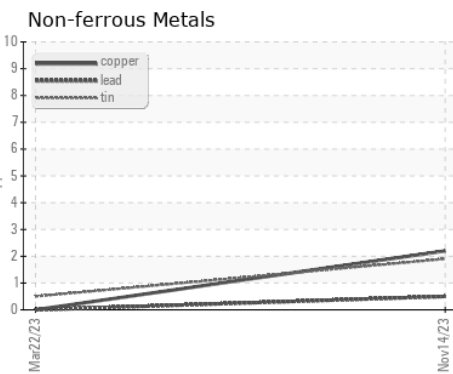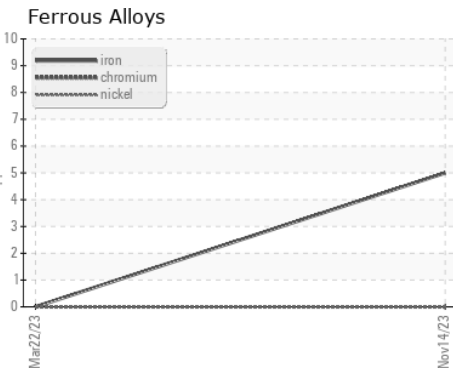

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0032981  
**Lab Number** : 06026586  
**Unique Number** : 10776377  
**Test Package** : IND 2

**ENERGY TRANSFER - CYGNET**  
 5152 ROCK RIDGE RD  
 CYGNET, OH  
 US 43413  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: