

PROBLEM SUMMARY

Sample Rating Trend


VISUAL METAL

Machine Id
CYG_MLU3
Component
Outboard Pump
Fluid
NOT GIVEN (--- GAL)



COMPONENT CONDITION SUMMARY

▲ Non-ferrous Metals

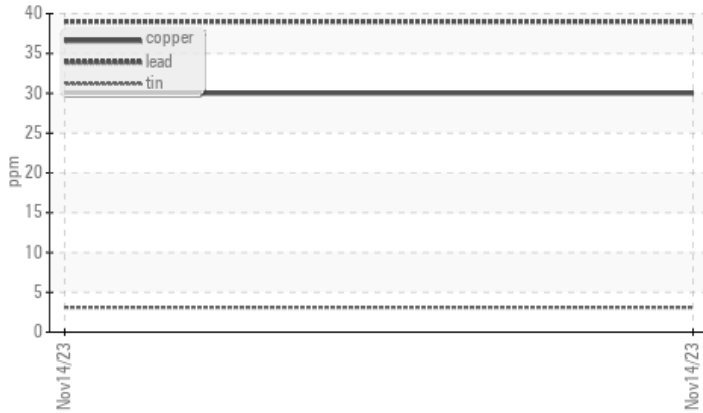

RECOMMENDATION

We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Lead	ppm	ASTM D5185m	>12	▲ 39	---	---
Copper	ppm	ASTM D5185m	>30	▲ 30	---	---
Yellow Metal	scalar	*Visual	NONE	▲ MODER	---	---

Customer Id: ENECYG
Sample No.: RP0032973
Lab Number: 06026587
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Inspect Wear Source	---	---	?	We advise that you inspect for the source(s) of wear.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

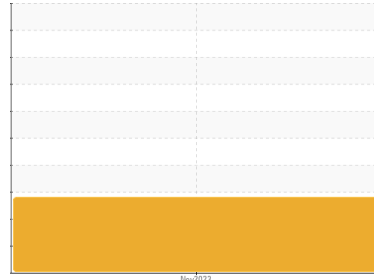

VISUAL METAL



Machine Id
CYG_MLU3
 Component
Outboard Pump
 Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

Recommendation
 We advise that you inspect for the source(s) of wear. We recommend an early resample to monitor this condition.

Wear
 Moderate concentration of visible metal present. Bearing and/or bushing wear is indicated.

Contamination
 The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
 The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	RP0032973	---	---
Sample Date	Client Info	14 Nov 2023	---	---
Machine Age	hrs Client Info	0	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>90	1	---	---
Chromium ppm ASTM D5185m	>5	0	---	---
Nickel ppm ASTM D5185m	>5	0	---	---
Titanium ppm ASTM D5185m	>3	<1	---	---
Silver ppm ASTM D5185m	>3	0	---	---
Aluminum ppm ASTM D5185m	>7	0	---	---
Lead ppm ASTM D5185m	>12	▲ 39	---	---
Copper ppm ASTM D5185m	>30	▲ 30	---	---
Tin ppm ASTM D5185m	>9	3	---	---
Vanadium ppm ASTM D5185m		<1	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		0	---	---
Barium ppm ASTM D5185m		0	---	---
Molybdenum ppm ASTM D5185m		0	---	---
Manganese ppm ASTM D5185m		0	---	---
Magnesium ppm ASTM D5185m		61	---	---
Calcium ppm ASTM D5185m		0	---	---
Phosphorus ppm ASTM D5185m		0	---	---
Zinc ppm ASTM D5185m		3	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>60	<1	---	---
Sodium ppm ASTM D5185m		6	---	---
Potassium ppm ASTM D5185m	>20	0	---	---
Water % ASTM D6304	>.1	0.016	---	---
ppm Water ppm ASTM D6304	>1000	165	---	---





FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		0.32	---	---

VISUAL

method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	NONE	---	---
Yellow Metal scalar *Visual	NONE	▲ MODER	---	---
Precipitate scalar *Visual	NONE	NONE	---	---
Silt scalar *Visual	NONE	NONE	---	---
Debris scalar *Visual	NONE	NONE	---	---
Sand/Dirt scalar *Visual	NONE	NONE	---	---
Appearance scalar *Visual	NORML	NORML	---	---
Odor scalar *Visual	NORML	NORML	---	---
Emulsified Water scalar *Visual	>.1	NEG	---	---
Free Water scalar *Visual		NEG	---	---



OIL ANALYSIS REPORT

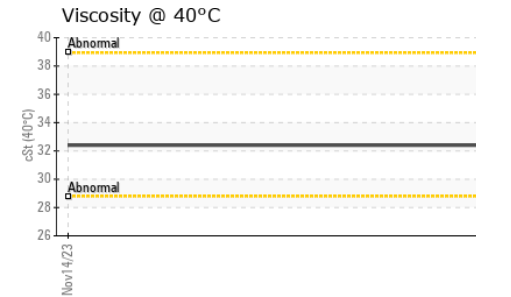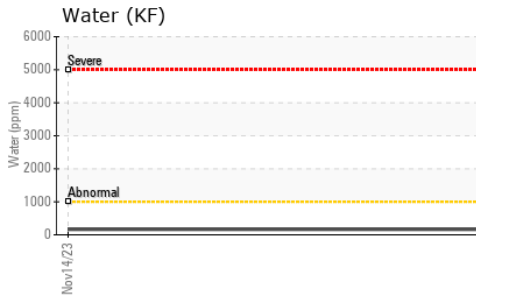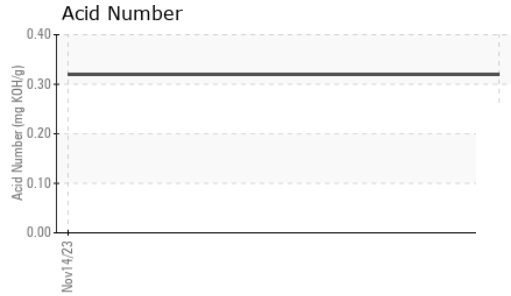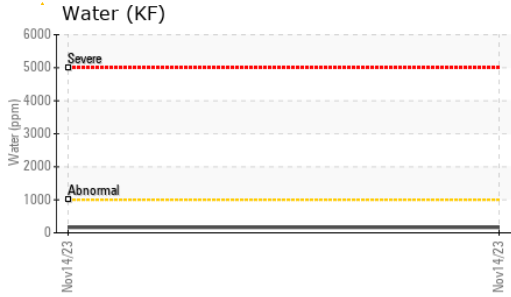





FLUID PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32.4	---

SAMPLE IMAGES

method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

GRAPHS

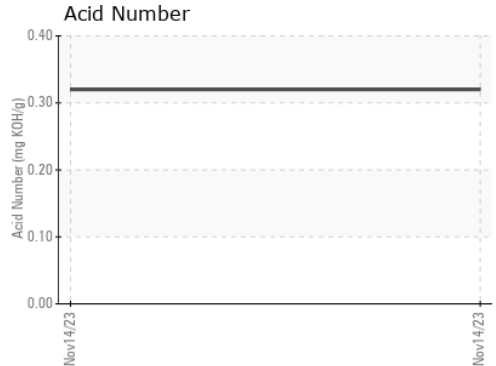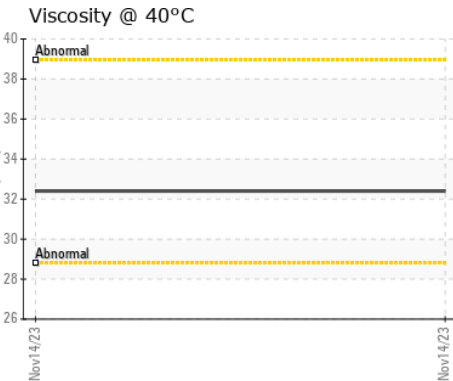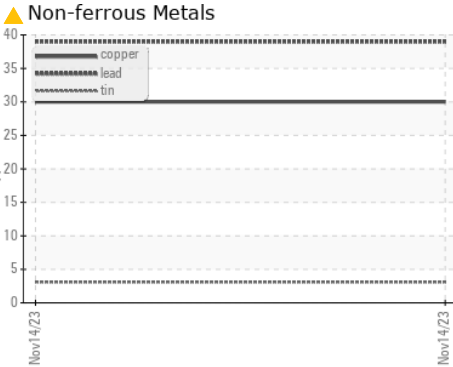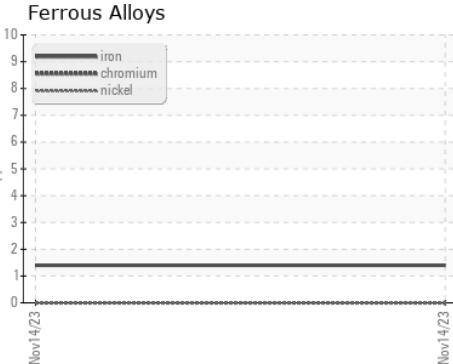

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0032973
Lab Number : 06026587
Unique Number : 10776378
Test Package : IND 2

ENERGY TRANSFER - CYGNET
 5152 ROCK RIDGE RD
 CYGNET, OH
 US 43413
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: