



OIL ANALYSIS REPORT


Sample Rating Trend

NORMAL



Machine Id
SULLAIR 201611030090 - EATON

Component
Compressor
Fluid
SULLAIR SULLUBE (--- GAL)

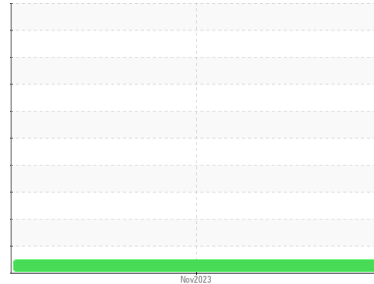

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|----------|----------|
| Sample Number | Client Info | | WC06026635 | --- | --- |
| Sample Date | Client Info | | 20 Nov 2023 | --- | --- |
| Machine Age | hrs | Client Info | 45578 | --- | --- |
| Oil Age | hrs | Client Info | 1362 | --- | --- |
| Oil Changed | Client Info | | Not Changed | --- | --- |
| Sample Status | | | NORMAL | --- | --- |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|-------|-----------|------------|------------|----------|----------|
| Water | WC Method | >0.1 | NEG | --- | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | 0 | --- | --- |
| Chromium | ppm | ASTM D5185m >10 | 0 | --- | --- |
| Nickel | ppm | ASTM D5185m | <1 | --- | --- |
| Titanium | ppm | ASTM D5185m | 0 | --- | --- |
| Silver | ppm | ASTM D5185m | 0 | --- | --- |
| Aluminum | ppm | ASTM D5185m >25 | <1 | --- | --- |
| Lead | ppm | ASTM D5185m >25 | 0 | --- | --- |
| Copper | ppm | ASTM D5185m >50 | 1 | --- | --- |
| Tin | ppm | ASTM D5185m >15 | 2 | --- | --- |
| Vanadium | ppm | ASTM D5185m | <1 | --- | --- |
| Cadmium | ppm | ASTM D5185m | 0 | --- | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-----------------|------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | --- | --- |
| Barium | ppm | ASTM D5185m 745 | 141 | --- | --- |
| Molybdenum | ppm | ASTM D5185m 0.0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185m | 0 | --- | --- |
| Magnesium | ppm | ASTM D5185m 0.0 | 0 | --- | --- |
| Calcium | ppm | ASTM D5185m 1 | 2 | --- | --- |
| Phosphorus | ppm | ASTM D5185m 3 | 2 | --- | --- |
| Zinc | ppm | ASTM D5185m 0.1 | 3 | --- | --- |
| Sulfur | ppm | ASTM D5185m 240 | 448 | --- | --- |

CONTAMINANTS



| | method | limit/base | current | history1 | history2 |
|-----------|--------|-----------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | --- | --- |
| Sodium | ppm | ASTM D5185m | 21 | --- | --- |
| Potassium | ppm | ASTM D5185m >20 | 4 | --- | --- |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|----------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 .06 | 0.21 | --- | --- |



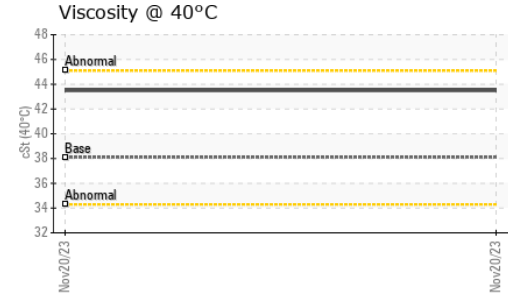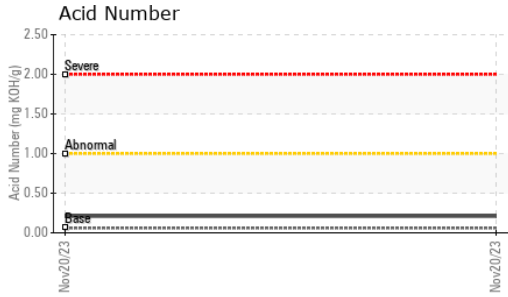

OIL ANALYSIS REPORT







| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | --- |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|-------------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 38.1 | 43.5 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

| | | | | | |
|--------|--|--|---|----------|----------|
| Color | | |  | no image | no image |
| Bottom | | |  | no image | no image |

GRAPHS

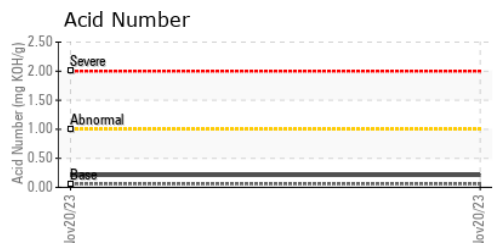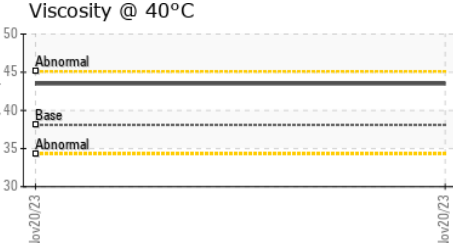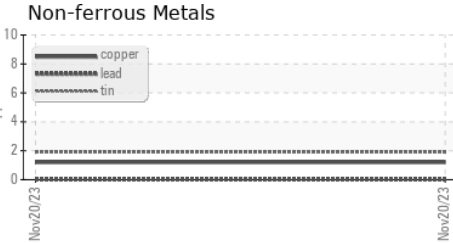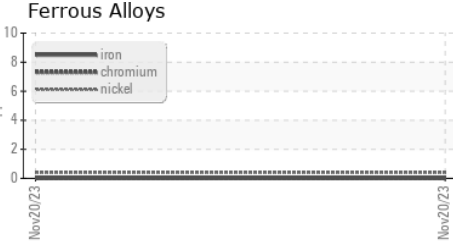

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06026635 **Received** : 06 Dec 2023
Lab Number : 06026635 **Diagnosed** : 08 Dec 2023
Unique Number : 10776426 **Diagnostician** : Jonathan Hester
Test Package : IND 2

FS-COMPRESSION CO, LLC
 203 AERO COURT
 GREENSBORO, NC
 US 27409

Contact: Dallas Burcham
 dallas.burcham@fs-compression.com
 T: (336)605-9622
 F: (336)605-9844

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)