




COOLANT REPORT

Sample Rating Trend

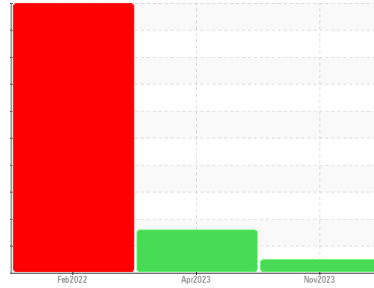

NORMAL



Area
FRONTIER II [200006776]
 Machine Id
54WEA86923
 Component
Coolant
 Fluid
ISENTHAL VARIDOS 45 (--- LTR)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		NX06027000	NX05868409	NX05487232
Sample Date	Client Info		22 Nov 2023	27 Apr 2023	23 Feb 2022
Machine Age	hrs	Client Info	0	0	0
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			NORMAL	ABNORMAL	SEVERE

PHYSICAL TEST RESULTS

	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298		1.060	1.060	1.055
pH	Scale 0-14	ASTM D1287 8.5	7.77	8.29	8.41
Nitrites	ppm	AP-053:2009 260	372	336	0
Reserve Alkalinity	Scale 0-20	*ASTM D1121	---	---	---
Percentage Glycol	%	ASTM D3321 45	44.8	44.3	40.8
Freezing Point	°F	ASTM D3321 -24	-21	-21	-13
Total Dissolved Solids			242.5	153.0	176.5
Carboxylate			n/a	n/a	fail

CORROSION INHIBITORS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D6130 25	10	0	74
Phosphorus	ppm	ASTM D6130 140	<1	0	174
Boron	ppm	ASTM D6130 0	0	0	0
Molybdenum	ppm	ASTM D6130 1075	0	229	1077

CORROSION

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D6130 >15	0	▲ 82	● 511
Aluminum	ppm	ASTM D6130 >10	0	▲ 42	● 156
Copper	ppm	ASTM D6130 >10	<1	0	<1
Lead	ppm	ASTM D6130 >10	<1	0	1
Tin	ppm	ASTM D6130 >10	<1	0	<1
Zinc	ppm	ASTM D6130	0	39	84

CONTAMINANTS

	method	limit/base	current	history1	history2
Chlorine	ppm	ASTM D6130	8	2	80

CARRIER SALTS


	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D6130 1075	2903	815	555
Potassium	ppm	ASTM D6130 5	158	307	583

SCALE POTENTIAL

	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D6130	4	0	2
Magnesium	ppm	ASTM D6130	<1	0	4









COOLANT REPORT

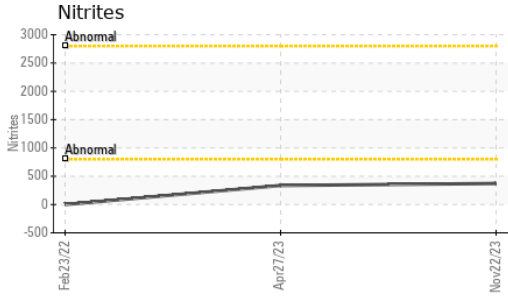

VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual	DkYlw	Yllow	Orange	Yllow
Coolant Appearance	*Visual	Clear	normal	normal	normal
Color					
Bottom					

GRAPHS

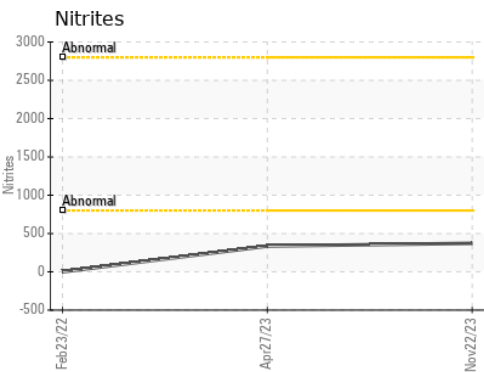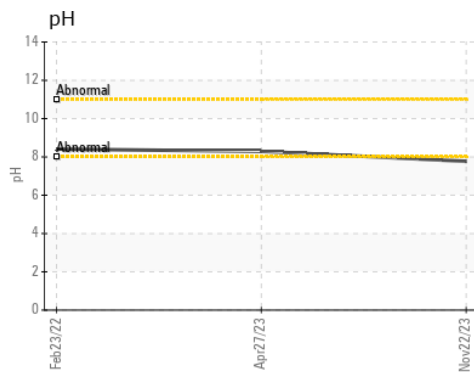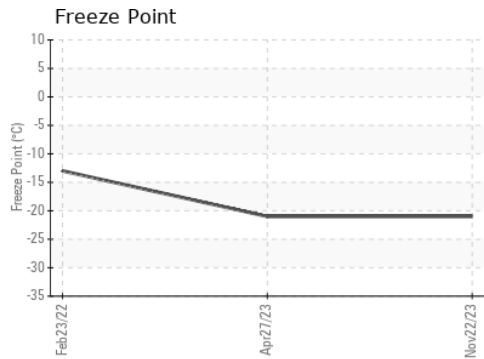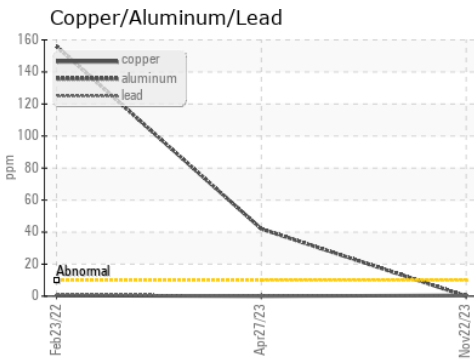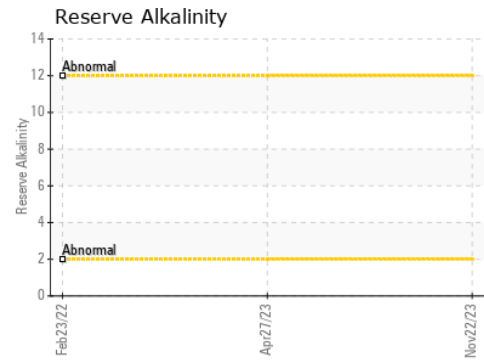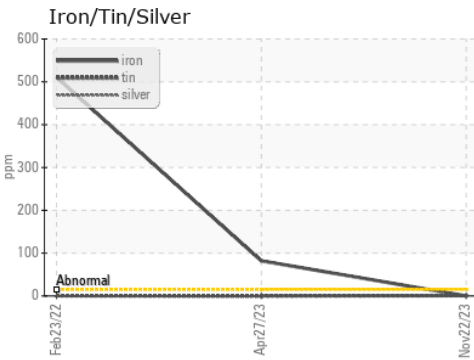

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : NX06027000 **Received** : 06 Dec 2023
Lab Number : 06027000 **Diagnosed** : 11 Dec 2023
Unique Number : 10776791 **Diagnostician** : Doug Bogart
Test Package : COOL- (Additional Tests: COOL, ICP)

NORDEX USA - Chicago
 300 SOUTH WACKER DRIVE, SUITE 1500
 CHICAGO, IL
 US 60606
 Contact: DEVIN LINEHAN
 DLinehan@nordex-online.com
 T: (312)386-4124
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)