


PROBLEM SUMMARY

RRJ Machine Id B-01-402 Biogas Blower Non-Drive End Component

Non-Drive End Compressor

GARDNER DENVER AEON PD (--- GAL)

COMPONENT CONDITION SUMMARY

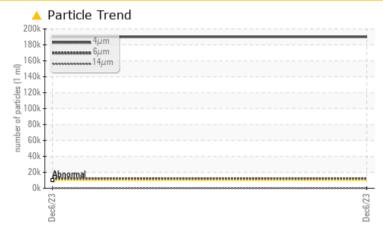

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS								
Sample Status			ABNORMAL					
Particles >4µm	ASTM D7647	>10000	<u> </u>					
Particles >6µm	ASTM D7647	>2500	🔺 11664					
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<u> </u>					


Customer Id: GEVDOO Sample No.: WC06027695 Lab Number: 06027695 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data: Jonathan Hester +1 919-379-4092 x4092 jhester@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

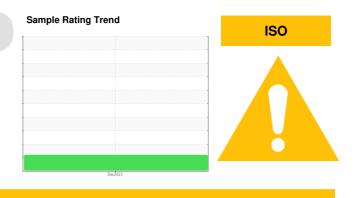

RECOMMENDED AC	OMMENDED ACTIONS				
Action	Status	Date	Done By	Description	
Change Filter			?	We recommend you service the filters on this component if applicable.	

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Area **RRJ** Machine Id **B-01-402 Biogas Blower Non-Drive End** Component

Non-Drive End Compressor

GARDNER DENVER AEON PD (--- GAL)

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Dec2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC06027695		
Sample Date		Client Info		06 Dec 2023		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
ron	ppm	ASTM D5185m	>50	42		
Chromium	ppm	ASTM D5185m	>10	2		
Nickel	ppm	ASTM D5185m		<1		
Titanium	ppm	ASTM D5185m		0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>25	<1		
_ead	ppm	ASTM D5185m	>25	0		
Copper	ppm	ASTM D5185m	>50	<1		
Гin	ppm	ASTM D5185m	>15	1		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		0		
Volybdenum	ppm	ASTM D5185m		<1		
Vanganese	ppm	ASTM D5185m		<1		
Vagnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		646		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		551		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	6		
Sodium	ppm	ASTM D5185m		-		
				0		
	ppm	ASTM D5185m	>20	0		
Potassium	ppm %	ASTM D5185m ASTM D6304	>20 >0.1			
Potassium	%			0		
Potassium Water FLUID CLEANLIN	%	ASTM D6304	>0.1	0 NEG		
Potassium Water FLUID CLEANLIN Particles >4µm	%	ASTM D6304 method ASTM D7647 ASTM D7647	>0.1 limit/base	0 NEG current	 history1	 history2
Potassium Water FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm	%	ASTM D6304 method ASTM D7647	>0.1 limit/base >10000	0 NEG current 190030	 history1	 history2
Potassium Water FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm	%	ASTM D6304 method ASTM D7647 ASTM D7647	>0.1 limit/base >10000 >2500	0 NEG current ▲ 190030 ▲ 11664	 history1 	 history2
Potassium Water FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm Particles >21μm	%	ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>0.1 limit/base >10000 >2500 >320	0 NEG current ▲ 190030 ▲ 11664 241	 history1 	 history2
Potassium Water FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm Particles >21μm Particles >38μm	%	ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647	>0.1 limit/base >10000 >2500 >320 >80	0 NEG current ▲ 190030 ▲ 11664 241 41	 history1 	 history2
Potassium Water	%	ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>0.1 limit/base >10000 >2500 >320 >80 >20	0 NEG current ▲ 190030 ▲ 11664 241 41 0	 history1 	 history2
Potassium Water FLUID CLEANLIN Particles >4μm Particles >6μm Particles >14μm Particles >21μm Particles >38μm Particles >71μm	% IESS	ASTM D6304 method ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647 ASTM D7647	>0.1 limit/base >10000 >2500 >320 >80 >20 >4	0 NEG current ▲ 190030 ▲ 11664 241 41 0 0	 history1 	 history2

Sample Rating Trend

ISO



🔺 Particle Trend

200

(1 ml) 150

Te 100

50

0

200

150

100

50

0.70

0.60 (B/HO) Ê 0.40

ළ 0.30

0.20 Acid

0.10

0.00

240

230


200

190

Abno 0

Ē

OIL ANALYSIS REPORT

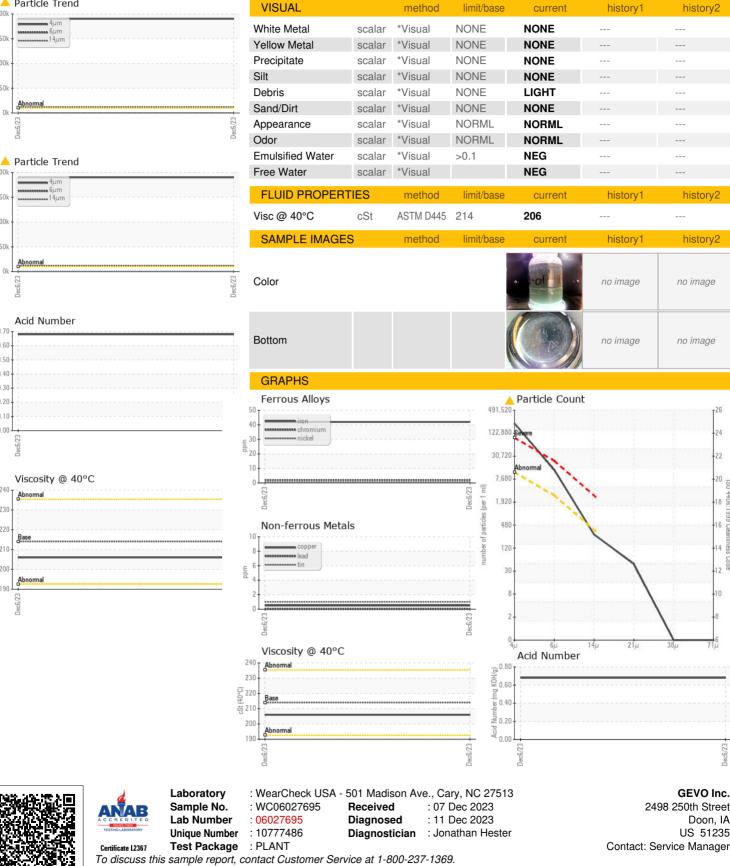

^{* -} Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - GEVDOO

214

GEVO Inc.

Doon, IA

US 51235

2498 250th Street

history2

historv2

history2

no image

no image

4406

:1999 Cle

14