




PROBLEM SUMMARY

Sample Rating Trend

DIRT




Area
RNG
 Machine Id
C101A Feed Compressor
 Component
Screw Compressor
 Fluid
CPI ENG. 6005-150 (--- GAL)

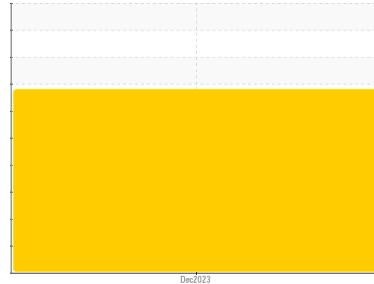


COMPONENT CONDITION SUMMARY

● Silicon (ppm)

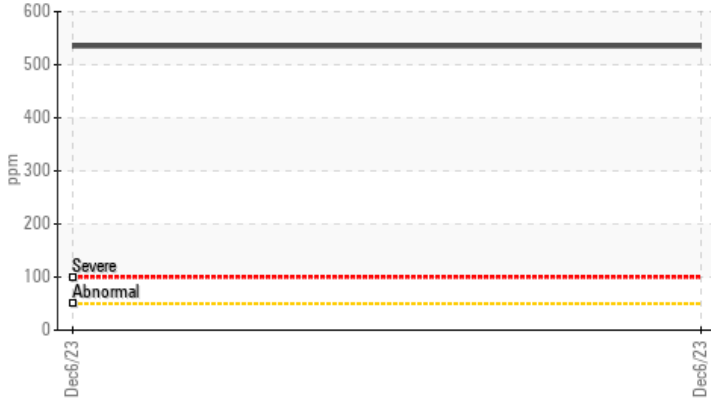

▲ Particle Trend

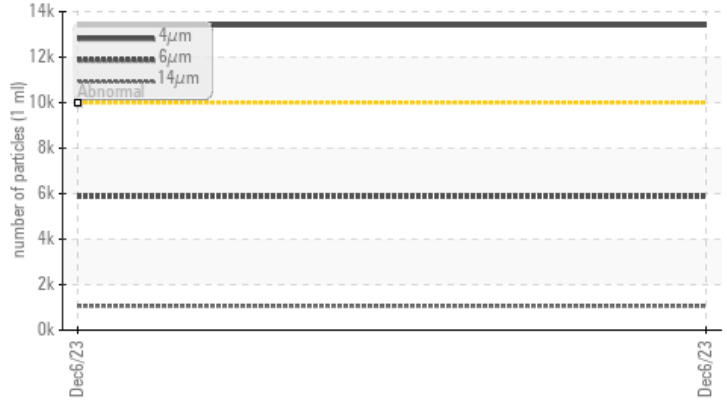

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	---	---
Silicon	ppm	ASTM D5185m	>50	● 535	---	---
Particles >4µm		ASTM D7647	>10000	▲ 13403	---	---
Particles >6µm		ASTM D7647	>2500	▲ 5867	---	---
Particles >14µm		ASTM D7647	>320	▲ 1057	---	---
Particles >21µm		ASTM D7647	>80	▲ 348	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	▲ 21/20/17	---	---

Customer Id: GEVDOO
 Sample No.: WC06027696
 Lab Number: 06027696
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS




OIL ANALYSIS REPORT

Sample Rating Trend

DIRT



Area
RNG
 Machine Id
C101A Feed Compressor
 Component
Screw Compressor
 Fluid
CPI ENG. 6005-150 (--- GAL)

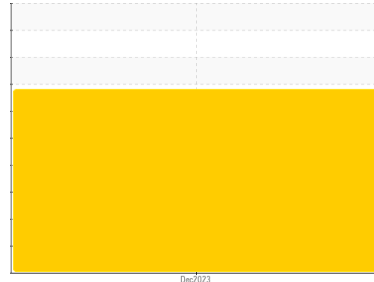

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. Elemental level of silicon (Si) above normal.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC06027696	---	---
Sample Date	Client Info		06 Dec 2023	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			SEVERE	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >60	7	---	---
Chromium	ppm	ASTM D5185m >4	<1	---	---
Nickel	ppm	ASTM D5185m	<1	---	---
Titanium	ppm	ASTM D5185m	0	---	---
Silver	ppm	ASTM D5185m	0	---	---
Aluminum	ppm	ASTM D5185m >5	<1	---	---
Lead	ppm	ASTM D5185m >10	0	---	---
Copper	ppm	ASTM D5185m >30	<1	---	---
Tin	ppm	ASTM D5185m >15	0	---	---
Vanadium	ppm	ASTM D5185m	0	---	---
Cadmium	ppm	ASTM D5185m	0	---	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---	---
Barium	ppm	ASTM D5185m	0	---	---
Molybdenum	ppm	ASTM D5185m	<1	---	---
Manganese	ppm	ASTM D5185m	<1	---	---
Magnesium	ppm	ASTM D5185m	1	---	---
Calcium	ppm	ASTM D5185m	4	---	---
Phosphorus	ppm	ASTM D5185m	17	---	---
Zinc	ppm	ASTM D5185m	0	---	---
Sulfur	ppm	ASTM D5185m	673	---	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	535	---	---
Sodium	ppm	ASTM D5185m	16	---	---
Potassium	ppm	ASTM D5185m >20	<1	---	---
Water	%	ASTM D6304 >0.1	NEG	---	---

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	13403	---	---
Particles >6µm	ASTM D7647	>2500	5867	---	---
Particles >14µm	ASTM D7647	>320	1057	---	---
Particles >21µm	ASTM D7647	>80	348	---	---
Particles >38µm	ASTM D7647	>20	13	---	---
Particles >71µm	ASTM D7647	>4	1	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	21/20/17	---	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.51	---	---



OIL ANALYSIS REPORT

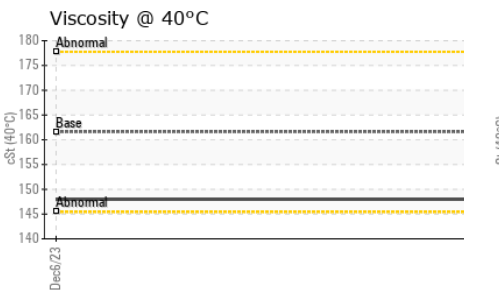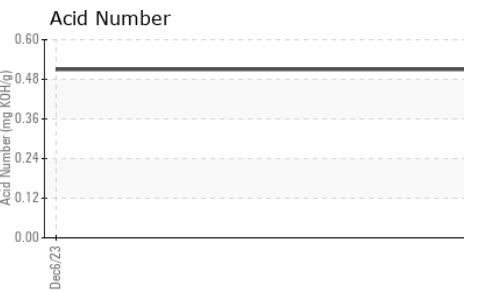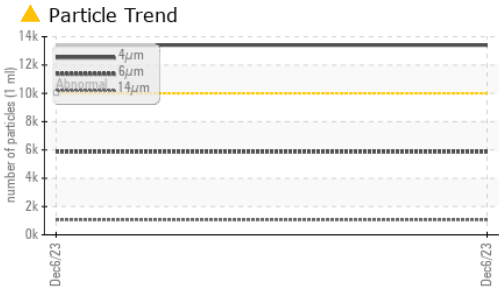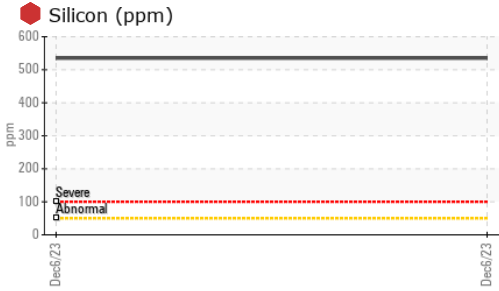






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	161.6	148	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

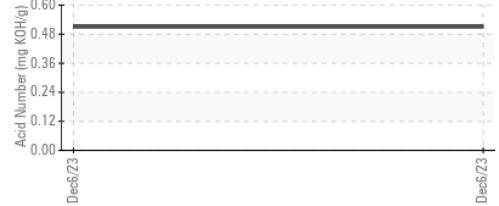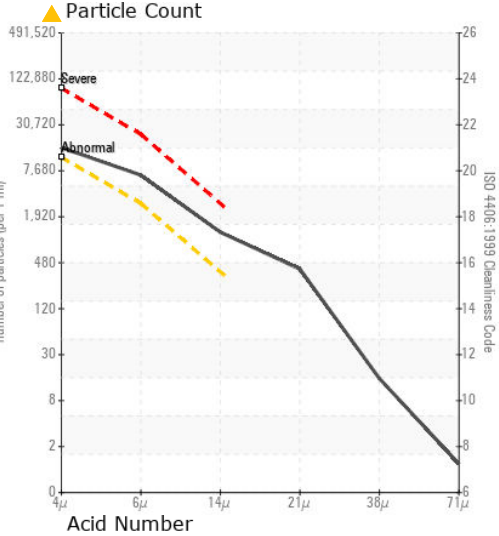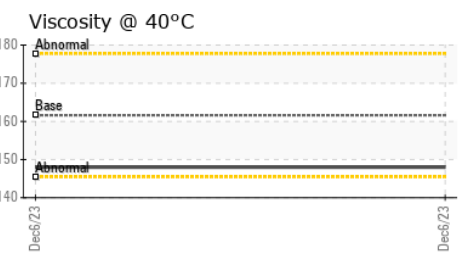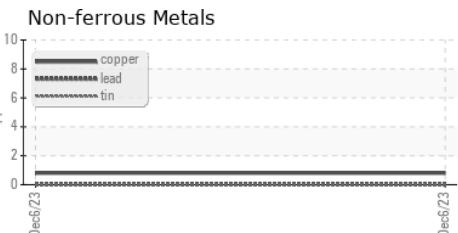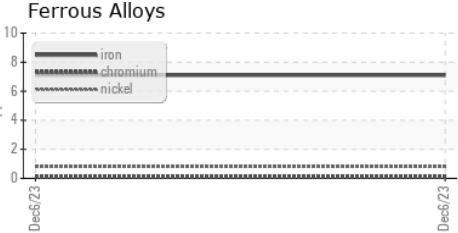

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC06027696 **Received** : 07 Dec 2023
Lab Number : 06027696 **Diagnosed** : 11 Dec 2023
Unique Number : 10777487 **Diagnostician** : Jonathan Hester
Test Package : PLANT

GEVO Inc.
 2498 250th Street
 Doon, IA
 US 51235
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: