



# PROBLEM SUMMARY

Sample Rating Trend


ISO

Area  
**MVD**  
 Machine Id  
**B-03-411 Pressure Displacement Blower Drive End**  
 Component  
**Drive End Compressor**  
 Fluid  
**GARDNER DENVER AEON PD (--- GAL)**



## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

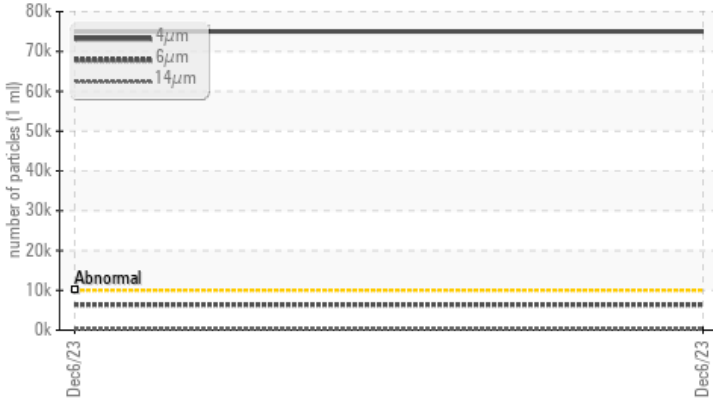

## RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >4µm	ASTM D7647	>10000	▲ <b>75012</b>	---	---
Particles >6µm	ASTM D7647	>2500	▲ <b>6386</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ <b>23/20/15</b>	---	---

Customer Id: GEVDOO  
 Sample No.: WC06027697  
 Lab Number: 06027697  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component if applicable.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend

ISO



Area  
**MVD**

Machine Id

## B-03-411 Pressure Displacement Blower Drive End

Component

**Drive End Compressor**

Fluid

**GARDNER DENVER AEON PD (--- GAL)**



### DIAGNOSIS

#### Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC06027697</b>	---	---
Sample Date	Client Info		<b>06 Dec 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>19</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>656</b>	---	---
Zinc	ppm	ASTM D5185m	<b>0</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>707</b>	---	---

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>16</b>	---	---
Sodium	ppm	ASTM D5185m	<b>0</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.1	<b>NEG</b>	---	---


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 75012</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>▲ 6386</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>258</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>68</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>3</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 23/20/15</b>	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.01</b>	---	---




# OIL ANALYSIS REPORT


### ▲ Particle Trend

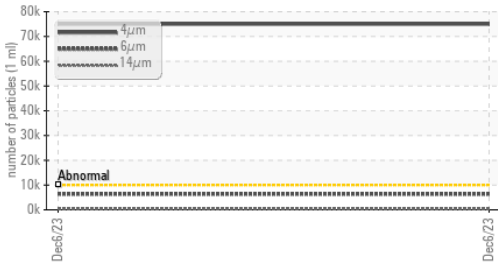

### ▲ Particle Trend

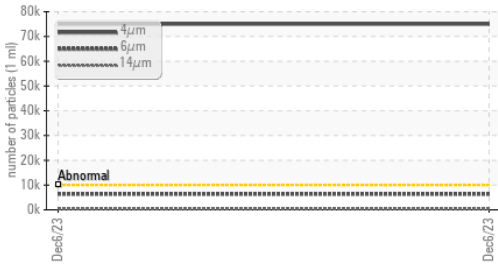

### Acid Number

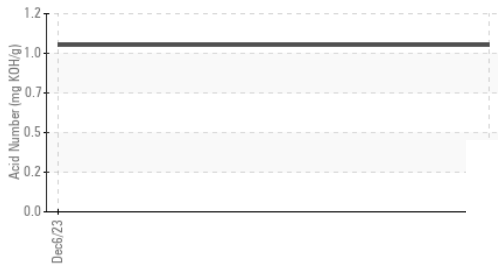

### Viscosity @ 40°C








VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 214	205	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

### GRAPHS

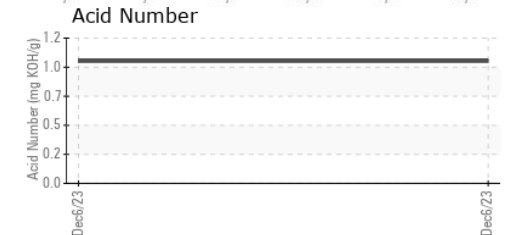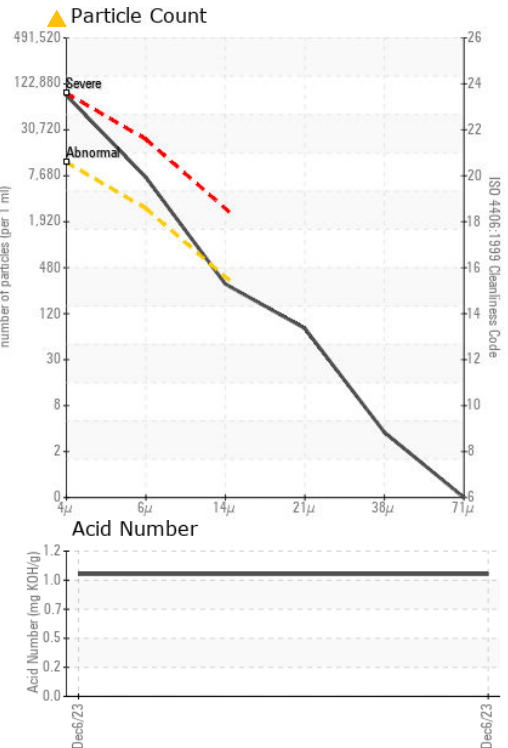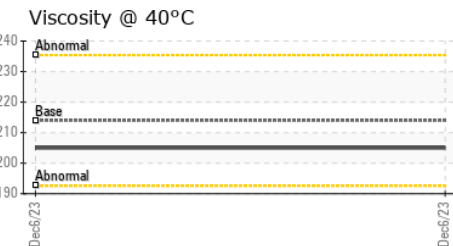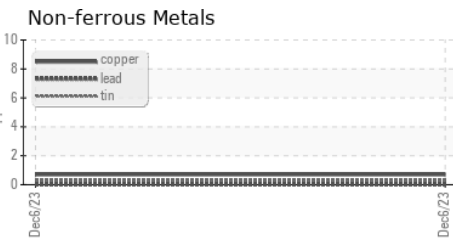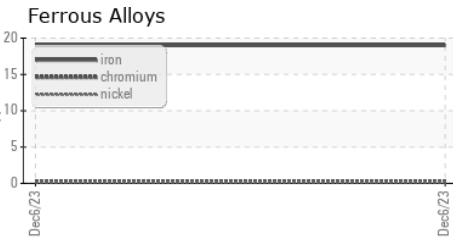

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC06027697 **Received** : 07 Dec 2023  
**Lab Number** : 06027697 **Diagnosed** : 11 Dec 2023  
**Unique Number** : 10777488 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT

**GEVO Inc.**  
 2498 250th Street  
 Doon, IA  
 US 51235  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: