




# OIL ANALYSIS REPORT

Sample Rating Trend

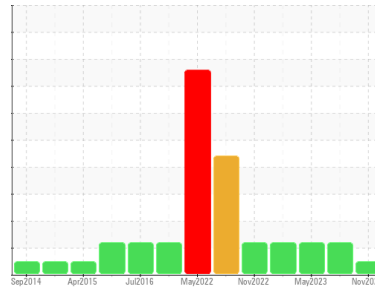

**NORMAL**



Area  
**WOOD SUPPLY**  
 Machine Id  
**0120 CC02**

Component  
**Reservoir Gearbox**  
 Fluid  
**SUMMIT Syngear SH-1022 220 (7 LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0842380</b>	WC0806871	WC0730500
Sample Date	Client Info	<b>06 Nov 2023</b>	10 Aug 2023	09 May 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	Not Changd	Not Changd
Sample Status		<b>NORMAL</b>	ABNORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184	<b>24</b>	19	---	
Iron	ppm	ASTM D5185m >200	<b>14</b>	12	11
Chromium	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >15	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>2</b>	<1	0
Lead	ppm	ASTM D5185m >100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >200	<b>&lt;1</b>	<1	0
Tin	ppm	ASTM D5185m >25	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>57</b>	49	80
Barium	ppm	ASTM D5185m	<b>6</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>0</b>	3	<1
Phosphorus	ppm	ASTM D5185m	<b>485</b>	433	427
Zinc	ppm	ASTM D5185m	<b>4</b>	13	7
Sulfur	ppm	ASTM D5185m	<b>8517</b>	7727	8401

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	<b>6</b>	3	1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>1</b>	<1	<1
Water	%	ASTM D6304 >0.2	<b>0.00</b>	0.017	---
ppm Water	ppm	ASTM D6304 >2000	<b>0</b>	173.6	---

## FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >80000	<b>72225</b>	▲ 76492	▲ 71992
Particles >6µm	ASTM D7647 >20000	<b>7251</b>	▲ 9611	▲ 9181
Particles >14µm	ASTM D7647 >2500	<b>152</b>	177	145
Particles >21µm	ASTM D7647 >640	<b>25</b>	35	21
Particles >38µm	ASTM D7647 >160	<b>0</b>	3	0
Particles >71µm	ASTM D7647 >40	<b>0</b>	2	0
Oil Cleanliness	ISO 4406 (c) >23/21/18	<b>23/20/14</b>	▲ 23/20/15	▲ 23/20/14

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.70</b>	0.76	0.70




# OIL ANALYSIS REPORT

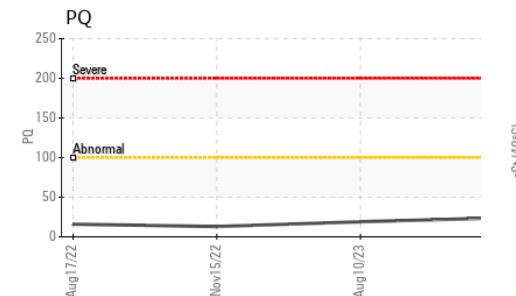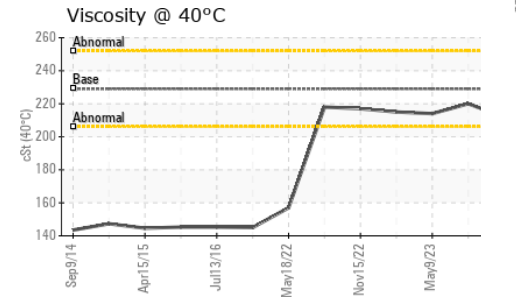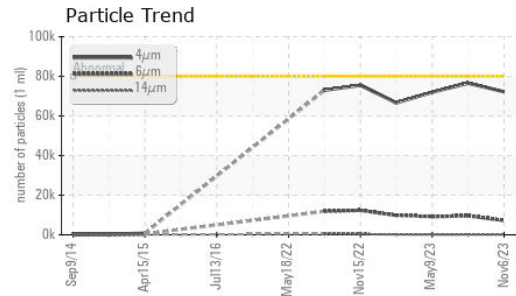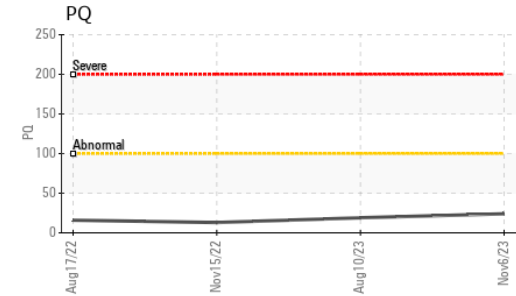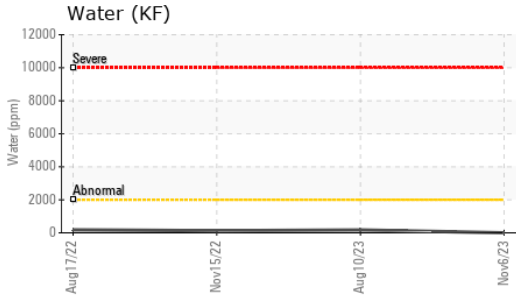






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	229	212	220

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

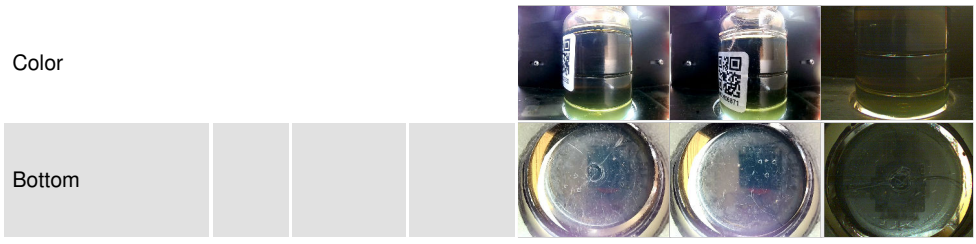

## GRAPHS

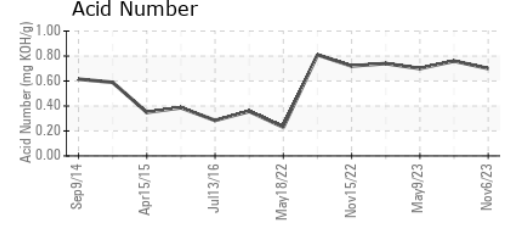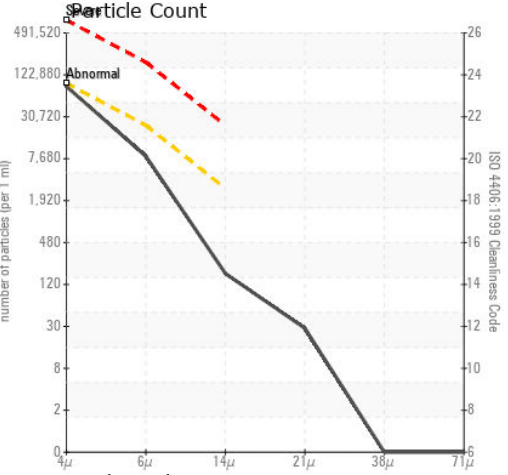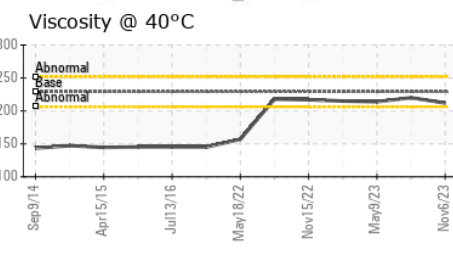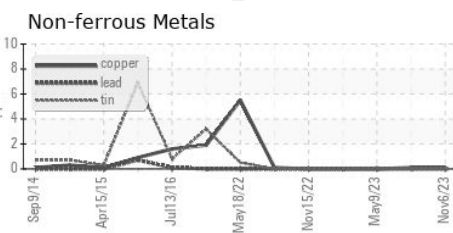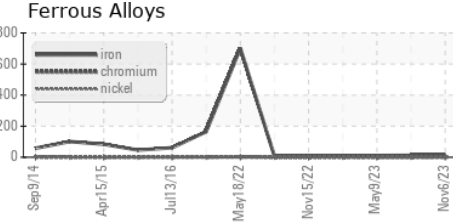

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0842380 **Received** : 07 Dec 2023  
**Lab Number** : 06027735 **Diagnosed** : 08 Dec 2023  
**Unique Number** : 10777526 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KF, PQ, PrtCount )

**ARAUCO FLAKEBOARD - MDF**  
 985 CORINTH RD  
 MONCURE, NC  
 US  
 Contact: JAMES WALTON  
 james.walton@arauco.com  
 T: (919)642-6696  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)