



# PROBLEM SUMMARY

Sample Rating Trend



ISO




Machine Id  
**KAESER 8835250**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

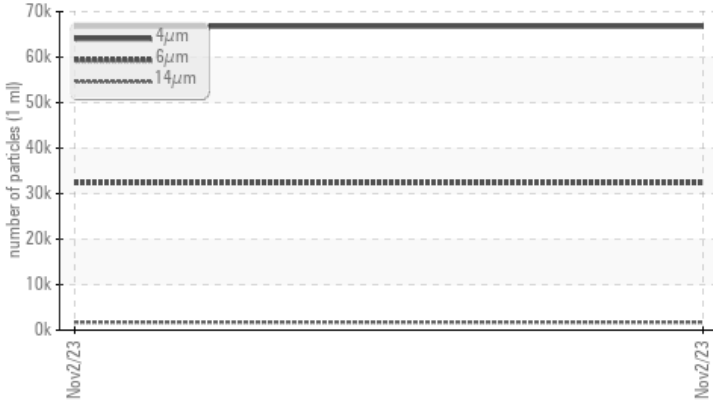

## RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ABNORMAL</b>	---	---
Particles >6µm	ASTM D7647	>1300	▲ <b>32355</b>	---	---
Particles >14µm	ASTM D7647	>80	▲ <b>1737</b>	---	---
Particles >21µm	ASTM D7647	>20	▲ <b>249</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>23/22/18</b>	---	---

**Customer Id:** BRIPIC  
**Sample No.:** KC111453  
**Lab Number:** 06027743  
**Test Package:** IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id  
**KAESER 8835250**

Component  
**Compressor**  
Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KC111453</b>	---	---
Sample Date	Client Info			<b>02 Nov 2023</b>	---	---
Machine Age	hrs	Client Info		<b>1304</b>	---	---
Oil Age	hrs	Client Info		<b>1304</b>	---	---
Oil Changed	Client Info			<b>Changed</b>	---	---
Sample Status				<b>ABNORMAL</b>	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>3</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	>3	<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	>2	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	---	---
Lead	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>3</b>	---	---
Tin	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m	90	<b>6</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	90	<b>51</b>	---	---
Calcium	ppm	ASTM D5185m	2	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>35</b>	---	---
Zinc	ppm	ASTM D5185m		<b>7</b>	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>1</b>	---	---
Sodium	ppm	ASTM D5185m		<b>10</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	---	---
Water	%	ASTM D6304	>0.05	<b>0.013</b>	---	---
ppm Water	ppm	ASTM D6304	>500	<b>140</b>	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>66753</b>	---	---
Particles >6µm		ASTM D7647	>1300	▲ <b>32355</b>	---	---
Particles >14µm		ASTM D7647	>80	▲ <b>1737</b>	---	---
Particles >21µm		ASTM D7647	>20	▲ <b>249</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>4</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ <b>23/22/18</b>	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.31</b>	---	---

# OIL ANALYSIS REPORT

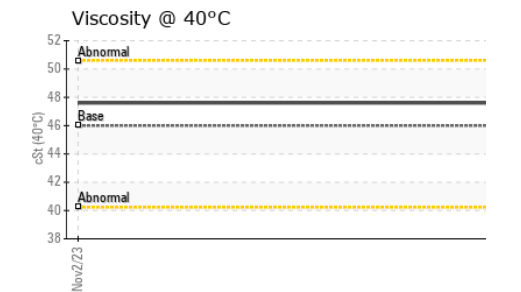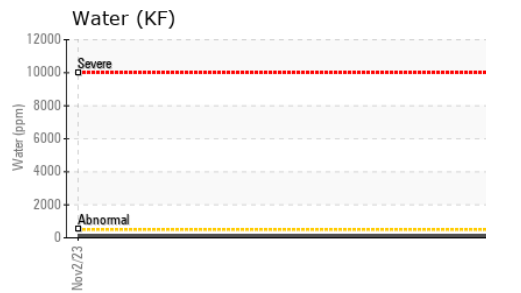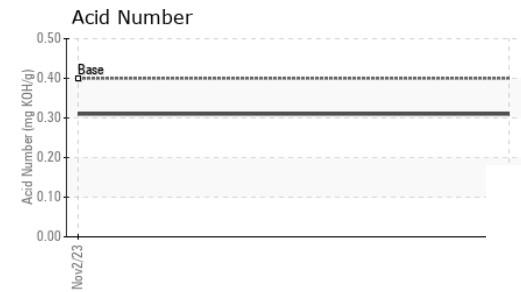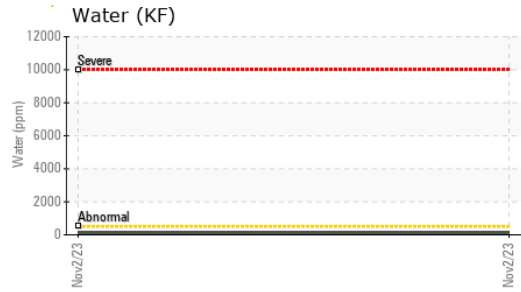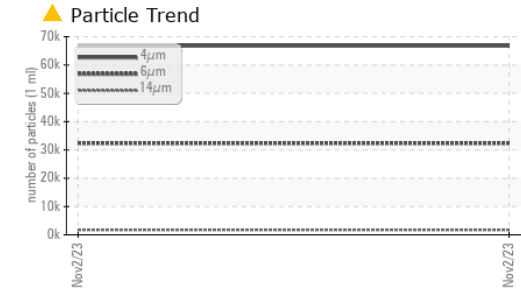





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	47.6	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

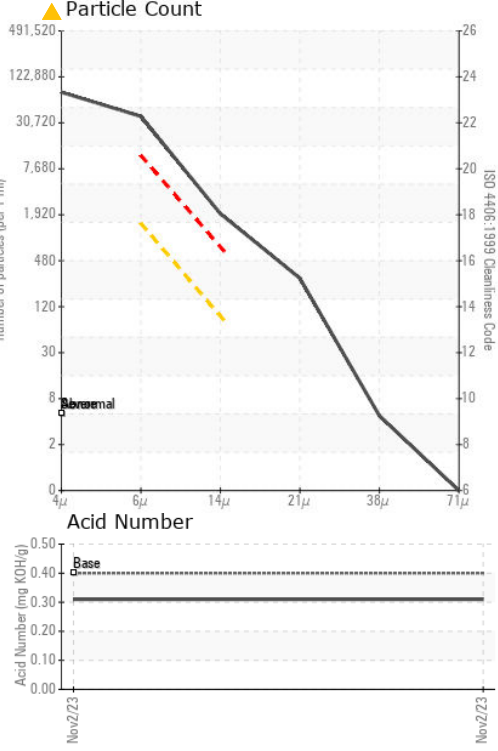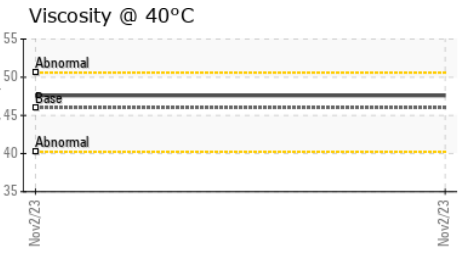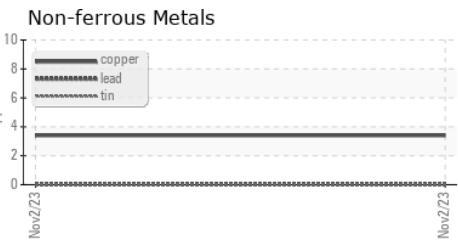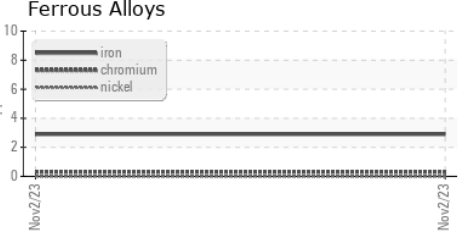

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC111453  
**Lab Number** : 06027743  
**Unique Number** : 10777534  
**Test Package** : IND 2

**BRIDGE BROTHERS**  
 225 PUMPKINTOWN HWY, BUILDING 19  
 PICKENS, SC  
 US 29671  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)