


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id KAESER DSD 200 5656227 (S/N 1004)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

652016 Aug/2018 F652019 Ju2019 Mar2020 Nov2020 Jun2021 Dec2021 Sep2022 Nov202						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC99586	KC112042	KC96693
Sample Date		Client Info		09 Nov 2023	23 May 2023	07 Sep 2022
Machine Age	hrs	Client Info		58883	55000	48811
Oil Age	hrs	Client Info		800	8026	6159
Oil Changed		Client Info		Not Changd	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>2	0	0	<1
Aluminum	ppm	ASTM D5185m	>10	2	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	8	<1	2
Tin	ppm	ASTM D5185m	>10	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	5	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	2	<1	0
Calcium	ppm	ASTM D5185m	2	0	0	0
Phosphorus	ppm	ASTM D5185m		31	0	4
Zinc	ppm	ASTM D5185m		0	0	0
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		0	<1	0
Potassium	ppm	ASTM D5185m	>20	1	0	0
Water	%	ASTM D6304	>0.05	0.009	0.005	0.011
ppm Water	ppm	ASTM D6304	>500	94	58.4	114.1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3683	1898	325
Particles >6µm		ASTM D7647	>1300	752	297	86
Particles >14µm		ASTM D7647	>80	31	10	14
Particles >21µm		ASTM D7647	>20	7	4	4
Particles >38μm		ASTM D7647	>4	0	1	0
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/12	18/15/10	16/14/11
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.43	0.51	0.52



OIL ANALYSIS REPORT

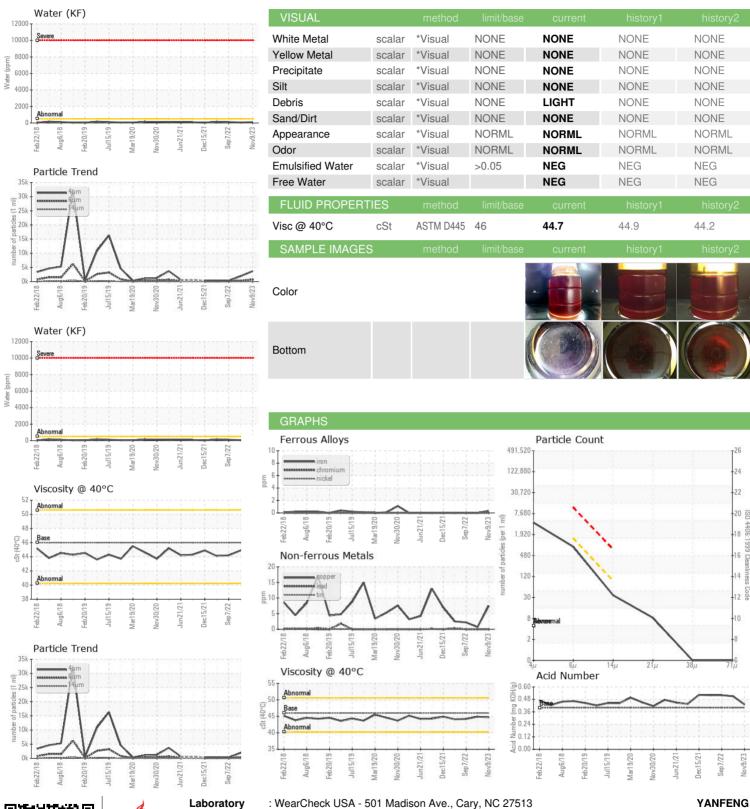





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: KC99586 : 06027754

: 10777545 : IND 2

: 07 Dec 2023 Received Diagnosed

: 08 Dec 2023 Diagnostician : Doug Bogart 101 INTERNATIONAL BLVD FOUNTAIN INN, SC US 29644

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: