


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id L14 Component Pump Fluid

USPI VAC 100 (--- LTR)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan2021	Jun2021 Dec2021	Jun2022 Dec2022 May2023	Nov2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM31938	USPM29411	USPM28429
Sample Date		Client Info		29 Nov 2023	18 Aug 2023	22 May 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	0	<1	<1
Chromium	ppm	ASTM D5185m	>5	<1	0	<1
Nickel	ppm	ASTM D5185m	>5	0	0	<1
Titanium	ppm	ASTM D5185m	>3	<1	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	0	0	0
Lead	ppm	ASTM D5185m	>12	0	0	<1
Copper	ppm	ASTM D5185m	>30	<1	0	0
Tin	ppm	ASTM D5185m	>9	0	<1	1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	0	<1	0	0
Calcium	ppm	ASTM D5185m	0	0	2	<1
Phosphorus	ppm	ASTM D5185m	1800	1329	1369	1367
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	105	113	83
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	16	13	10
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	1	0	1
Water	%	ASTM D6304	>.1	0.018	0.076	0.050
ppm Water	ppm	ASTM D6304	>1000	186	766.7	506.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	96	305	204
Particles >6µm		ASTM D7647	>2500	27	105	91
Particles >14µm		ASTM D7647	>640	9	28	23
Particles >21µm		ASTM D7647	>160	3	9	9
Particles >38µm		ASTM D7647	>40	0	1	1
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	14/12/10	15/14/12	15/14/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.10	0.10	0.07



OIL ANALYSIS REPORT

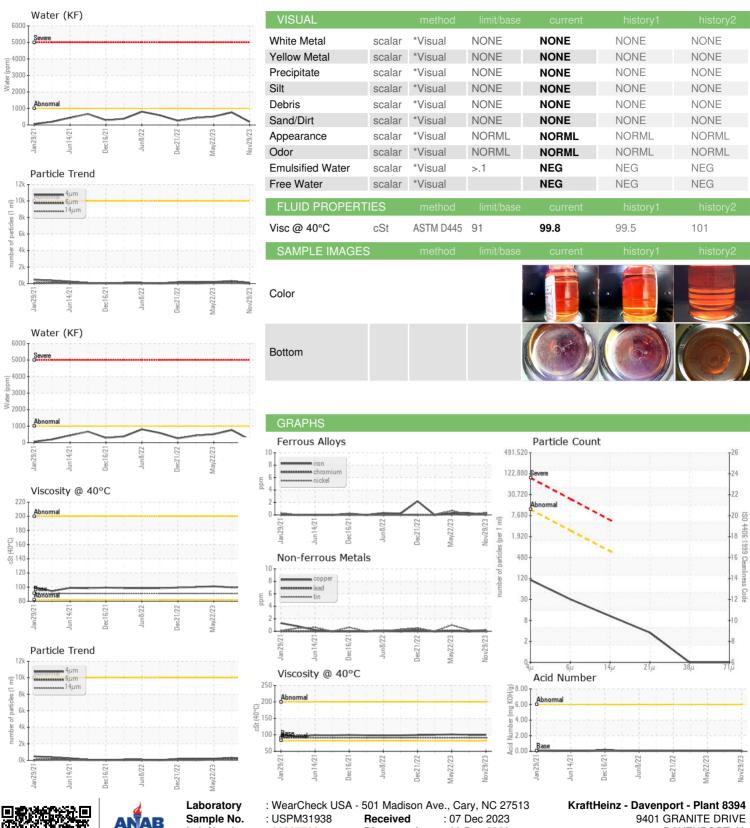



Certificate L2367

Lab Number **Unique Number**

Test Package : IND 2

: 06027762

: 10777553

: 08 Dec 2023 Diagnosed Diagnostician : Doug Bogart

DAVENPORT, IA US 52802

Contact: JOHN KONRAD john.konrad@kraftheinz.com

F: (563)326-8391

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: