




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

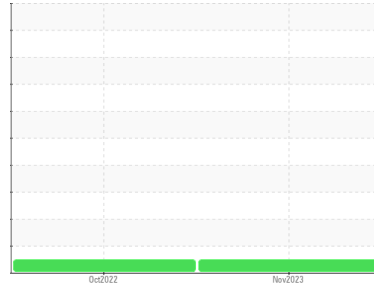

Area
SIGMA [SP2515815]
 Machine Id
KAESER 1013-2 - BAY AREA PRODUCTION SERVICES
 Component
Compressor

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|----------|
| Sample Number | Client Info | | UCH06027902 | UCH05676774 | --- |
| Sample Date | Client Info | | 28 Nov 2023 | 12 Oct 2022 | --- |
| Machine Age | hrs | Client Info | 33962 | 30485 | --- |
| Oil Age | hrs | Client Info | 2977 | 0 | --- |
| Oil Changed | Client Info | | Not Changed | Changed | --- |
| Sample Status | | | NORMAL | NORMAL | --- |

WEAR METALS

| | method | limit/base | current | history1 | history2 |
|----------|--------|-----------------|--------------|----------|----------|
| Iron | ppm | ASTM D5185m >50 | <1 | 0 | --- |
| Chromium | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Nickel | ppm | ASTM D5185m >3 | 0 | 0 | --- |
| Titanium | ppm | ASTM D5185m >3 | 0 | 0 | --- |
| Silver | ppm | ASTM D5185m >2 | 0 | 0 | --- |
| Aluminum | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Lead | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Copper | ppm | ASTM D5185m >50 | 7 | 7 | --- |
| Tin | ppm | ASTM D5185m >10 | 0 | 0 | --- |
| Vanadium | ppm | ASTM D5185m | 0 | 0 | --- |
| Cadmium | ppm | ASTM D5185m | 0 | 0 | --- |

ADDITIVES

| | method | limit/base | current | history1 | history2 |
|------------|--------|-------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | 0 | 0 | --- |
| Barium | ppm | ASTM D5185m | 0 | 0 | --- |
| Molybdenum | ppm | ASTM D5185m | 0 | 0 | --- |
| Manganese | ppm | ASTM D5185m | <1 | 0 | --- |
| Magnesium | ppm | ASTM D5185m | 0 | 0 | --- |
| Calcium | ppm | ASTM D5185m | 0 | 0 | --- |
| Phosphorus | ppm | ASTM D5185m | 117 | 3 | --- |
| Zinc | ppm | ASTM D5185m | 0 | 0 | --- |
| Sulfur | ppm | ASTM D5185m | 7966 | 22357 | --- |

CONTAMINANTS




| | method | limit/base | current | history1 | history2 |
|-----------|--------|------------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m >25 | <1 | <1 | --- |
| Sodium | ppm | ASTM D5185m | 2 | 0 | --- |
| Potassium | ppm | ASTM D5185m >20 | 0 | 0 | --- |
| Water | % | ASTM D6304 >0.05 | 0.056 | --- | --- |
| ppm Water | ppm | ASTM D6304 >500 | 560 | --- | --- |

FLUID DEGRADATION

| | method | limit/base | current | history1 | history2 |
|------------------|----------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.24 | 0.52 | --- |




OIL ANALYSIS REPORT

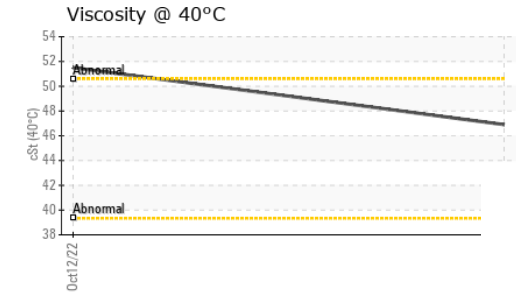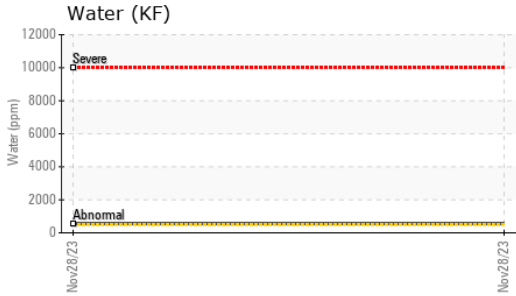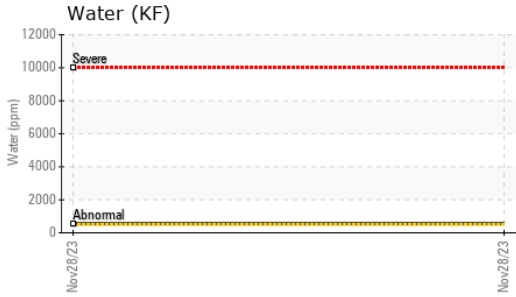





| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | --- |
| Precipitate | scalar | *Visual | NONE | NONE | --- |
| Silt | scalar | *Visual | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | LIGHT |
| Sand/Dirt | scalar | *Visual | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.05 | 0.2% | NEG |
| Free Water | scalar | *Visual | | NEG | --- |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 46.9 | 51.5 | --- |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

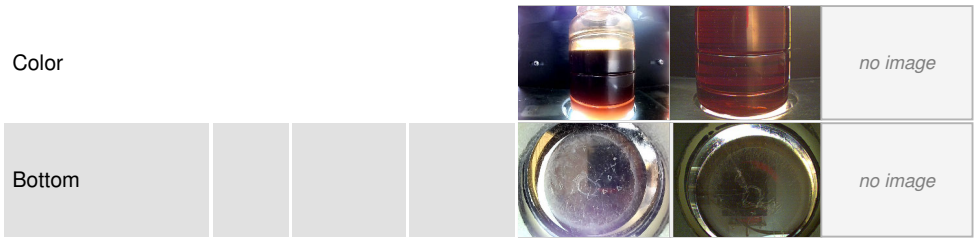

GRAPHS

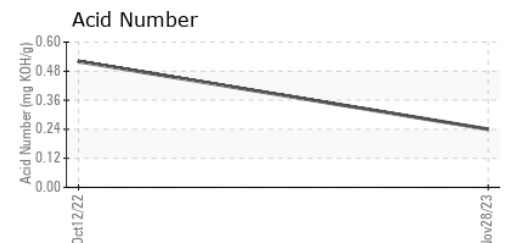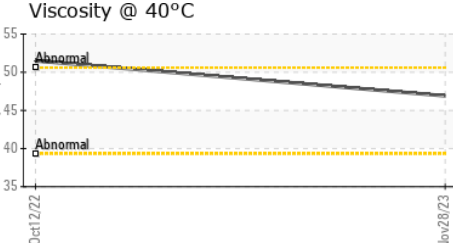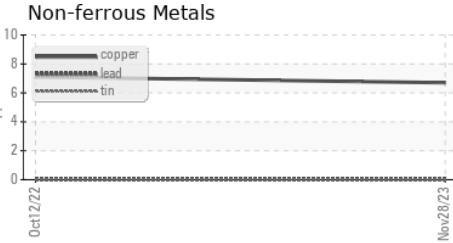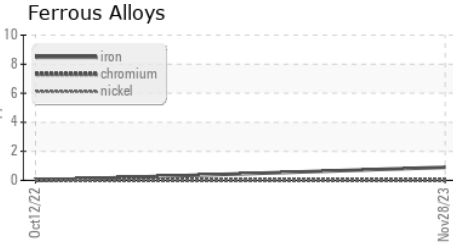

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06027902 **Received** : 07 Dec 2023
Lab Number : 06027902 **Diagnosed** : 11 Dec 2023
Unique Number : 10777693 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF)

CISCO AIR SYSTEMS
 2373 LINCOLN AVE
 HAYWARD, CA
 US 94545
 Contact: JOHN FINCH
 jfinch@ciscoair.com
 T: (916)414-0331
 F: x:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)