




# OIL ANALYSIS REPORT

Sample Rating Trend

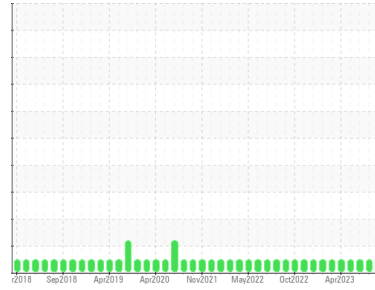

**NORMAL**



Area

**DF8**

Machine Id

**KAESER 4011 - NESTLE PURINA PET CARE (S/N 1028)**

Component

**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06027904</b>	UCH05999147	UCH05973725
Sample Date	Client Info		<b>06 Dec 2023</b>	05 Nov 2023	08 Oct 2023
Machine Age	hrs	Client Info	<b>0</b>	141521	1248
Oil Age	hrs	Client Info	<b>2525</b>	1826	0
Oil Changed	Client Info		<b>Not Changed</b>	N/A	Not Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	<1	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 1	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0.3	<b>0</b>	4	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m 0.5	<b>0</b>	<1	2
Phosphorus	ppm	ASTM D5185m 536	<b>52</b>	80	38
Zinc	ppm	ASTM D5185m 0.2	<b>0</b>	0	<1
Sulfur	ppm	ASTM D5185m 649	<b>225</b>	302	185

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	0
Sodium	ppm	ASTM D5185m	<b>2</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>0</b>	1	1

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.337	<b>0.45</b>	0.41	0.82




# OIL ANALYSIS REPORT

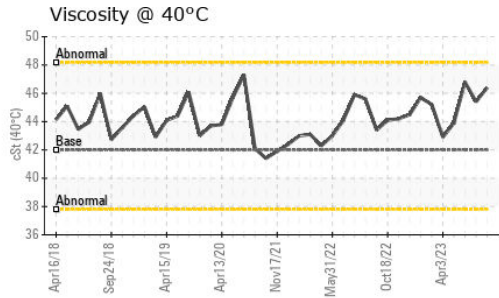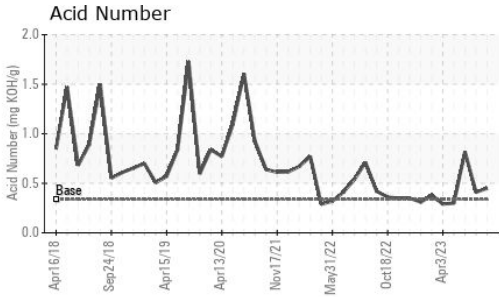





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	42.0	<b>46.4</b>	45.4	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

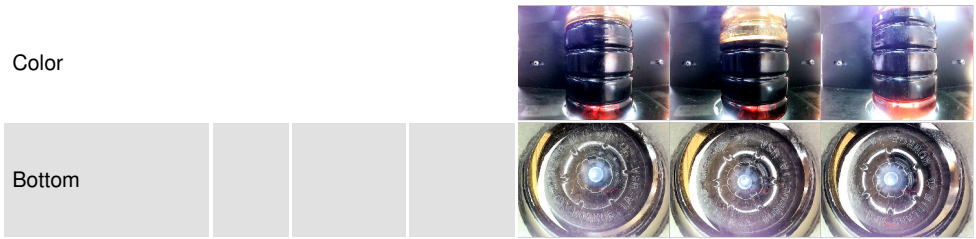

## GRAPHS

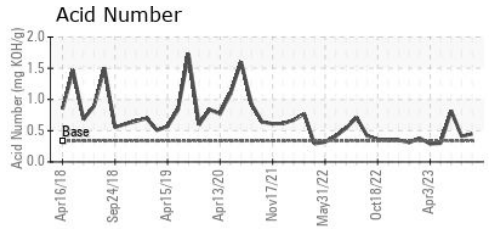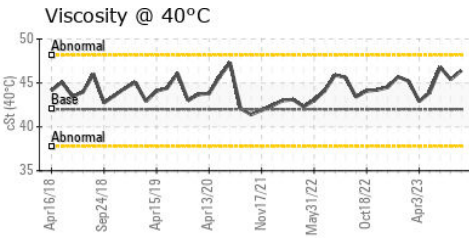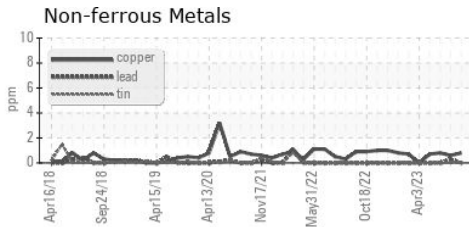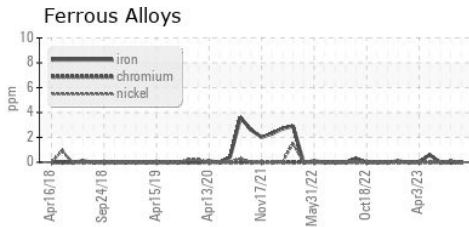

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06027904 **Received** : 07 Dec 2023  
**Lab Number** : **06027904** **Diagnosed** : 09 Dec 2023  
**Unique Number** : 10777695 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**DELTA INDUSTRIES - CEDAR RAPIDS**  
 6540 4TH ST SW  
 CEDAR RAPIDS, IA  
 US 52404  
 Contact: MICHAEL FERRIS  
 wearcheck@deltaind.net  
 T: (319)862-2500  
 F: (319)862-2501

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)