




# OIL ANALYSIS REPORT

Sample Rating Trend

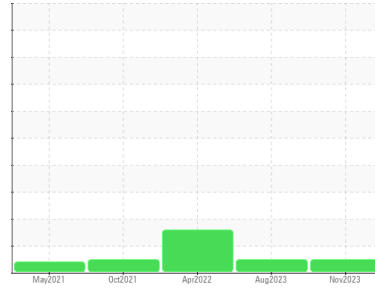

**NORMAL**



Area  
**CFG-546 [O-SP2763787]**  
 Machine Id  
**GARDNER DENVER S419859 - GRIMMWAY MALAGA**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

Moderate concentration of visible dirt/debris present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UCH06027908</b>	UCH05958690	UCH05527115
Sample Date	Client Info		<b>20 Nov 2023</b>	18 Aug 2023	12 Apr 2022
Machine Age	hrs	Client Info	<b>68272</b>	66076	54751
Oil Age	hrs	Client Info	<b>2814</b>	568	4295
Oil Changed	Client Info		<b>Changed</b>	Not Changd	Changed
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	5
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	1	<1
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>7</b>	<1	3
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	1
Barium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m 0	<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m 1.2	<b>0</b>	2	0
Calcium	ppm	ASTM D5185m 0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m 295	<b>181</b>	276	93
Zinc	ppm	ASTM D5185m 0	<b>17</b>	0	142
Sulfur	ppm	ASTM D5185m 253	<b>584</b>	1129	309

## CONTAMINANTS



	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	1	<1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	2	0

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.252	<b>0.44</b>	0.48	▲ 1.52




# OIL ANALYSIS REPORT

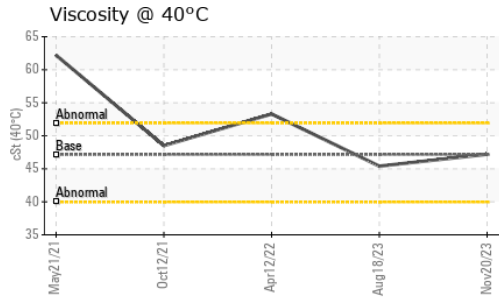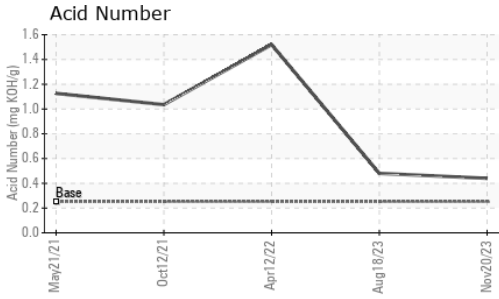





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	<b>MODER</b>	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	47.16	<b>47.2</b>	45.4 ▲ 53.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

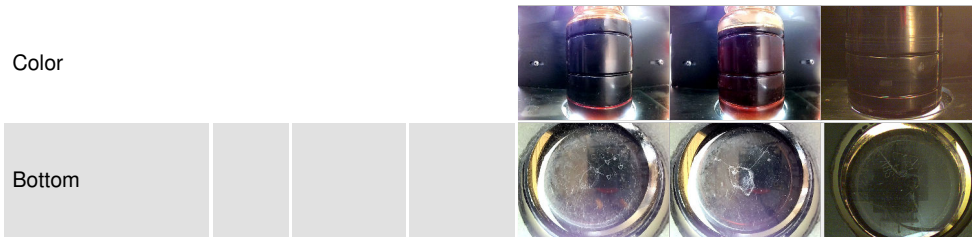

## GRAPHS

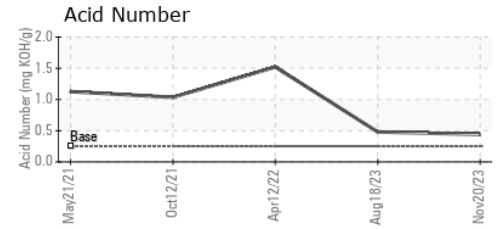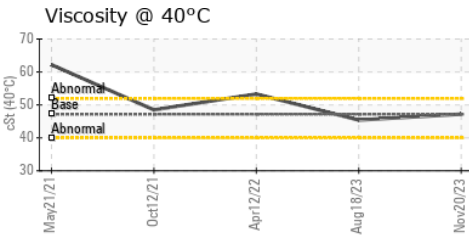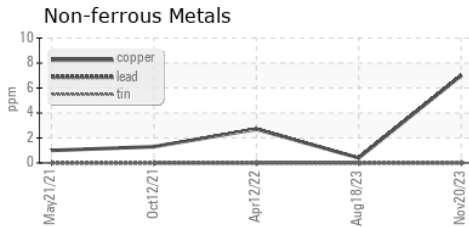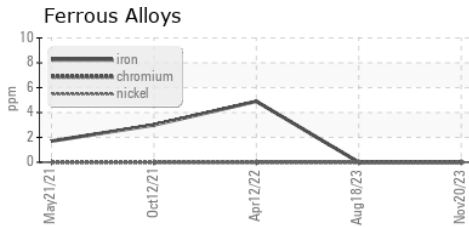

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH06027908 **Received** : 07 Dec 2023  
**Lab Number** : **06027908** **Diagnosed** : 09 Dec 2023  
**Unique Number** : 10777699 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**CISCO AIR SYSTEMS**  
 214 27TH ST  
 SACRAMENTO, CA  
 US 95816

Contact: BARRY FRKOVICH  
 barryfrkovich@ciscoair.com

T: (916)444-2525

F: x: