


PROBLEM SUMMARY

Sample Rating Trend




DEGRADATION

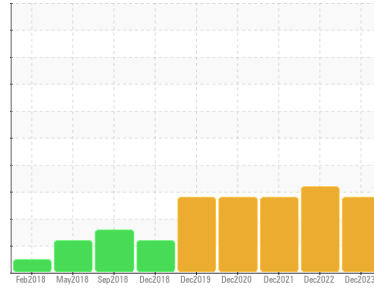


Area
COOLING TOWER
Machine Id
Motor - WEST COOLING TOWER PUMP (S/N P613M)
Component
Bearing
Fluid
TURBINE OIL ISO 32 (6 QTS)

COMPONENT CONDITION SUMMARY

▲ Acid Number

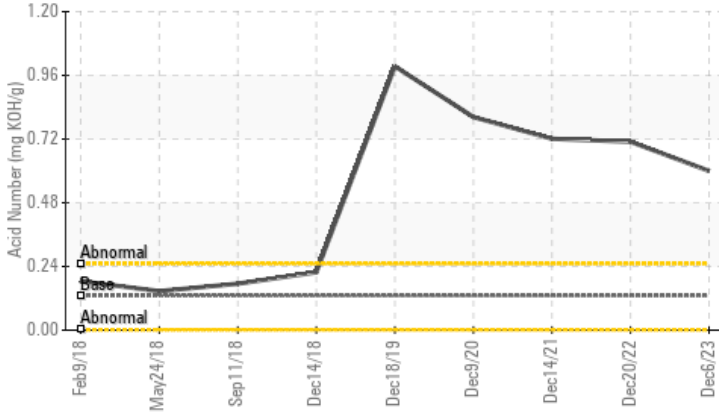

▲ Additives

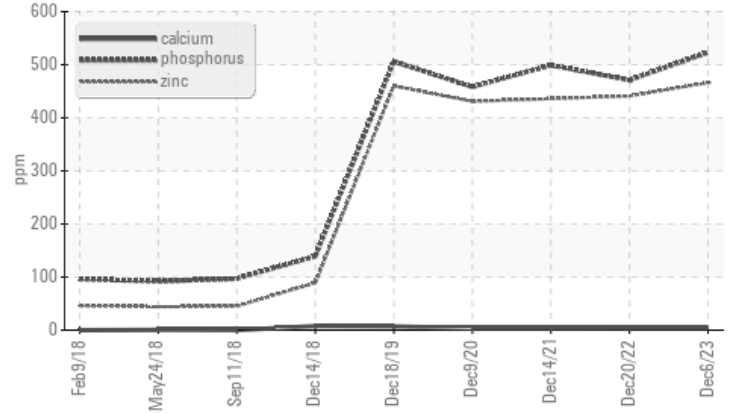

RECOMMENDATION

Oil profile does not match the reference oil on file. Please provide a reference oil sample for the lab to test against. No other action required at this time. Resample at next normal interval.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Molybdenum	ppm	ASTM D5185m	5	▲ 214	▲ 219	▲ 232
Phosphorus	ppm	ASTM D5185m	275	▲ 523	▲ 471	▲ 499
Zinc	ppm	ASTM D5185m	7	▲ 466	▲ 441	▲ 436
Sulfur	ppm	ASTM D5185m	400	▲ 1675	▲ 1478	▲ 1559
Acid Number (AN)	mg KOH/g	ASTM D8045	0.13	▲ 0.60	▲ 0.71	▲ 0.721

Customer Id: HEXDIB
Sample No.: PLS0000654
Lab Number: 06028590
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Mike Johnson +1 (615)771-6030
mike.johnson@amrri.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

20 Dec 2022 Diag: Mike Johnson

DEGRADATION



Oil profile does not match the reference oil on file. Please provide a reference oil sample for the lab to test against. No other action required at this time. Resample at next normal interval. Wear Particles are low and acceptable. Contamination is low and acceptable. Some light debris was found in the sample. Fluid health indicators are steady when compared with previous samples, but can be verified with a reference sample on file.

[view report](#)



14 Dec 2021 Diag: Mike Johnson

DEGRADATION



Confirm that reference oil is correct. The additive profile does not match the oil on file, but are consistent with previous samples. Resample at next normal interval and indicate exact oil used on label. Wear particles are low and acceptable. Particle contaminants are low and acceptable. Fluid additives are not consistent with reference oil on file. Additives are consistent with previous sampling.

[view report](#)



09 Dec 2020 Diag: Mike Johnson

DEGRADATION




Wear rate is low and steady. PQ (large bits of ferro-magnetic) reading is still elevated, but is steady. No further action at this time. Continue to monitor. Wear rate is low and steady. Contaminant level (particulate, moisture) is low and appropriate. Fluid health indicators suggest that the oil is acceptable for continued use. There appears to still be additive mixing in this drive which can influence the AN values, giving misleading indicators of failing oil health. Please VERIFY that the oil in use is properly noted on the submission form when sending in a sample.

[view report](#)



OIL ANALYSIS REPORT

Sample Rating Trend

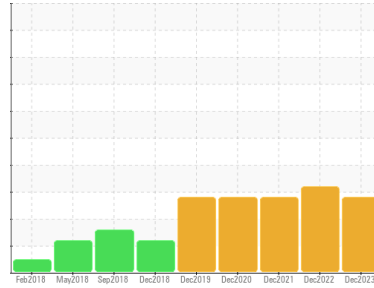

DEGRADATION



Area
COOLING TOWER
Machine Id
Motor - WEST COOLING TOWER PUMP (S/N P613M)
Component
Bearing
Fluid
TURBINE OIL ISO 32 (6 QTS)

DIAGNOSIS

Recommendation

Oil profile does not match the reference oil on file. Please provide a reference oil sample for the lab to test against. No other action required at this time. Resample at next normal interval.

Wear

Wear Particles are low and acceptable.

Contamination

Contamination is low and acceptable.

Fluid Condition

Fluid health indicators are steady when compared with previous samples, but can be verified with a reference sample on file.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PLS0000654	PLS0000641	PLS0000236
Sample Date	Client Info			06 Dec 2023	20 Dec 2022	14 Dec 2021
Machine Age	yrs	Client Info		0	16	15
Oil Age	yrs	Client Info		0	5	4
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	NEG	NEG	NEG






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184		13	9	10
Iron	ppm	ASTM D5185m	>20	0	<1	<1
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	0	0
Lead	ppm	ASTM D5185m	>20	0	0	0
Copper	ppm	ASTM D5185m	>20	2	1	1
Tin	ppm	ASTM D5185m	>20	0	0	0
Antimony	ppm	ASTM D5185m		---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	5	5	0	2
Barium	ppm	ASTM D5185m	5	0	0	0
Molybdenum	ppm	ASTM D5185m	5	▲ 214	▲ 219	▲ 232
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	5	<1	0	0
Calcium	ppm	ASTM D5185m	10	4	4	4
Phosphorus	ppm	ASTM D5185m	275	▲ 523	▲ 471	▲ 499
Zinc	ppm	ASTM D5185m	7	▲ 466	▲ 441	▲ 436
Sulfur	ppm	ASTM D5185m	400	▲ 1675	▲ 1478	▲ 1559

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	2	2
Sodium	ppm	ASTM D5185m		2	0	2
Potassium	ppm	ASTM D5185m	>20	<1	<1	0

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624		1.9	2.2	2.1
Sulfation	Abs:1mm	*ASTM D7415		11.0	11.0	11.2

OIL ANALYSIS REPORT

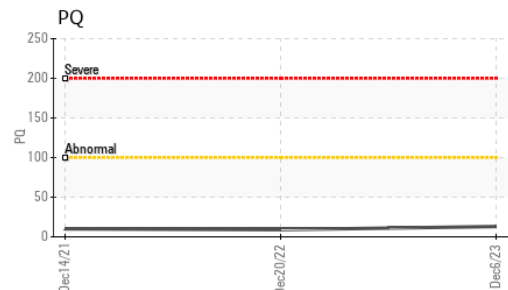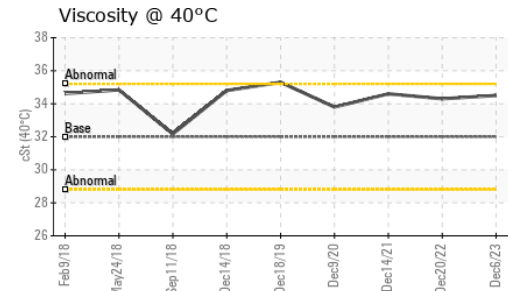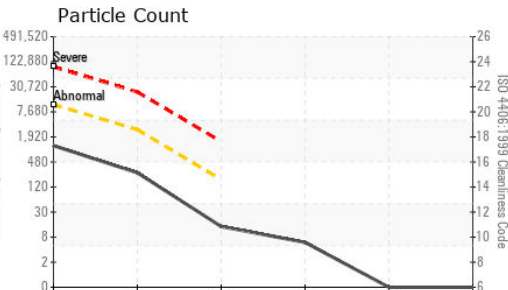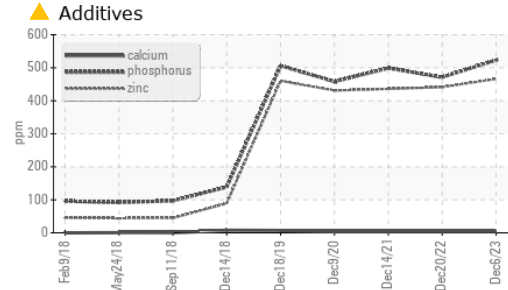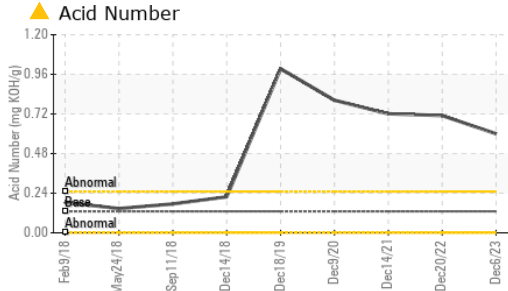

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	1041	1683	1281
Particles >6µm	ASTM D7647	>2500	232	198	150
Particles >14µm	ASTM D7647	>160	12	6	7
Particles >21µm	ASTM D7647	>40	5	1	1
Particles >38µm	ASTM D7647	>10	0	0	0
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	17/15/11	18/15/10	17/14/10


FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm *ASTM D7414		2.3	2.4	2.2
Acid Number (AN)	mg KOH/g ASTM D8045	0.13	▲ 0.60	▲ 0.71	▲ 0.721

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar *Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar *Visual	NONE	NONE	NONE	NONE
Precipitate	scalar *Visual	NONE	NONE	NONE	NONE
Silt	scalar *Visual	NONE	NONE	NONE	NONE
Debris	scalar *Visual	NONE	NONE	▲ VLITE	NONE
Sand/Dirt	scalar *Visual	NONE	NONE	NONE	NONE
Appearance	scalar *Visual	NORML	NORML	NORML	NORML
Odor	scalar *Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar *Visual	>2	NEG	NEG	NEG
Free Water	scalar *Visual		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D445	32	34.5	34.3	34.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

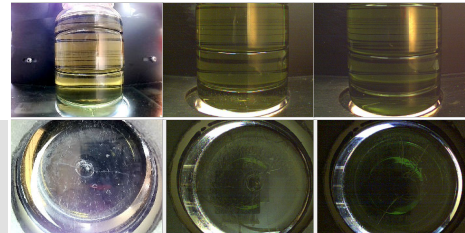

Bottom



Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : PLS0000654 **Received** : 07 Dec 2023
Lab Number : **06028590** **Diagnosed** : 15 Dec 2023
Unique Number : 10778381 **Diagnostician** : Mike Johnson
Test Package : IND 2 (Additional Tests: FT-IR, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

HEXION - DIBOLL PLANT
 100 W BORDEN DR
 DIBOLL, TX
 US 75941

Contact: DENISE ROBERTSON
 denise.robertson@hexion.com;mike.johnson@amrri.com

T: (936)829-8029
 F: (936)829-8003