




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

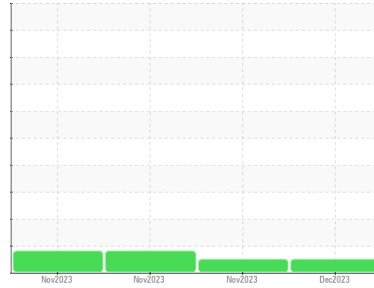

Area
GUAY SON [CONHER]
 Machine Id
PISA 4 SH - Pacifico Industrial
 Component
Hydraulic System
 Fluid
ISO 68 (1000 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. (after 10 hours of Kleenoil filtration). (Customer Sample Comment: After 10 hours of Kleenoil filtration)

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION | | method | limit/base | current | history1 | history2 |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | | KL0013440 | KL0013435 | KL0013436 |
| Sample Date | Client Info | | | 01 Dec 2023 | 30 Nov 2023 | 30 Nov 2023 |
| Machine Age | mths | Client Info | | 0 | 0 | 0 |
| Oil Age | mths | Client Info | | 24 | 24 | 24 |
| Oil Changed | Client Info | | | Not Chngd | Not Chngd | Not Chngd |
| Sample Status | | | | NORMAL | --- | ATTENTION |

| CONTAMINATION | | method | limit/base | current | history1 | history2 |
|---------------|-----------|--------|------------|------------|----------|----------|
| Water | WC Method | | >0.1 | NEG | NEG | NEG |

| WEAR METALS | | method | limit/base | current | history1 | history2 |
|-------------|-----|-------------|------------|----------|----------|----------|
| Iron | ppm | ASTM D5185m | >20 | 2 | 8 | 2 |
| Chromium | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Titanium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Lead | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >75 | 4 | 4 | 4 |
| Tin | ppm | ASTM D5185m | >10 | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185m | | 0 | 0 | 0 |

| ADDITIVES | | method | limit/base | current | history1 | history2 |
|------------|-----|-------------|------------|--------------|----------|----------|
| Boron | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Barium | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | | 2 | 3 | 1 |
| Calcium | ppm | ASTM D5185m | | 21 | 19 | 19 |
| Phosphorus | ppm | ASTM D5185m | | 319 | 319 | 320 |
| Zinc | ppm | ASTM D5185m | | 373 | 370 | 362 |
| Sulfur | ppm | ASTM D5185m | | 1475 | 1480 | 1488 |

| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
|--------------|-----|-------------|------------|--------------|----------|----------|
| Silicon | ppm | ASTM D5185m | >20 | 1 | 1 | 1 |
| Sodium | ppm | ASTM D5185m | | 4 | 12 | 5 |
| Potassium | ppm | ASTM D5185m | >20 | <1 | <1 | <1 |


| FLUID CLEANLINESS | | method | limit/base | current | history1 | history2 |
|-------------------|--|--------------|------------|--------------|----------|----------|
| Particles >4µm | | ASTM D7647 | | 14971 | --- | 39053 |
| Particles >6µm | | ASTM D7647 | >1300 | 1207 | --- | ▲ 2382 |
| Particles >14µm | | ASTM D7647 | >160 | 20 | --- | 18 |
| Particles >21µm | | ASTM D7647 | >40 | 4 | --- | 4 |
| Particles >38µm | | ASTM D7647 | >10 | 1 | --- | 0 |
| Particles >71µm | | ASTM D7647 | >3 | 0 | --- | 0 |
| Oil Cleanliness | | ISO 4406 (c) | >17/14 | 17/11 | --- | ▲ 18/11 |

| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 0.29 | 0.27 | 0.28 |




OIL ANALYSIS REPORT


Particle Trend

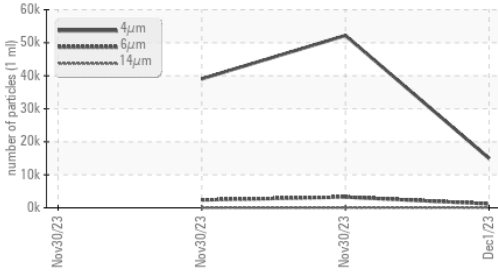


Acid Number

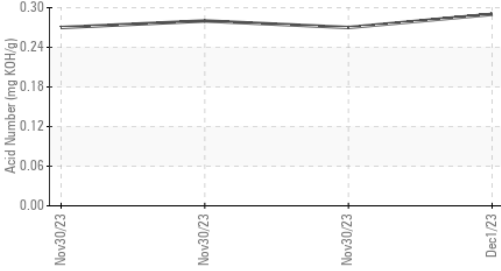

Viscosity @ 40°C

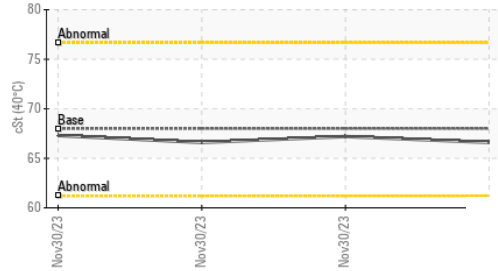

Particle Trend

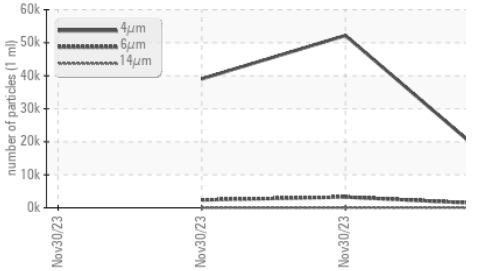

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | *Visual | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE |
| Precipitate | scalar | *Visual | NONE | NONE | NONE |
| Silt | scalar | *Visual | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | 0.2% |
| Free Water | scalar | *Visual | | NEG | NEG |


| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D445 | 68.0 | 66.6 | 67.2 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
|---------------|--------|------------|---------|----------|----------|

Color




Bottom




GRAPHS


Ferrous Alloys

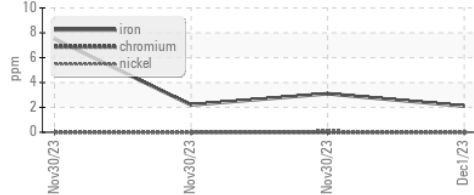


Non-ferrous Metals

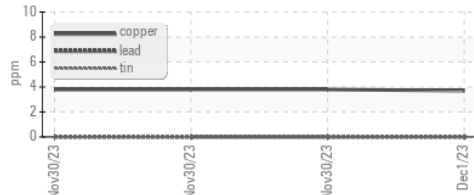


Viscosity @ 40°C

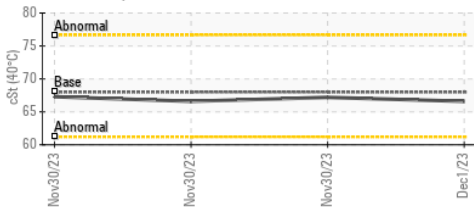

Particle Count

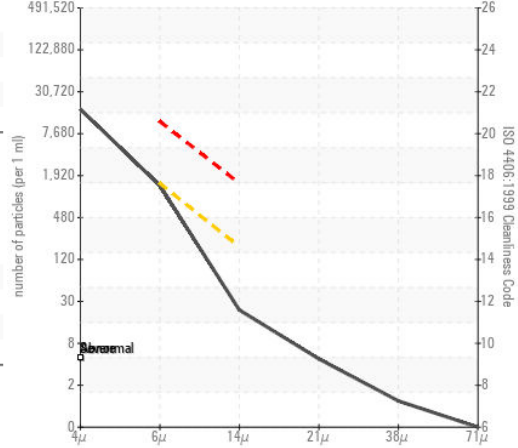

Acid Number

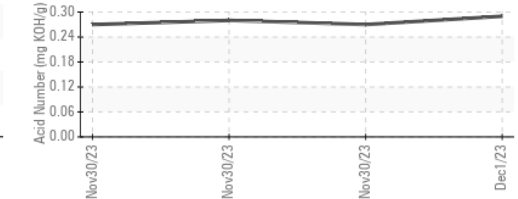

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KL0013440
 Lab Number : 06028640
 Unique Number : 10778431
 Test Package : MOB 2

Received : 07 Dec 2023
 Diagnosed : 11 Dec 2023
 Diagnostician : Don Baldrige

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CONOR
 JUAREZ 348
 HERMOSILLO,
 MX 83140

Contact: EDUARDO GARCIA
 egarcia.comsa@gmail.com

T: (526)622-1581 x:81

F: x: