



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Area
GUAY SON [CONHER]
 Machine Id
PISA 4 SH - Pacifico Industrial
 Component
Hydraulic System
 Fluid
ISO 68 (1000 LTR)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. (after 4 hours Kleenoil filtration). (Customer Sample Comment: After 4 hours of kleenoil filtration)

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KL0013437	---	---
Sample Date	Client Info	30 Nov 2023	---	---
Machine Age	mths Client Info	0	---	---
Oil Age	mths Client Info	24	---	---
Oil Changed	Client Info	Not Chngd	---	---
Sample Status		ABNORMAL	---	---

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >20	3	---	---
Chromium	ppm ASTM D5185m >10	0	---	---
Nickel	ppm ASTM D5185m >10	<1	---	---
Titanium	ppm ASTM D5185m	0	---	---
Silver	ppm ASTM D5185m	0	---	---
Aluminum	ppm ASTM D5185m >10	0	---	---
Lead	ppm ASTM D5185m >10	0	---	---
Copper	ppm ASTM D5185m >75	4	---	---
Tin	ppm ASTM D5185m >10	0	---	---
Vanadium	ppm ASTM D5185m	0	---	---
Cadmium	ppm ASTM D5185m	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	---	---
Barium	ppm ASTM D5185m	0	---	---
Molybdenum	ppm ASTM D5185m	0	---	---
Manganese	ppm ASTM D5185m	<1	---	---
Magnesium	ppm ASTM D5185m	3	---	---
Calcium	ppm ASTM D5185m	19	---	---
Phosphorus	ppm ASTM D5185m	316	---	---
Zinc	ppm ASTM D5185m	363	---	---
Sulfur	ppm ASTM D5185m	1471	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >20	1	---	---
Sodium	ppm ASTM D5185m	7	---	---
Potassium	ppm ASTM D5185m >20	<1	---	---

FLUID CLEANLINESS





method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	52188	---	---
Particles >6µm	ASTM D7647 >1300	▲ 3263	---	---
Particles >14µm	ASTM D7647 >160	22	---	---
Particles >21µm	ASTM D7647 >40	5	---	---
Particles >38µm	ASTM D7647 >10	0	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >17/14	▲ 19/12	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	0.27	---	---



OIL ANALYSIS REPORT

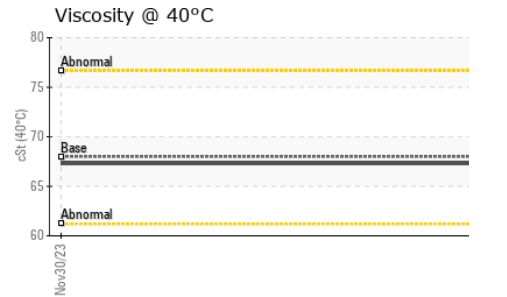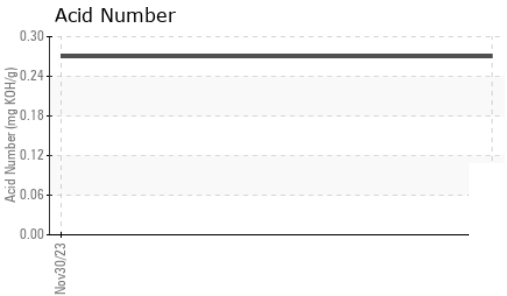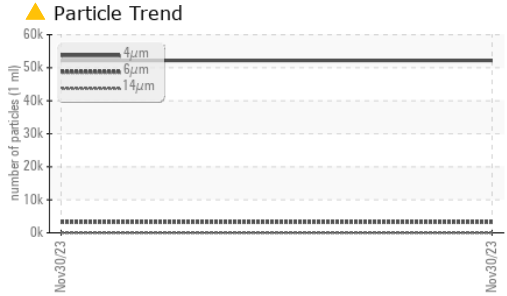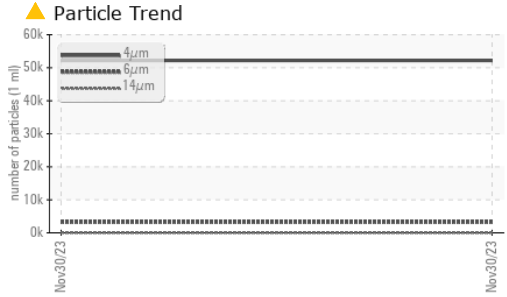





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	68.0	67.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

GRAPHS

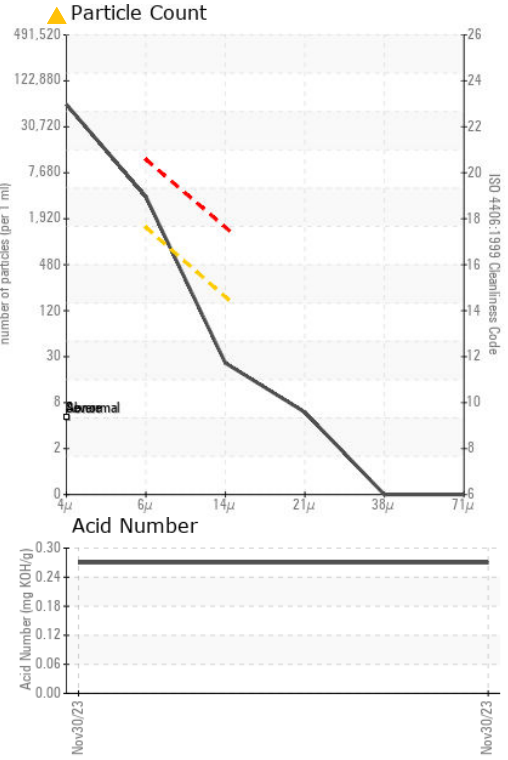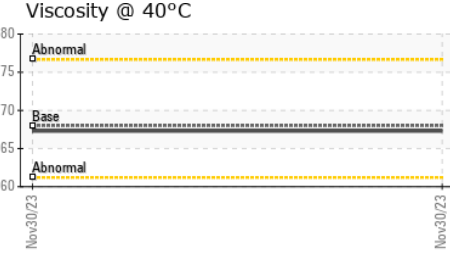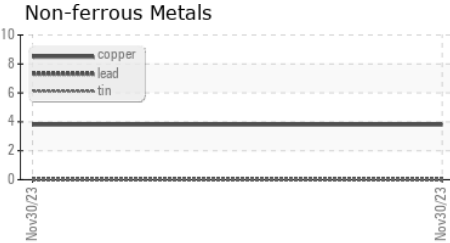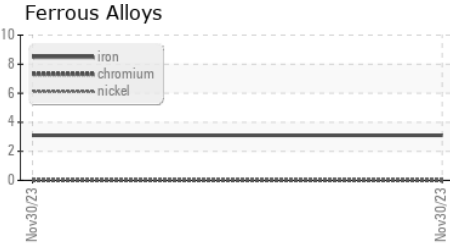

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KL0013437 **Received** : 07 Dec 2023
Lab Number : 06028641 **Diagnosed** : 11 Dec 2023
Unique Number : 10778432 **Diagnostician** : Don Baldrige
Test Package : MOB 2

CONOR
 JUAREZ 348
 HERMOSILLO,
 MX 83140
 Contact: EDUARDO GARCIA
 egarcia.comsa@gmail.com
 T: (526)622-1581 x:81
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)