




OIL ANALYSIS REPORT

Sample Rating Trend

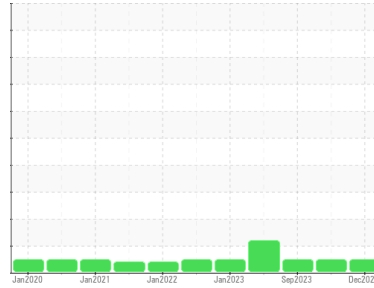

NORMAL



Area
MIXERS
 Machine Id
M-512
 Component
Gearbox
 Fluid
MOBIL SHC 630 (4 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0871620	WC0871616	WC0857562
Sample Date	Client Info			05 Dec 2023	23 Oct 2023	12 Sep 2023
Machine Age	mths	Client Info		0	0	0
Oil Age	mths	Client Info		0	3	1
Oil Changed	Client Info			N/A	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.2	NEG	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	133	118	21
Chromium	ppm	ASTM D5185m	>15	1	1	<1
Nickel	ppm	ASTM D5185m	>15	<1	<1	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>100	0	0	0
Copper	ppm	ASTM D5185m	>200	<1	0	<1
Tin	ppm	ASTM D5185m	>25	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		1	1	<1
Magnesium	ppm	ASTM D5185m		0	4	<1
Calcium	ppm	ASTM D5185m		2	1	1
Phosphorus	ppm	ASTM D5185m		518	491	481
Zinc	ppm	ASTM D5185m		0	3	0
Sulfur	ppm	ASTM D5185m		969	207	53





CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	18	17	18
Sodium	ppm	ASTM D5185m		1	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	158096	153973	166293
Particles >6µm		ASTM D7647	>5000	86738	43621	62092
Particles >14µm		ASTM D7647	>640	5238	1135	1911
Particles >21µm		ASTM D7647	>160	1088	216	243
Particles >38µm		ASTM D7647	>40	12	4	3
Particles >71µm		ASTM D7647	>10	1	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	24/24/20	24/23/17	25/23/18

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.47	0.46	0.49




OIL ANALYSIS REPORT

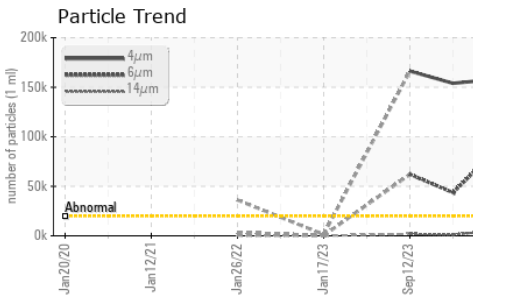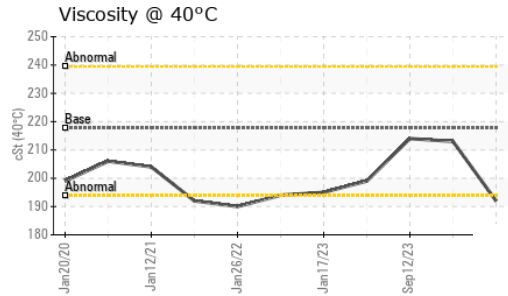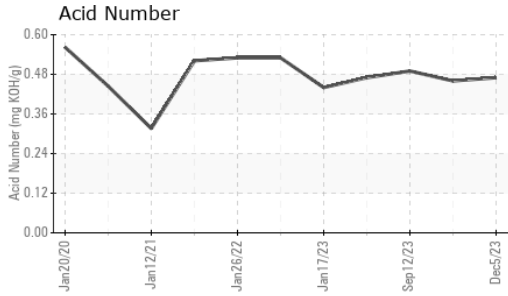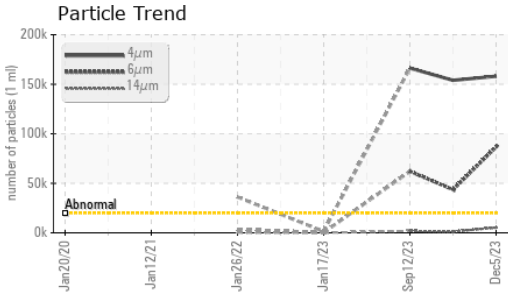






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	LIGHT	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	217.7	192	213

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

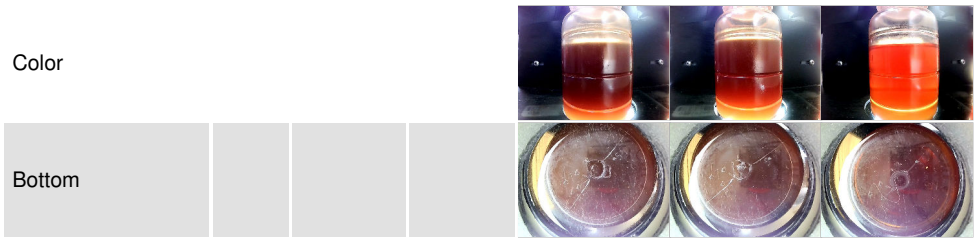

GRAPHS

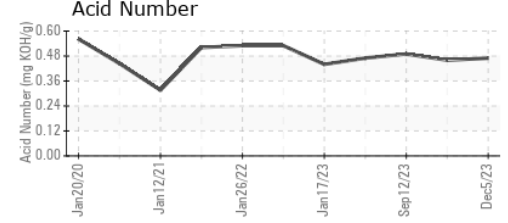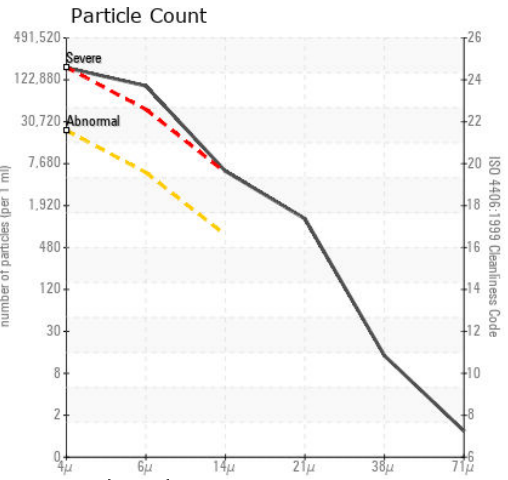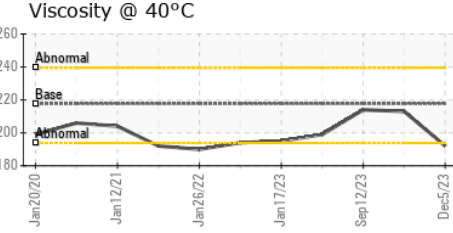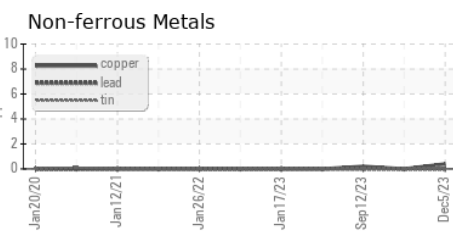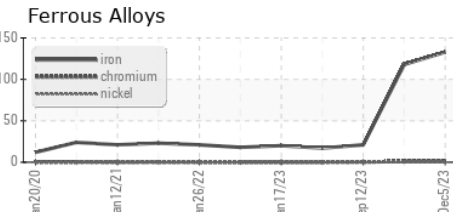

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0871620 **Received** : 07 Dec 2023
Lab Number : 06028656 **Diagnosed** : 10 Dec 2023
Unique Number : 10778447 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: PrtCount)

POET BIOREFINING - Groton
 40425 133RD STREET
 GROTON, SD
 US 57445-6400
 Contact: GAVIN KRUEGER
 Gavin.Krueger@POET.COM
 T: 6(05) 846-6863
 F: (605)397-2754

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)