




PROBLEM SUMMARY


Sample Rating Trend

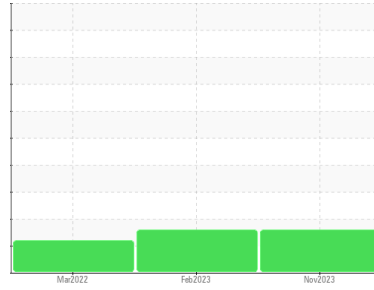

Machine Id
KAESER CSD 75 7939706 (S/N 1229)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

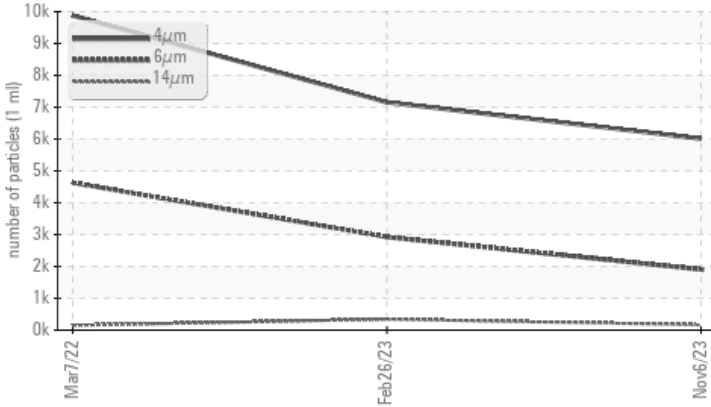

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	ISO 4406 (c)	ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	>1300	▲ 1905	▲ 2924	▲ 4624	
Particles >14µm	>80	▲ 165	▲ 344	▲ 152	
Particles >21µm	>20	▲ 46	▲ 85	▲ 33	
Oil Cleanliness	>--/17/13	▲ 20/18/15	▲ 20/19/16	▲ 19/14	

Customer Id: SCHDALKC
 Sample No.: KCPA007981
 Lab Number: 06028688
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

26 Feb 2023 Diag: Don Baldrige

ISO



Oil and filter change at the time of sampling has been noted. No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



07 Mar 2022 Diag: Angela Borella


ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



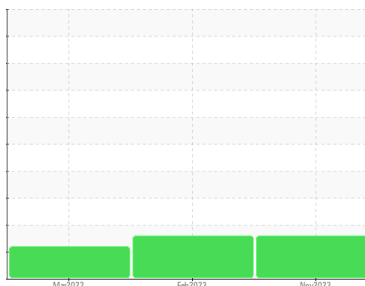

Machine Id
KAESER CSD 75 7939706 (S/N 1229)

Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA007981	KCP54793	KCP38427
Sample Date	Client Info			06 Nov 2023	26 Feb 2023	07 Mar 2022
Machine Age	hrs	Client Info		6873	4652	2108
Oil Age	hrs	Client Info		0	4652	2108
Oil Changed		Client Info		N/A	Changed	Not Changed
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	1	<1
Lead	ppm	ASTM D5185m	>10	0	<1	0
Copper	ppm	ASTM D5185m	>50	9	17	3
Tin	ppm	ASTM D5185m	>10	0	<1	1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	90	40	20	50
Calcium	ppm	ASTM D5185m	2	<1	<1	<1
Phosphorus	ppm	ASTM D5185m		<1	1	12
Zinc	ppm	ASTM D5185m		5	42	<1
Sulfur	ppm	ASTM D5185m		18109	21163	15855

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	<1
Sodium	ppm	ASTM D5185m		25	9	11
Potassium	ppm	ASTM D5185m	>20	12	12	12
Water	%	ASTM D6304	>0.05	0.018	0.018	0.018
ppm Water	ppm	ASTM D6304	>500	181	182.6	187.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6013	7155	9878
Particles >6µm		ASTM D7647	>1300	▲ 1905	▲ 2924	▲ 4624
Particles >14µm		ASTM D7647	>80	▲ 165	▲ 344	▲ 152
Particles >21µm		ASTM D7647	>20	▲ 46	▲ 85	▲ 33
Particles >38µm		ASTM D7647	>4	2	4	5
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/15	▲ 20/19/16	▲ 19/14

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.29	0.32	0.35


OIL ANALYSIS REPORT

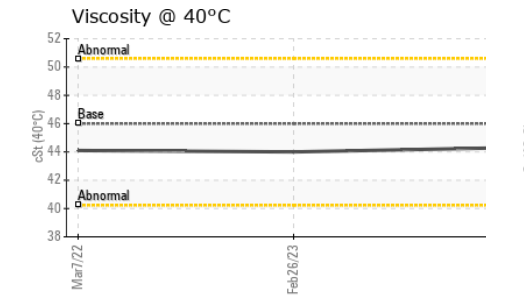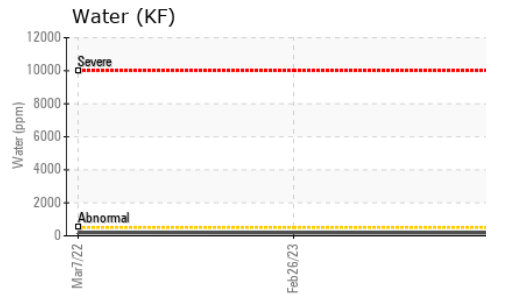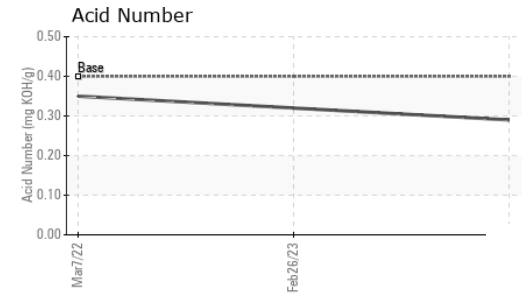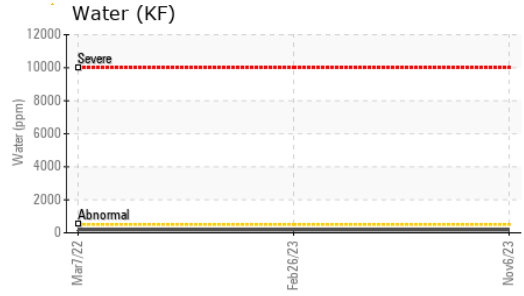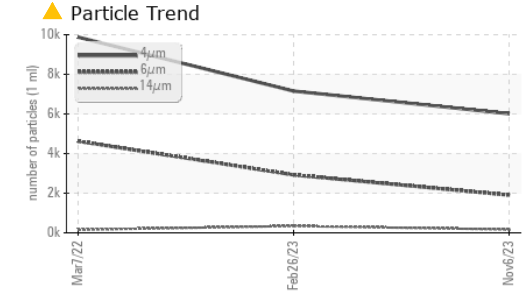






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.3	44.0	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

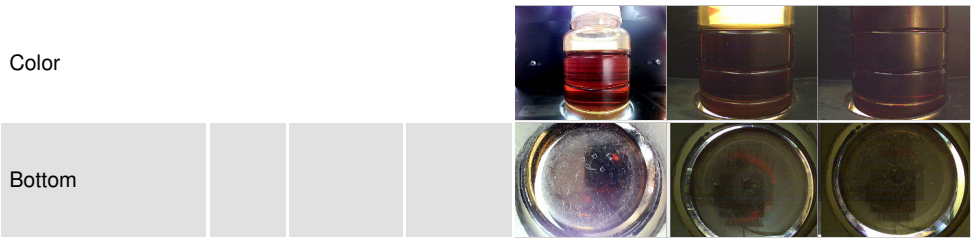

GRAPHS

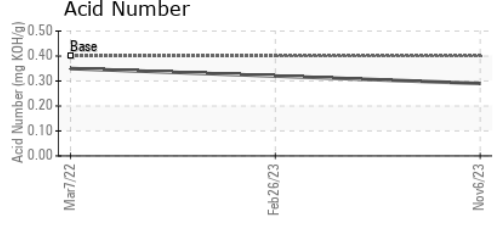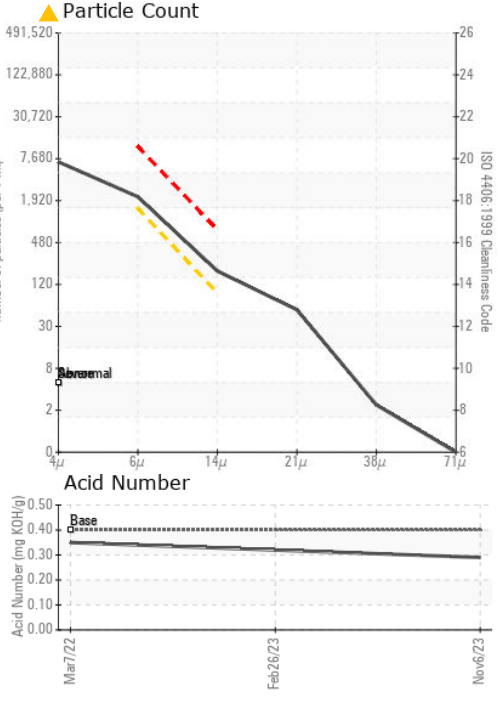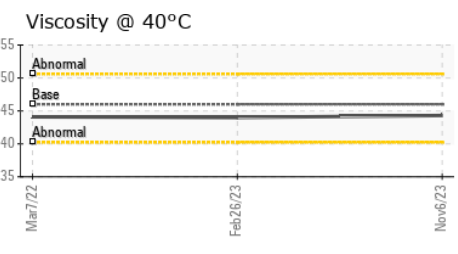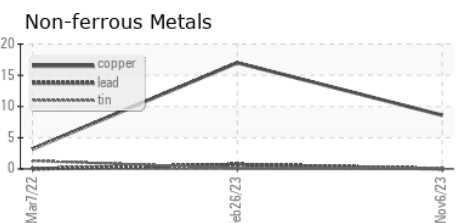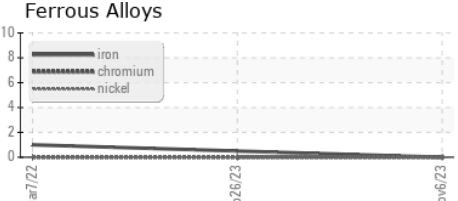

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA007981 **Received** : 07 Dec 2023
Lab Number : 06028688 **Diagnosed** : 10 Dec 2023
Unique Number : 10778479 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

SCHWARZ PARTNER PKG DALTON BOX
 3470 CORPORATE DR
 DALTON, GA
 US 30721
 Contact: G. KENERLY
 gkenerly@daltonbox.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)