

PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER SFC 90S 5986444 (S/N 1008)
Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

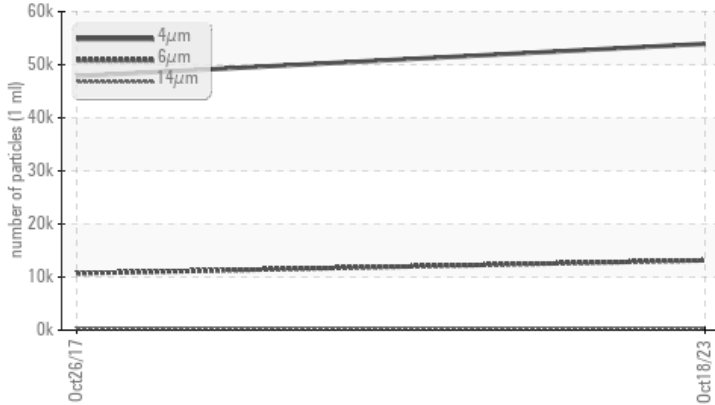

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 13155	▲ 10696	---
Particles >14µm	ASTM D7647	>80	▲ 368	▲ 357	---
Particles >21µm	ASTM D7647	>20	▲ 95	▲ 80	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 23/21/16	▲ 21/16	---

Customer Id: RINROC
Sample No.: KC111748
Lab Number: 06028689
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

26 Oct 2017 Diag: Don Baldrige

ISO




We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

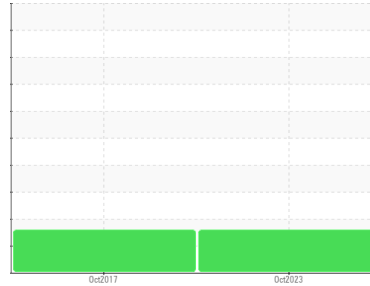

ISO



Machine Id
KAESER SFC 90S 5986444 (S/N 1008)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info		KC111748	KC64728	---
Sample Date	Client Info		18 Oct 2023	26 Oct 2017	---
Machine Age	hrs	Client Info	34488	1675	---
Oil Age	hrs	Client Info	1987	1675	---
Oil Changed	Client Info		Changed	Not Changd	---
Sample Status			ABNORMAL	ABNORMAL	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	0	<1	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m	>3	<1	<1	---
Titanium	ppm	ASTM D5185m	>3	0	<1	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	0	<1	---
Lead	ppm	ASTM D5185m	>10	0	<1	---
Copper	ppm	ASTM D5185m	>50	15	4	---
Tin	ppm	ASTM D5185m	>10	0	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	<1	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m	90	0	<1	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	<1	---
Magnesium	ppm	ASTM D5185m	90	<1	32	---
Calcium	ppm	ASTM D5185m	2	0	<1	---
Phosphorus	ppm	ASTM D5185m		<1	5	---
Zinc	ppm	ASTM D5185m		0	15	---

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	<1	<1	---
Sodium	ppm	ASTM D5185m		2	12	---
Potassium	ppm	ASTM D5185m	>20	<1	0	---
Water	%	ASTM D6304	>0.05	0.003	0.022	---
ppm Water	ppm	ASTM D6304	>500	36	220	---






FLUID CLEANLINESS method limit/base current history1 history2

Particles >4µm	ASTM D7647			53930	47859	---
Particles >6µm	ASTM D7647	>1300		▲ 13155	▲ 10696	---
Particles >14µm	ASTM D7647	>80		▲ 368	▲ 357	---
Particles >21µm	ASTM D7647	>20		▲ 95	▲ 80	---
Particles >38µm	ASTM D7647	>4		3	▲ 5	---
Particles >71µm	ASTM D7647	>3		0	2	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13		▲ 23/21/16	▲ 21/16	---

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35	0.338	---
------------------	----------	------------	-----	-------------	-------	-----


OIL ANALYSIS REPORT

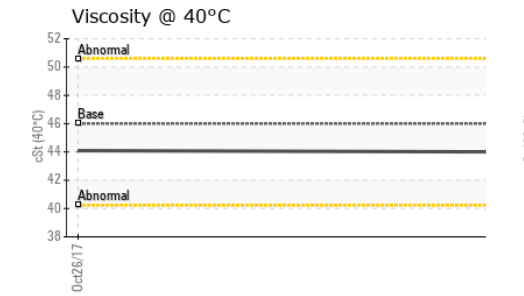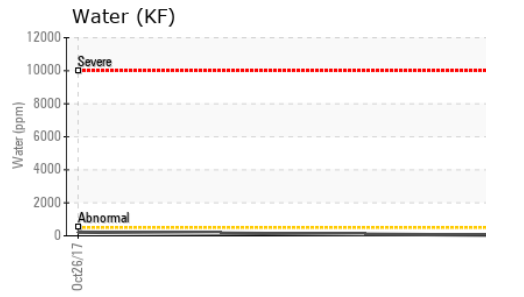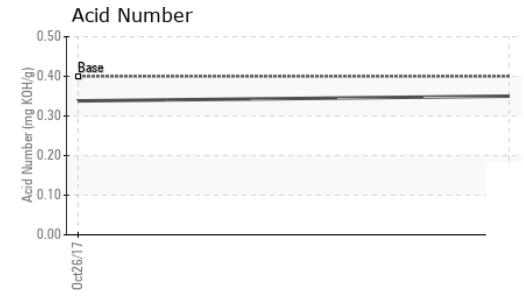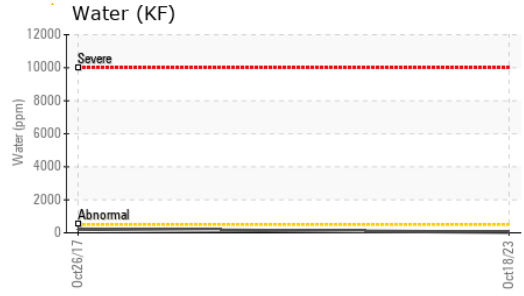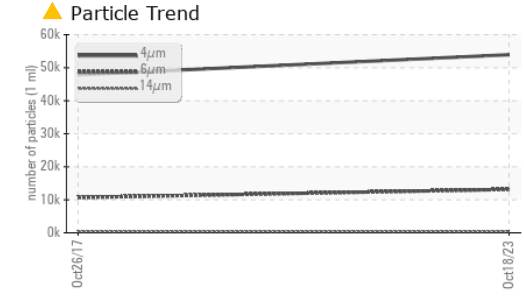





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.0	44.09

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

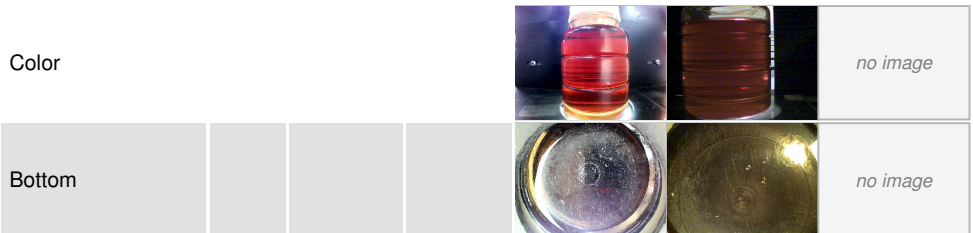

GRAPHS

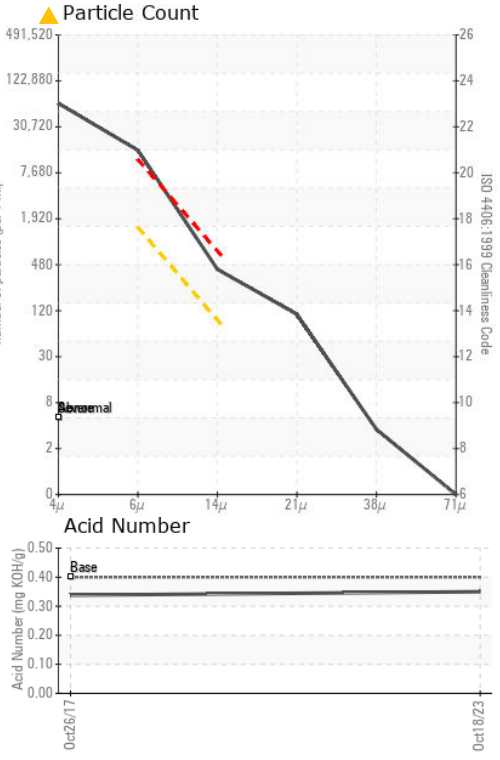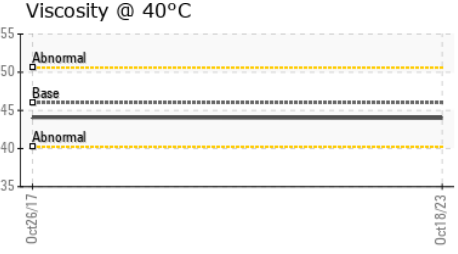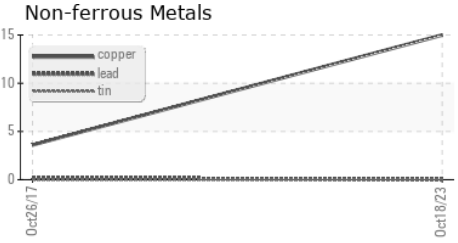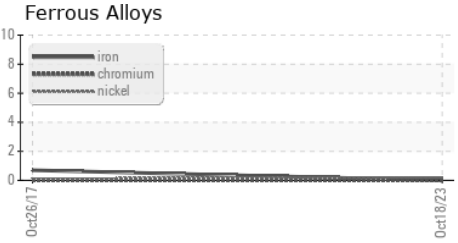

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KC111748 **Received** : 07 Dec 2023
Lab Number : 06028689 **Diagnosed** : 10 Dec 2023
Unique Number : 10778480 **Diagnostician** : Doug Bogart
Test Package : IND 2

RING CONTAINER
 4689 ASSEMBLY DR
 ROCKFORD, IL
 US 61109
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)