




# OIL ANALYSIS REPORT

Sample Rating Trend

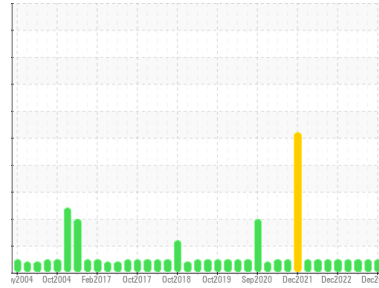

**NORMAL**



Machine Id  
**QUINCY AIR 2 (S/N 552066)**

Component  
**Compressor**  
Fluid  
**QUINCY QUINSYN F (12 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0004238</b>	USP0000174	USP250122
Sample Date	Client Info		<b>05 Dec 2023</b>	06 Sep 2023	14 Jun 2023
Machine Age	hrs	Client Info	<b>16495</b>	15866	15008
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>2</b>	2	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>35</b>	23	4
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Calcium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Phosphorus	ppm	ASTM D5185m		<b>&lt;1</b>	2	1
Zinc	ppm	ASTM D5185m		<b>35</b>	29	0
Sulfur	ppm	ASTM D5185m		<b>3</b>	11	0

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>3</b>	4	3
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	2	1
Water	%	ASTM D6304	>0.1	<b>0.004</b>	0.006	0.007
ppm Water	ppm	ASTM D6304	>1000	<b>44</b>	68.6	78.7

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>78</b>	381	535
Particles >6µm	ASTM D7647	>2500	<b>17</b>	115	136
Particles >14µm	ASTM D7647	>320	<b>2</b>	19	19
Particles >21µm	ASTM D7647	>80	<b>1</b>	7	6
Particles >38µm	ASTM D7647	>20	<b>0</b>	1	1
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>13/11/9</b>	16/14/11	16/14/11

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	.10	<b>1.42</b>	1.35	1.40




# OIL ANALYSIS REPORT

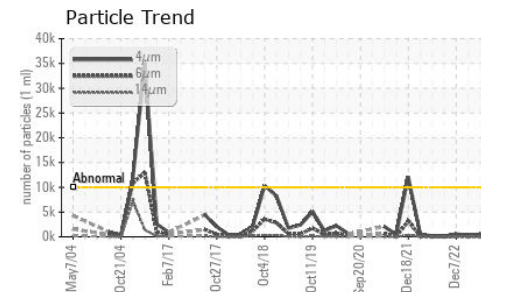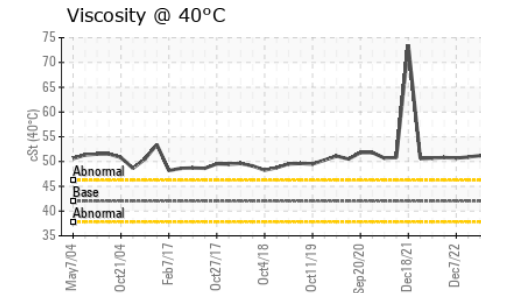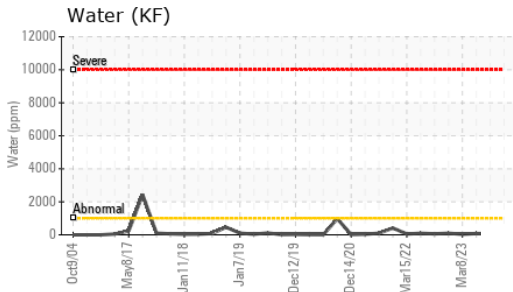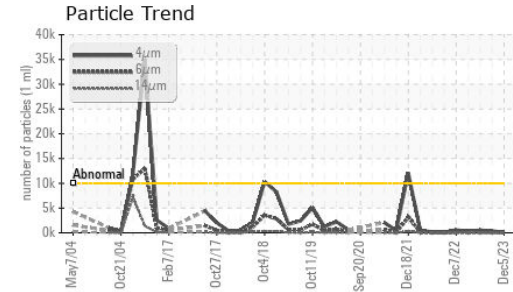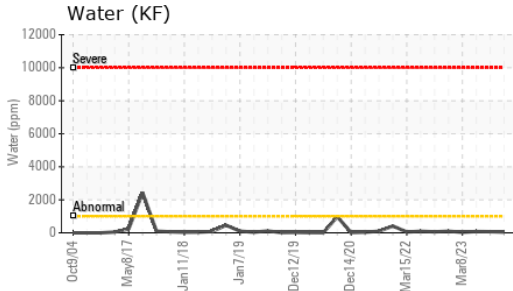





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	42	51.1	51.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

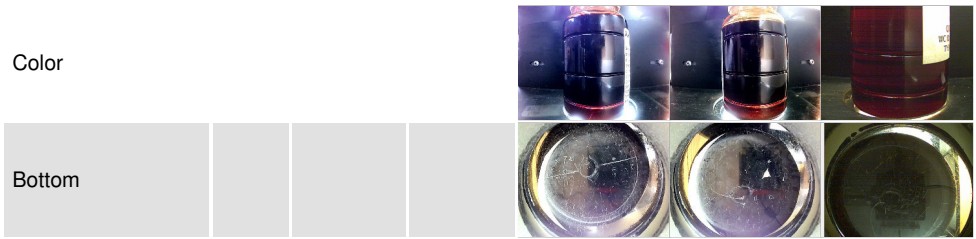

## GRAPHS

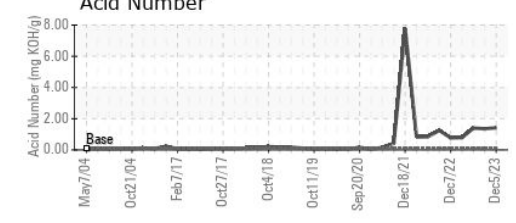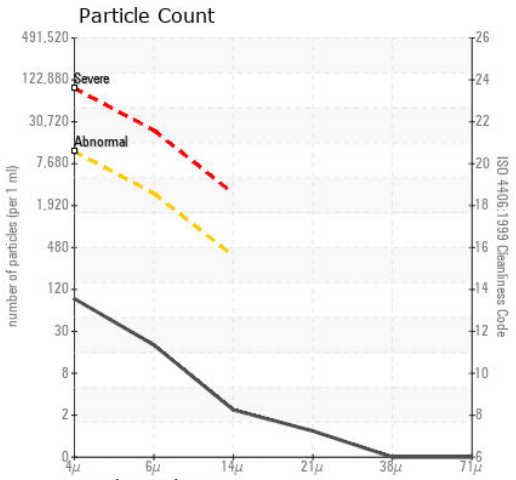

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0004238  
**Lab Number** : 06028713  
**Unique Number** : 10778504  
**Test Package** : IND 2

**TYSON - NEW HOLLAND - PLANT 1 - USP**  
 PLANT 1  
 NEW HOLLAND, PA  
 US 17557  
 Contact: ROGER GOOD  
 roger.good@tyson.com  
 T: (800)755-4572  
 F: (402)423-6661

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)