




PROBLEM SUMMARY

Sample Rating Trend

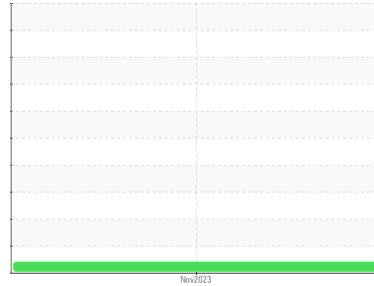

VIS DEBRIS



Machine Id
INGERSOLL RAND FF1733U99132
 Component
Compressor
 Fluid
INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	---	---
Debris	scalar	*Visual	NONE	▲ MODER	---	---

Customer Id: LOPHAM
Sample No.: WC0849079
Lab Number: 06028752
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend

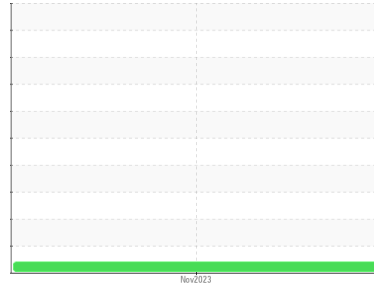

VIS DEBRIS



Machine Id
INGERSOLL RAND FF1733U99132
 Component
Compressor
 Fluid
INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0849079	---	---
Sample Date	Client Info			07 Nov 2023	---	---
Machine Age	hrs	Client Info		127363	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed	Client Info			Not Changed	---	---
Sample Status				ABNORMAL	---	---

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.1	NEG	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		<1	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	7	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
Cadmium	ppm	ASTM D5185m		0	---	---



ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	2	---	---
Barium	ppm	ASTM D5185m	500	427	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m	0	<1	---	---
Calcium	ppm	ASTM D5185m	0	2	---	---
Phosphorus	ppm	ASTM D5185m	20	76	---	---
Zinc	ppm	ASTM D5185m	0	0	---	---
Sulfur	ppm	ASTM D5185m	200	281	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	5	---	---
Sodium	ppm	ASTM D5185m		16	---	---
Potassium	ppm	ASTM D5185m	>20	2	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.12	---	---



OIL ANALYSIS REPORT

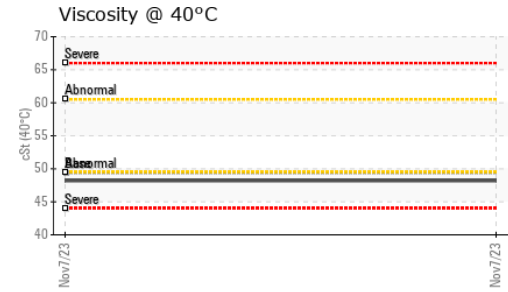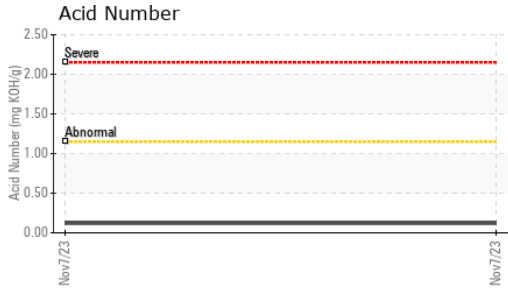





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	LIGHT	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	▲ MODER	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	48.2	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

GRAPHS

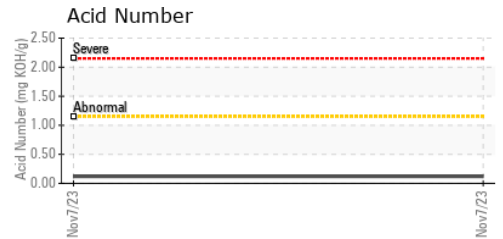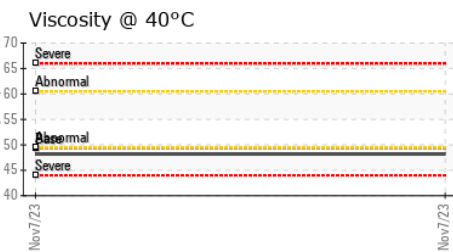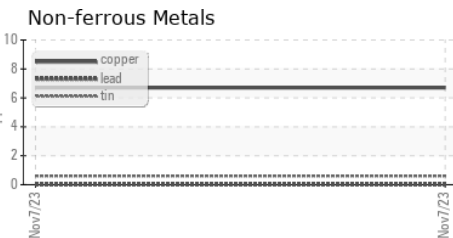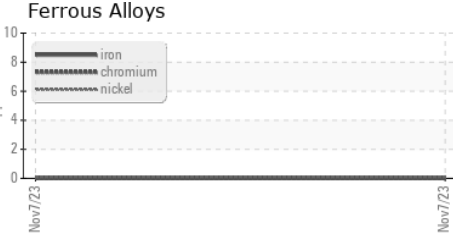

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0849079 **Received** : 07 Dec 2023
Lab Number : 06028752 **Diagnosed** : 11 Dec 2023
Unique Number : 10778543 **Diagnostician** : Don Baldrige
Test Package : IND 2

LOPAREX
 1740 RIDGEWAY ST
 HAMMOND, WI
 US 54015
 Contact: JERRY ADAMS

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (715)796-5814

F: