



# PROBLEM SUMMARY

Sample Rating Trend


DIRT

Area  
**EL SAUZ [200007686]**  
 Machine Id  
**M04WEA90360 (S/N GME004427A-52)**  
 Component  
**Hydraulic System**  
 Fluid  
**SHELL TELLUS S2 VX 32 (--- LTR)**



## COMPONENT CONDITION SUMMARY

▲ Silicon (ppm)

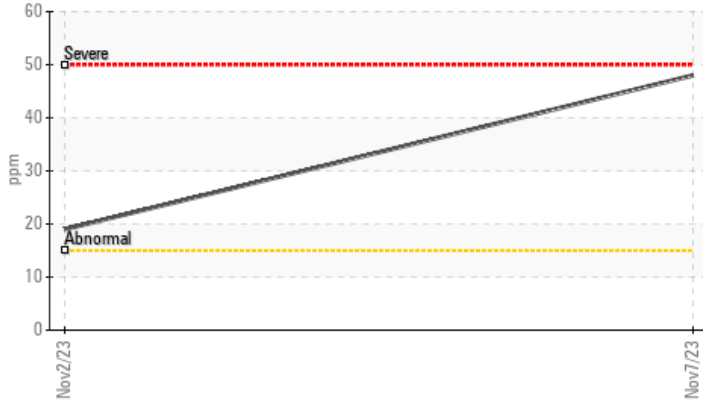

## RECOMMENDATION

No corrective action is recommended at this time.  
 Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	MARGINAL	---
Silicon	ppm	ASTM D5185m	>15	▲ 48	▲ 19	---

Customer Id: NORDEX  
 Sample No.: NX014657  
 Lab Number: 06029373  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

**02 Nov 2023 Diag: Don Baldrige**

### DIRT



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. Elemental level of silicon (Si) above normal indicating ingress of dirt/seal material. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report





# OIL ANALYSIS REPORT

Sample Rating Trend



**DIRT**



Area  
**EL SAUZ [200007686]**  
 Machine Id  
**M04WEA90360 (S/N GME004427A-52)**  
 Component  
**Hydraulic System**  
 Fluid  
**SHELL TELLUS S2 VX 32 (--- LTR)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

Elemental level of silicon (Si) above normal indicating ingress of dirt/seal material. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>NX014657</b>	NX014585	---
Sample Date	Client Info		<b>07 Nov 2023</b>	02 Nov 2023	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>ABNORMAL</b>	MARGINAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>14</b>	15	---
Iron	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	---
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	---
Nickel	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >20	<b>2</b>	0	---
Lead	ppm	ASTM D5185m >20	<b>0</b>	<1	---
Copper	ppm	ASTM D5185m >20	<b>1</b>	4	---
Tin	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m	<b>&lt;1</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	<b>22</b>	19	---
Calcium	ppm	ASTM D5185m	<b>29</b>	28	---
Phosphorus	ppm	ASTM D5185m	<b>323</b>	267	---
Zinc	ppm	ASTM D5185m	<b>283</b>	239	---
Sulfur	ppm	ASTM D5185m	<b>6984</b>	6267	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>▲ 48</b>	<b>▲ 19</b>	---
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	---
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	---
Water	%	ASTM D6304 >0.05	<b>0.026</b>	0.003	---
ppm Water	ppm	ASTM D6304 >500	<b>260</b>	30	---

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>2678</b>	491	---
Particles >6µm	ASTM D7647	>2500	<b>689</b>	109	---
Particles >14µm	ASTM D7647	>320	<b>61</b>	16	---
Particles >21µm	ASTM D7647	>80	<b>17</b>	3	---
Particles >38µm	ASTM D7647	>20	<b>2</b>	0	---
Particles >71µm	ASTM D7647	>4	<b>1</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>21/18/15	<b>19/17/13</b>	16/14/11	---


## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.41</b>	0.40	---




# OIL ANALYSIS REPORT


▲ Silicon (ppm)

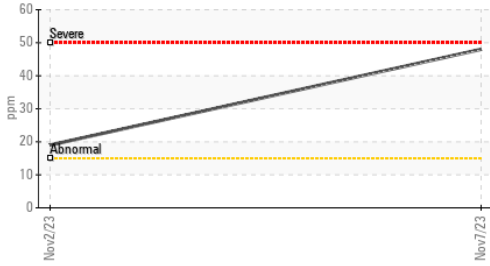


Water (KF)

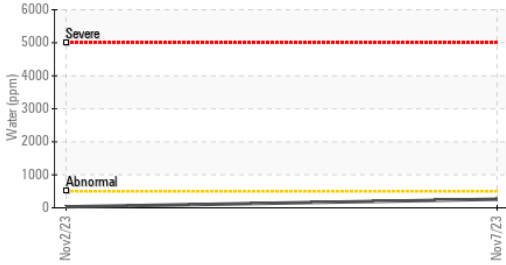


PQ

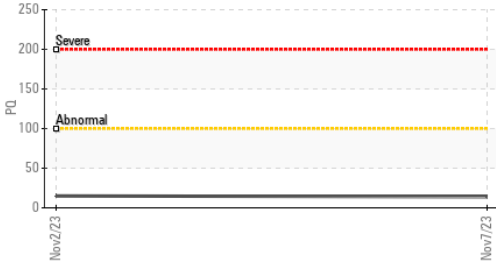

Particle Trend

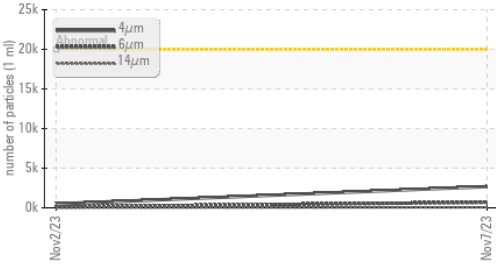

Viscosity @ 40°C

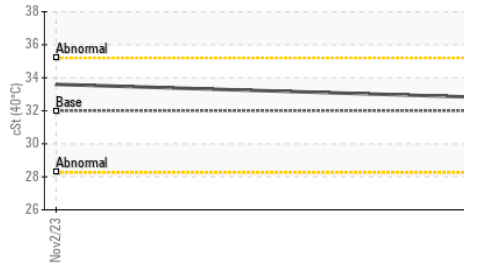

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	NEG
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	32.8	33.6


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color



no image


Bottom




no image

## GRAPHS

Ferrous Alloys

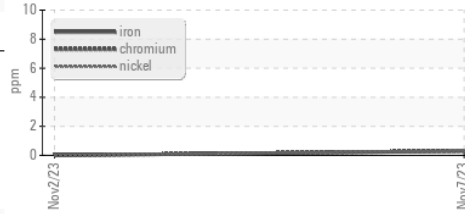


Non-ferrous Metals

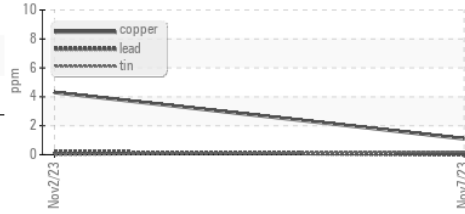


Viscosity @ 40°C



Particle Count

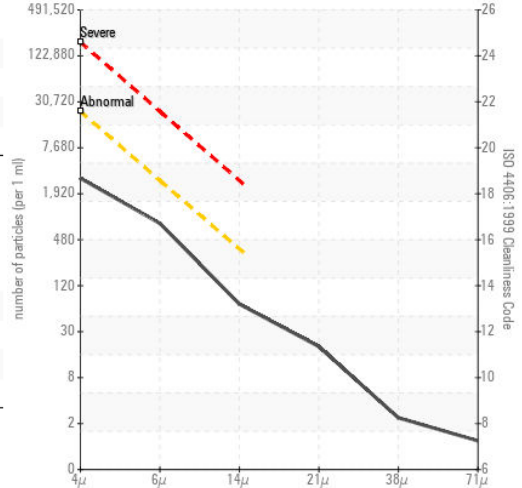

Acid Number

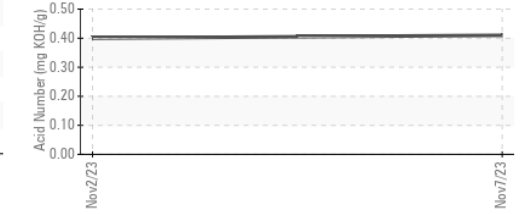

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : NX014657 Received : 08 Dec 2023  
 Lab Number : 06029373 Diagnosed : 14 Dec 2023  
 Unique Number : 10779164 Diagnostician : Doug Bogart  
 Test Package : IND 2 ( Additional Tests: KF, PQ )

**NORDEX USA - Chicago**  
 300 SOUTH WACKER DRIVE, SUITE 1500  
 CHICAGO, IL  
 US 60606  
 Contact: DEVIN LINEHAN  
 DLinehan@nordex-online.com  
 T: (312)386-4124  
 F: (312)386-7102

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)