




PROBLEM SUMMARY


Sample Rating Trend

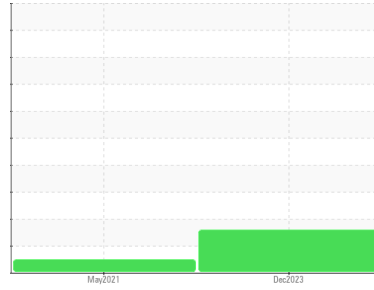

Machine Id
KAESER 2660217
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

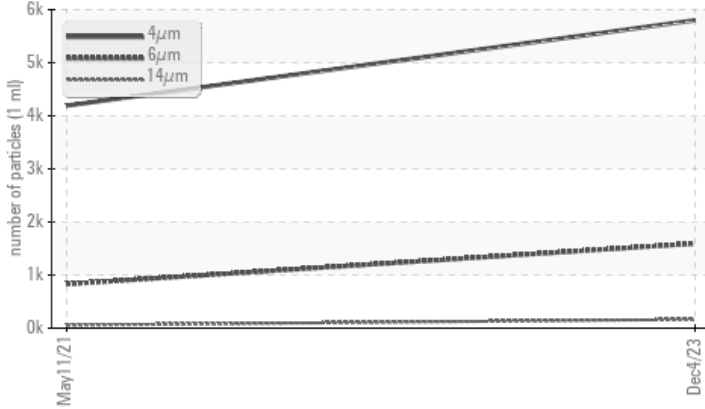

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	NORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 1594	830	---
Particles >14µm	ASTM D7647	>80	▲ 164	56	---
Particles >21µm	ASTM D7647	>20	▲ 45	13	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/18/15	17/13	---

Customer Id: CITPALCA
 Sample No.: KCPA010821
 Lab Number: 06029383
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

11 May 2021 Diag: Don Baldrige

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER 2660217

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

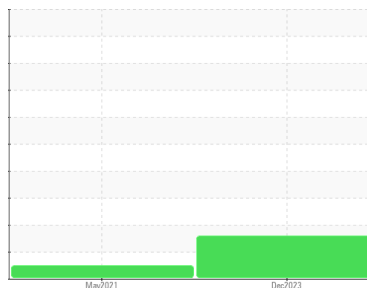

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA010821	KCP32229	---
Sample Date	Client Info			04 Dec 2023	11 May 2021	---
Machine Age	hrs	Client Info		9443	3309	---
Oil Age	hrs	Client Info		0	2800	---
Oil Changed	Client Info			N/A	Changed	---
Sample Status				ABNORMAL	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	---
Chromium	ppm	ASTM D5185m	>10	<1	0	---
Nickel	ppm	ASTM D5185m	>3	<1	0	---
Titanium	ppm	ASTM D5185m	>3	<1	0	---
Silver	ppm	ASTM D5185m	>2	0	0	---
Aluminum	ppm	ASTM D5185m	>10	2	0	---
Lead	ppm	ASTM D5185m	>10	<1	<1	---
Copper	ppm	ASTM D5185m	>50	3	5	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Antimony	ppm	ASTM D5185m		---	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		<1	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	---
Barium	ppm	ASTM D5185m	90	0	6	---
Molybdenum	ppm	ASTM D5185m	0	<1	0	---
Manganese	ppm	ASTM D5185m		<1	<1	---
Magnesium	ppm	ASTM D5185m	100	87	63	---
Calcium	ppm	ASTM D5185m	0	6	0	---
Phosphorus	ppm	ASTM D5185m	0	0	0	---
Zinc	ppm	ASTM D5185m	0	0	0	---
Sulfur	ppm	ASTM D5185m	23500	23997	17999	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	0	---
Sodium	ppm	ASTM D5185m		21	17	---
Potassium	ppm	ASTM D5185m	>20	3	2	---
Water	%	ASTM D6304	>0.05	0.015	0.018	---
ppm Water	ppm	ASTM D6304	>500	159	182.0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5800	4192	---
Particles >6µm		ASTM D7647	>1300	▲ 1594	830	---
Particles >14µm		ASTM D7647	>80	▲ 164	56	---
Particles >21µm		ASTM D7647	>20	▲ 45	13	---
Particles >38µm		ASTM D7647	>4	2	0	---
Particles >71µm		ASTM D7647	>3	0	0	---
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 20/18/15	17/13	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.37	0.365	---


OIL ANALYSIS REPORT

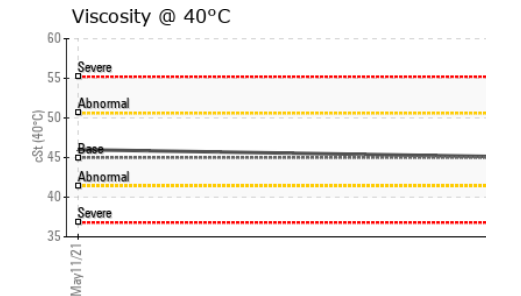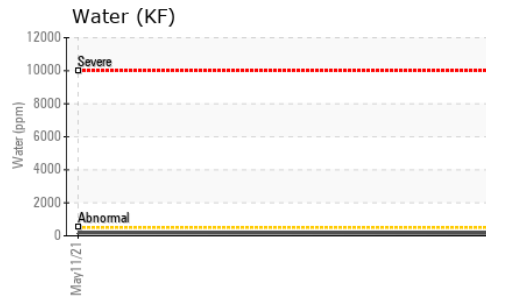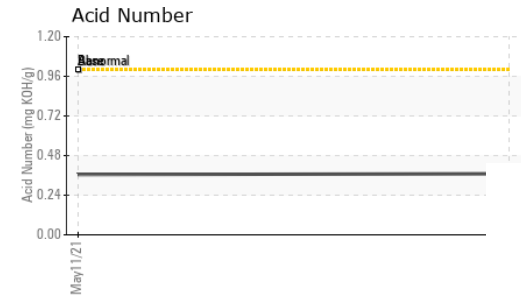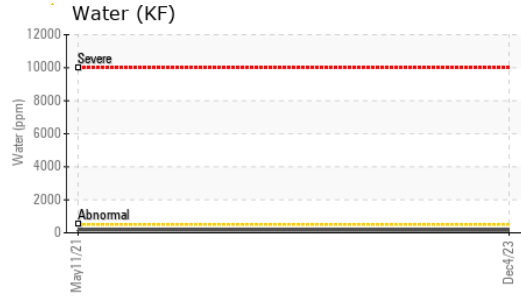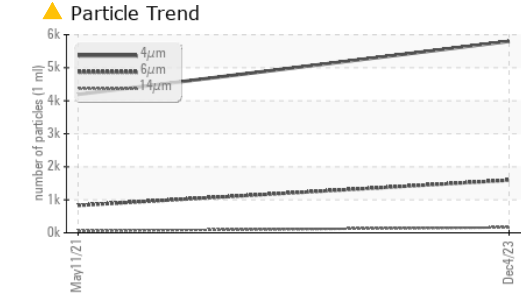





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	46.0	---

SAMPLE IMAGES

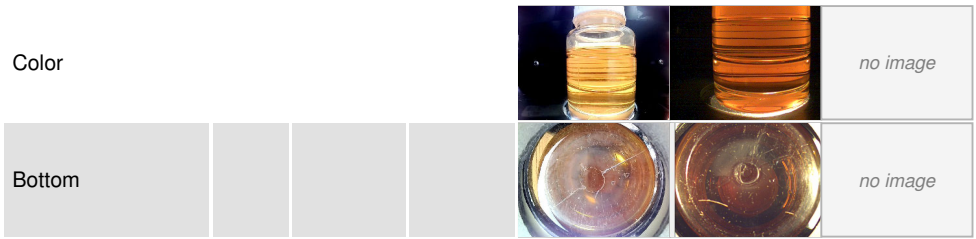

GRAPHS

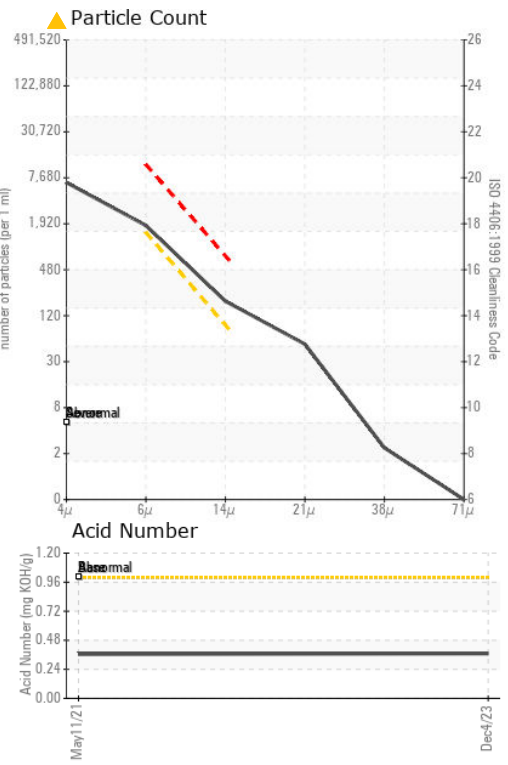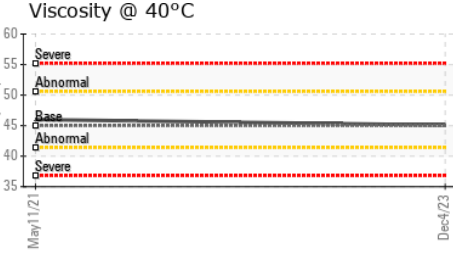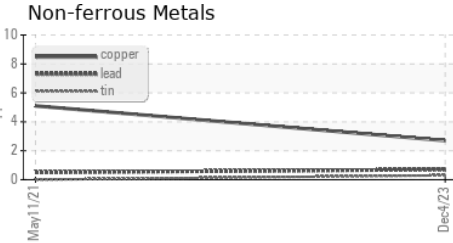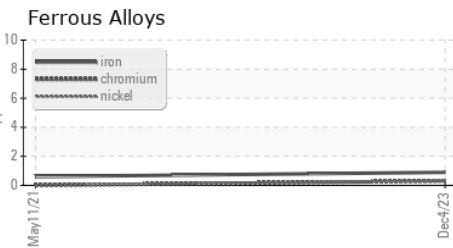

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA010821 **Received** : 08 Dec 2023
Lab Number : 06029383 **Diagnosed** : 12 Dec 2023
Unique Number : 10779174 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

CITY OF PALO ALTO
 3201 E BAYSHORE RD
 PALO ALTO, CA
 US 94303
 Contact: TED MEDINA
 ted.medina@cityofpaloalto.org
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)