




PROBLEM SUMMARY


Sample Rating Trend

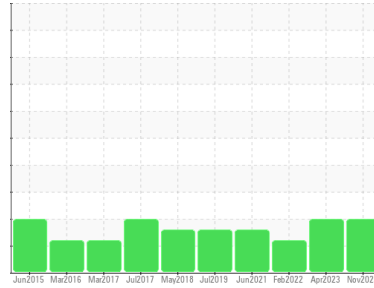

Machine Id
KAESER AIRTOWER 8 2289945 (S/N 1002)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

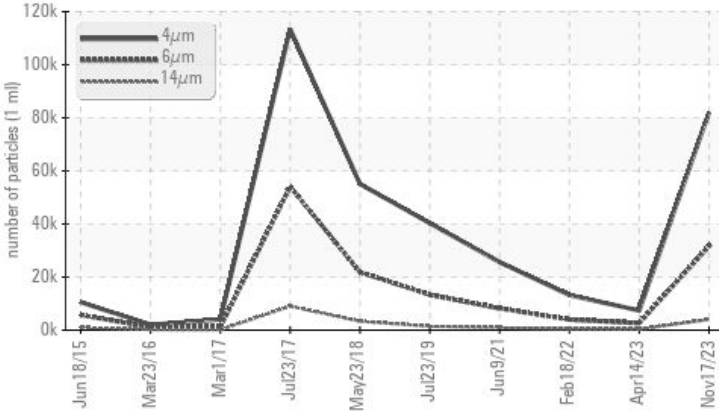

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 31631	▲ 2621	▲ 3986
Particles >14µm	ASTM D7647	>80	▲ 4026	▲ 329	▲ 444
Particles >21µm	ASTM D7647	>20	▲ 1120	▲ 89	▲ 87
Particles >38µm	ASTM D7647	>4	▲ 37	▲ 10	6
Oil Cleanliness	ISO 4406 (c)	>17/13	▲ 22/19	▲ 19/16	▲ 19/16

Customer Id: JPADUL
 Sample No.: KCPA009984
 Lab Number: 06029391
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

14 Apr 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



18 Feb 2022 Diag: Angela Borella

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



09 Jun 2021 Diag: Angela Borella

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

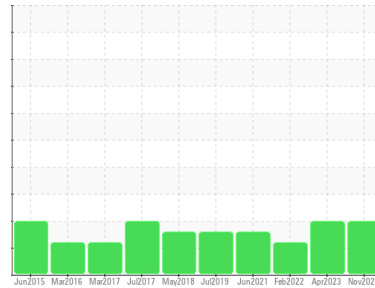

ISO



Machine Id
KAESER AIRTOWER 8 2289945 (S/N 1002)

Component

Compressor

Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	KCPA009984	KCPA001322	KCP43385	
Sample Date	Client Info	17 Nov 2023	14 Apr 2023	18 Feb 2022	
Machine Age	hrs	Client Info	72577	72024	68951
Oil Age	hrs	Client Info	0	0	1700
Oil Changed	Client Info	N/A	N/A	Not Changd	
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL	

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	2	<1	<1
Chromium	ppm	ASTM D5185m >10	<1	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	<1	0	0
Silver	ppm	ASTM D5185m >2	0	0	<1
Aluminum	ppm	ASTM D5185m >10	2	0	1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	1	3	1
Tin	ppm	ASTM D5185m >10	<1	0	<1
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	<1
Barium	ppm	ASTM D5185m 90	0	0	33
Molybdenum	ppm	ASTM D5185m	<1	0	0
Manganese	ppm	ASTM D5185m	<1	0	<1
Magnesium	ppm	ASTM D5185m 90	70	40	74
Calcium	ppm	ASTM D5185m 2	0	0	1
Phosphorus	ppm	ASTM D5185m	0	<1	0
Zinc	ppm	ASTM D5185m	0	3	0
Sulfur	ppm	ASTM D5185m	20419	18661	14439

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	1	0	<1
Sodium	ppm	ASTM D5185m	10	5	20
Potassium	ppm	ASTM D5185m >20	2	2	4
Water	%	ASTM D6304 >0.05	0.033	0.016	0.023
ppm Water	ppm	ASTM D6304 >500	339	163.5	237.2






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	82066	7394	13214
Particles >6µm	ASTM D7647 >1300	▲ 31631	▲ 2621	▲ 3986
Particles >14µm	ASTM D7647 >80	▲ 4026	▲ 329	▲ 444
Particles >21µm	ASTM D7647 >20	▲ 1120	▲ 89	▲ 87
Particles >38µm	ASTM D7647 >4	▲ 37	▲ 10	6
Particles >71µm	ASTM D7647 >3	▲ 1	1	0
Oil Cleanliness	ISO 4406 (c) >17/13	▲ 22/19	▲ 19/16	▲ 19/16

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.38	0.35	0.34


OIL ANALYSIS REPORT

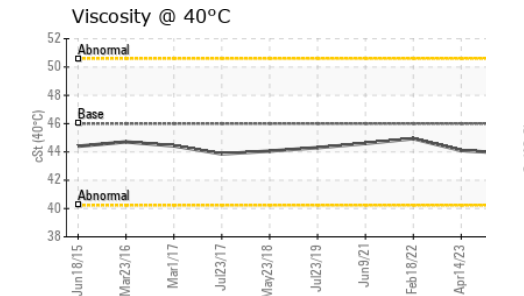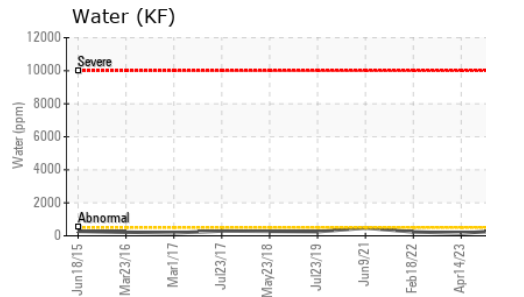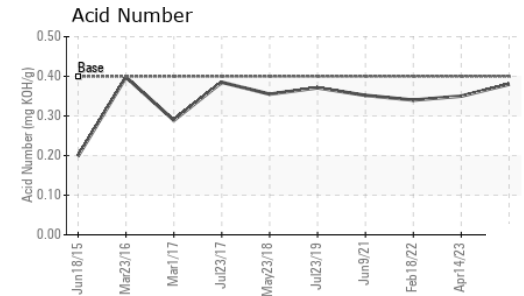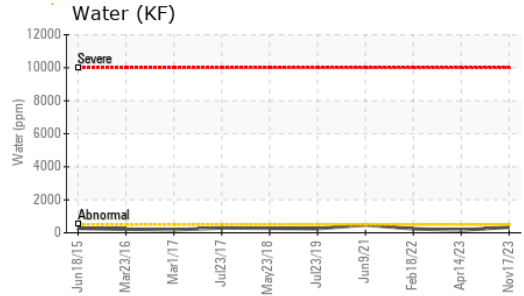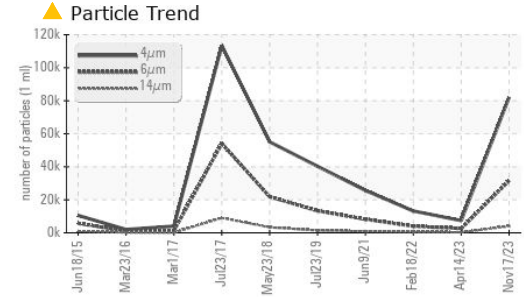





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.9	44.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

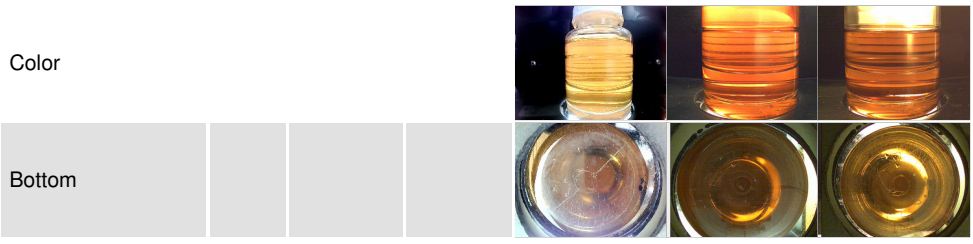

GRAPHS

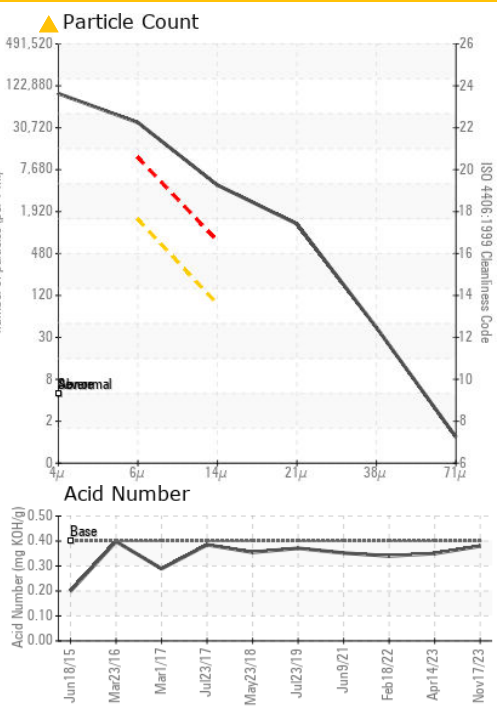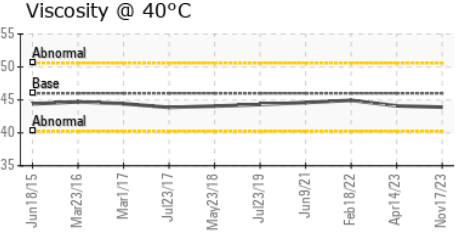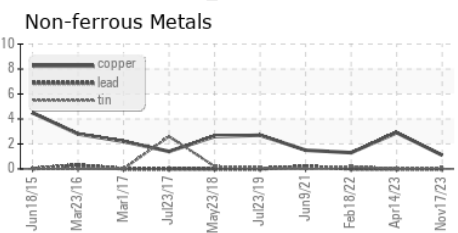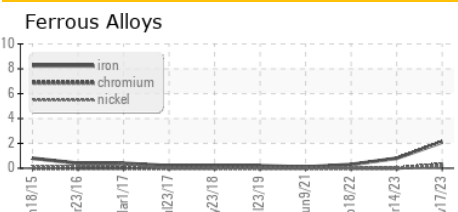

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA009984 **Received** : 08 Dec 2023
Lab Number : 06029391 **Diagnosed** : 12 Dec 2023
Unique Number : 10779182 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

J PATTON SPORTS MARKETING - AAA LABEL
 3450 RIVERGREEN CT
 DULUTH, GA
 US 30096
 Contact: DAN
 dan@jpattonondemand.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: