



# PROBLEM SUMMARY

Sample Rating Trend



ISO



Machine Id

## HI CELL II

Component


### Hydraulic System

Fluid

### MOBIL DTE ULTRA 24 ISO 32 (--- GAL)

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

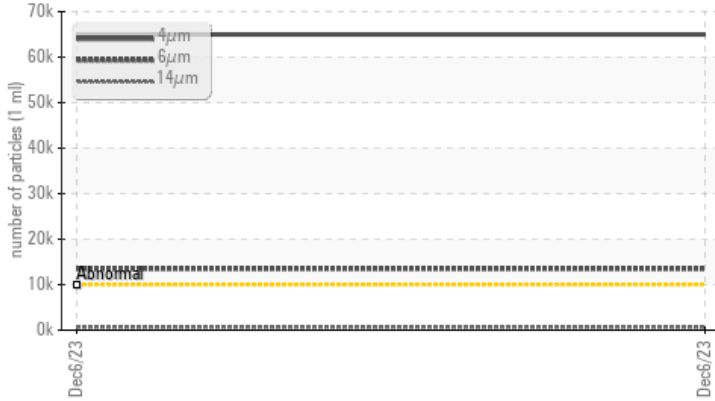


## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status				<b>ABNORMAL</b>	---	---
Particles >4µm	ASTM D7647	>10000	▲ <b>64973</b>	---	---	---
Particles >6µm	ASTM D7647	>2500	▲ <b>13515</b>	---	---	---
Particles >14µm	ASTM D7647	>320	▲ <b>646</b>	---	---	---
Particles >21µm	ASTM D7647	>80	▲ <b>176</b>	---	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ <b>23/21/17</b>	---	---	---

PrtFilter



Customer Id: LINORA  
 Sample No.: PH0003680  
 Lab Number: 06029981  
 Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

## Sample Rating Trend



ISO



Machine Id

## HI CELL II

Component

### Hydraulic System

Fluid

### MOBIL DTE ULTRA 24 ISO 32 (--- GAL)

#### DIAGNOSIS

##### ▲ Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

##### Wear

All component wear rates are normal.

##### ▲ Contamination

There is a high amount of particulates present in the oil.

##### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PH0003680</b>	---	---
Sample Date	Client Info		<b>06 Dec 2023</b>	---	---
Machine Age	yrs	Client Info	<b>0</b>	---	---
Oil Age	yrs	Client Info	<b>1</b>	---	---
Oil Changed	Client Info		<b>N/A</b>	---	---
Sample Status			<b>ABNORMAL</b>	---	---

CONTAMINATION	method	limit/base	current	history1	history2
Water	WC Method	>0.05	<b>NEG</b>	---	---

WEAR METALS	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m	>20	<b>4</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Tin	ppm	ASTM D5185m	>20	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

ADDITIVES	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	---	---
Calcium	ppm	ASTM D5185m		<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>64</b>	---	---
Zinc	ppm	ASTM D5185m		<b>118</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>76</b>	---	---

CONTAMINANTS	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m	>15	<b>2</b>	---	---
Sodium	ppm	ASTM D5185m		<b>1</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>▲ 64973</b>	---	---
Particles >6µm	ASTM D7647	>2500	<b>▲ 13515</b>	---	---
Particles >14µm	ASTM D7647	>320	<b>▲ 646</b>	---	---
Particles >21µm	ASTM D7647	>80	<b>▲ 176</b>	---	---
Particles >38µm	ASTM D7647	>20	<b>8</b>	---	---
Particles >71µm	ASTM D7647	>4	<b>1</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>▲ 23/21/17</b>	---	---





FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.14</b>	---	---

Particle Filter (Magn: 200 x)





# OIL ANALYSIS REPORT

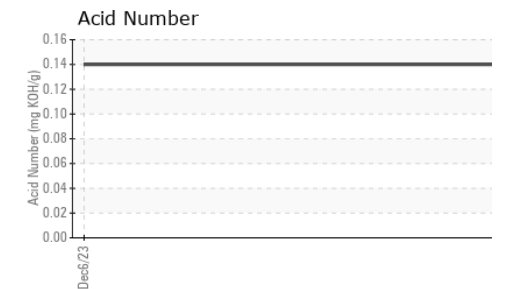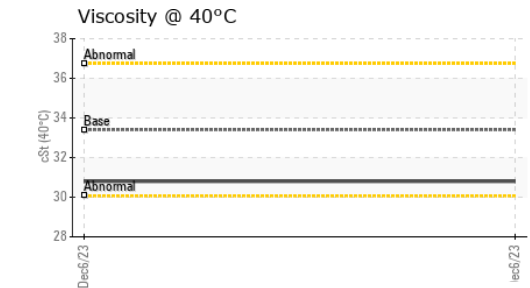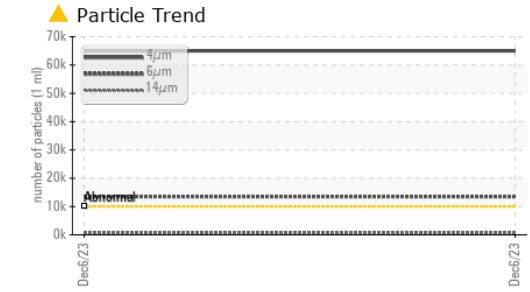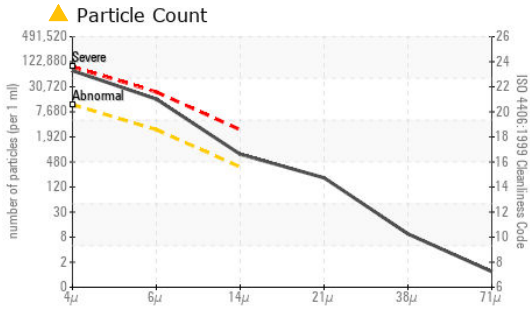

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PH0003680 **Received** : 08 Dec 2023  
**Lab Number** : 06029981 **Diagnosed** : 13 Dec 2023  
**Unique Number** : 10779772 **Diagnostician** : Jonathan Hester  
**Test Package** : PLANT ( Additional Tests: PrtFilter )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.






Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	33.4	30.8	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					
PrtFilter					

## GRAPHS

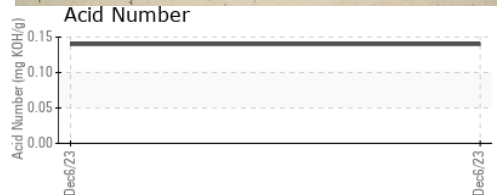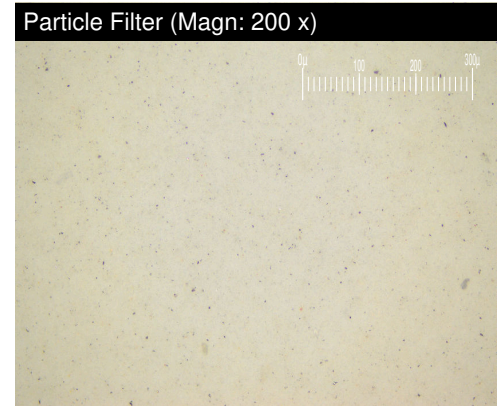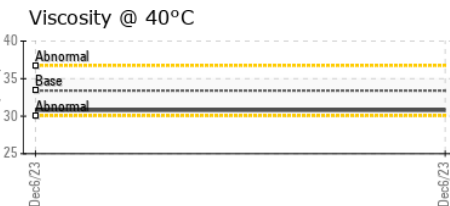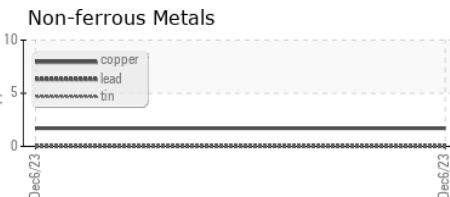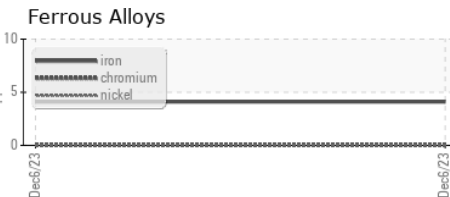

**LINDE ADVANCED MATERIALS TECHNOLOGIES**  
 542 ROUTE 303  
 ORANGEBURG, NY  
 US 10920  
 Contact: THOMAS BIGGIE  
 thomas.biggie@linde.com

T:  
F: