OIL ANALYSIS REPORT

Sample Rating Trend

DIRT

Area
1A1
Machine Id
17-046S16-6EOT
Component
Gearbox
Fluid
NOT GIVEN (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

Elemental level of silicon (Si) above normal indicating ingress of seal material. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**WC0881646**	---	---
Sample Date		Client Info		**10 Dec 2023**	---	---
Machine Age	mls	Client Info		**0**	---	---
Oil Age	mls	Client Info		**0**	---	---
Oil Changed		Client Info		**N/A**	---	---
Sample Status				**ABNORMAL**	---	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	**0**	---	---
Chromium	ppm	ASTM D5185m	>15	**0**	---	---
Nickel	ppm	ASTM D5185m	>15	**<1**	---	---
Titanium	ppm	ASTM D5185m		**<1**	---	---
Silver	ppm	ASTM D5185m		**0**	---	---
Aluminum	ppm	ASTM D5185m	>25	**0**	---	---
Lead	ppm	ASTM D5185m	>100	**0**	---	---
Copper	ppm	ASTM D5185m	>200	**0**	---	---
Tin	ppm	ASTM D5185m	>25	**0**	---	---
Vanadium	ppm	ASTM D5185m		**0**	---	---
Cadmium	ppm	ASTM D5185m		**0**	---	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**324**	---	---
Barium	ppm	ASTM D5185m		**0**	---	---
Molybdenum	ppm	ASTM D5185m		**0**	---	---
Manganese	ppm	ASTM D5185m		**0**	---	---
Magnesium	ppm	ASTM D5185m		**0**	---	---
Calcium	ppm	ASTM D5185m		**28**	---	---
Phosphorus	ppm	ASTM D5185m		**1172**	---	---
Zinc	ppm	ASTM D5185m		**0**	---	---
Sulfur	ppm	ASTM D5185m		**154**	---	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	▲ **60**	---	---
Sodium	ppm	ASTM D5185m		**0**	---	---
Potassium	ppm	ASTM D5185m	>20	**3**	---	---
Water	%	ASTM D6304	>0.2	**0.016**	---	---
ppm Water	ppm	ASTM D6304	>2000	**165**	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	**1301**	---	---
Particles >6µm		ASTM D7647	>5000	**369**	---	---
Particles >14µm		ASTM D7647	>640	**22**	---	---
Particles >21µm		ASTM D7647	>160	**4**	---	---
Particles >38µm		ASTM D7647	>40	**0**	---	---
Particles >71µm		ASTM D7647	>10	**0**	---	---
Oil Cleanliness		ISO 4406 (c)	>21/19/16	**18/16/12**	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		**2.99**	---	---

OIL ANALYSIS REPORT

Silicon (ppm)

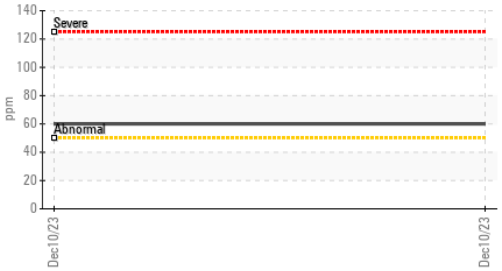

Water (KF)

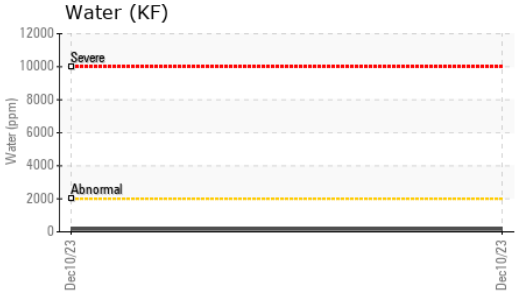

Particle Trend

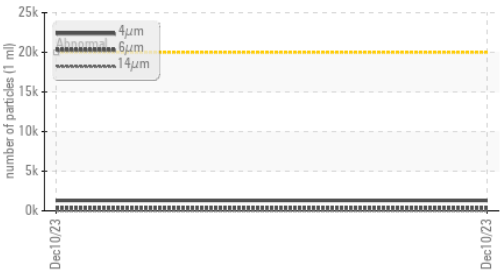

Viscosity @ 100°C

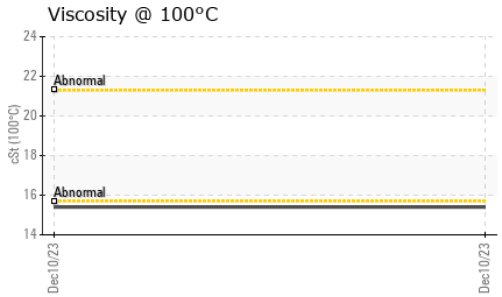

Viscosity @ 40°C

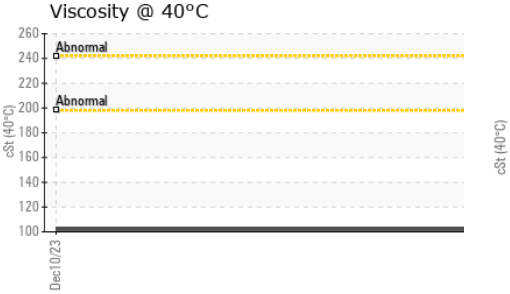

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	---	---
Yellow Metal	scalar	*Visual	NONE	**NONE**	---	---
Precipitate	scalar	*Visual	NONE	**NONE**	---	---
Silt	scalar	*Visual	NONE	**NONE**	---	---
Debris	scalar	*Visual	NONE	**NONE**	---	---
Sand/Dirt	scalar	*Visual	NONE	**NONE**	---	---
Appearance	scalar	*Visual	NORML	**NORML**	---	---
Odor	scalar	*Visual	NORML	**NORML**	---	---
Emulsified Water	scalar	*Visual	>0.2	**NEG**	---	---
Free Water	scalar	*Visual		**NEG**	---	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		**102**	---	---
Visc @ 100°C	cSt	ASTM D445		**15.4**	---	---
Viscosity Index (VI)	Scale	ASTM D2270		**159**	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color			*no image*	*no image*	*no image*
Bottom			*no image*	*no image*	*no image*

GRAPHS

Ferrous Alloys

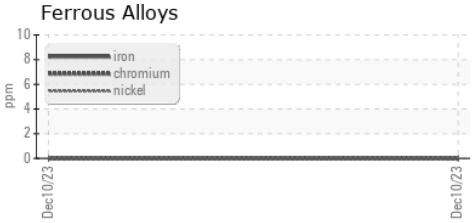

Non-ferrous Metals

Viscosity @ 40°C

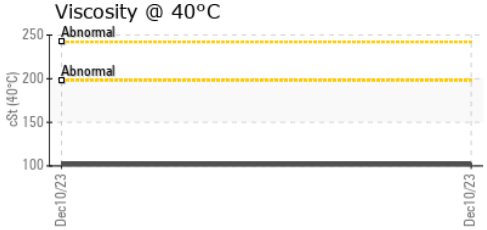

Particle Count

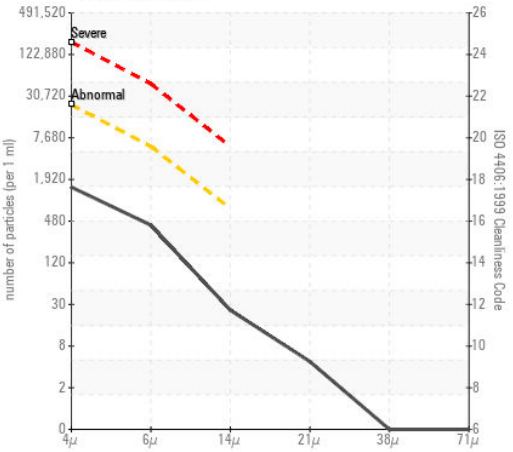

Acid Number

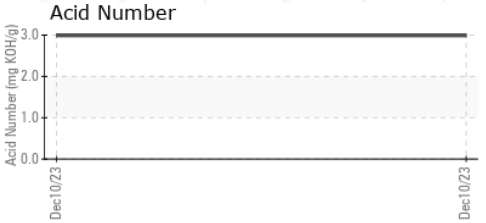

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0881646 **Recieved** : 08 Dec 2023
Lab Number : 06030021 **Diagnosed** : 15 Dec 2023
Unique Number : 10779812 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: KF, KV100, PRTCOUNT, VI)

Certificate L2367

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BASF - GIANNA CREDAROLI
500 WHITE PLAINS RD
TARRYTOWN, NY
US 10591
Contact: GIANNA CREDAROLI
gianna.credaroli@basf.com
T:
F: