



COOLANT REPORT

Sample Rating Trend

NORMAL



Machine Id
E-1 - RICHLAND CREEK

Component
Coolant
Fluid
PRECOOL 4060 Q8 (--- GAL)

DIAGNOSIS

Recommendation

The fluid is suitable for further service.

Contaminants

There is no indication of any contamination in the coolant.

Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.



SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0880391	---	---
Sample Date	Client Info		03 Jan 2024	---	---
Machine Age	hrs	Client Info	42651	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed		Client Info	N/A	---	---
Sample Status			NORMAL	---	---

PHYSICAL TEST RESULTS









	method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298		1.064	---	---
pH	Scale 0-14 ASTM D1287		7.70	---	---
Nitrites	ppm AP-053:2009		1500	---	---
Reserve Alkalinity	Scale 0-20 *ASTM D1121		---	---	---
Percentage Glycol	% ASTM D3321		47.1	---	---
Freezing Point	°F ASTM D3321		-28	---	---
Total Dissolved Solids			368.0	---	---
Carboxylate			n/a	---	---

VISUAL

	method	limit/base	current	history1	history2
Coolant Color	*Visual		Orange	---	---
Coolant Appearance	*Visual	Clear	normal	---	---
Color				no image	no image
Bottom				no image	no image



COOLANT REPORT

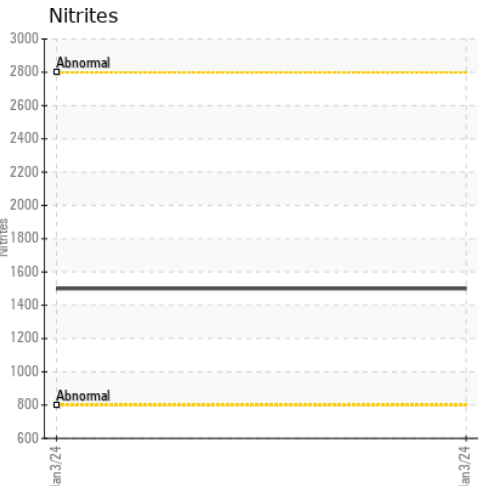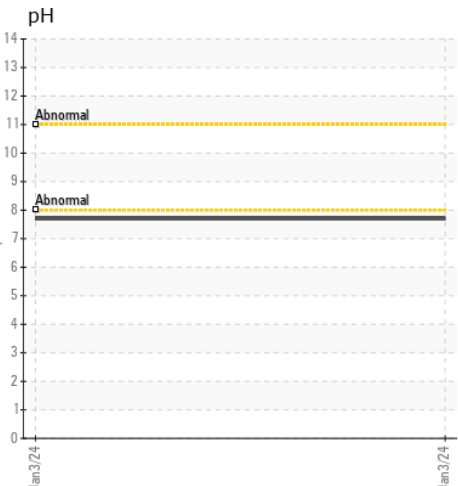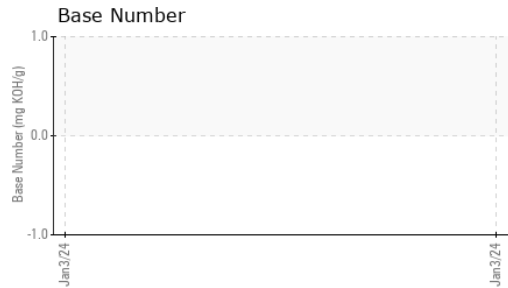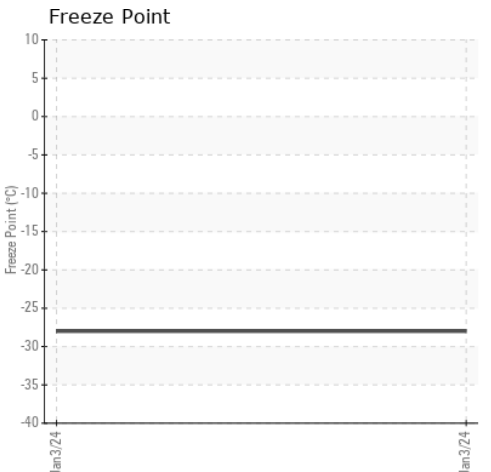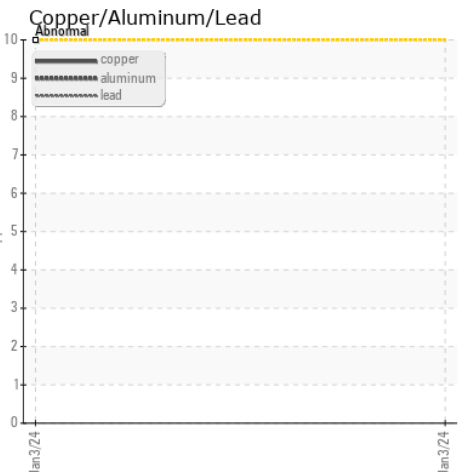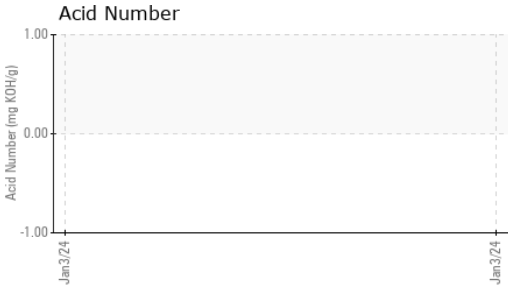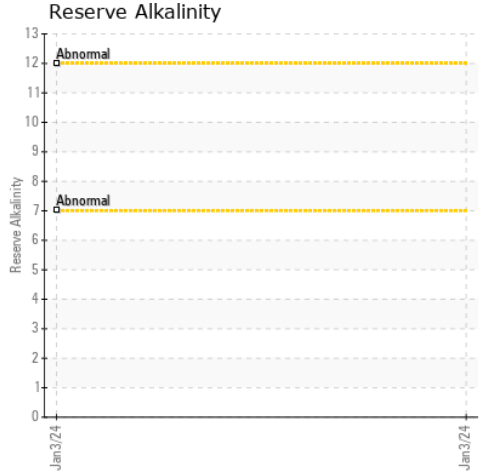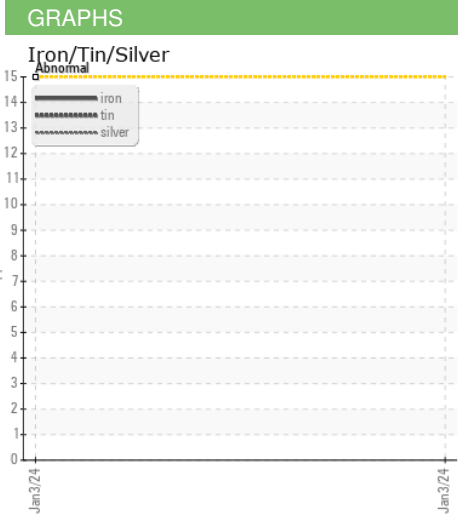

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0880391 **Received** : 08 Jan 2024
Lab Number : 06054517 **Diagnosed** : 10 Jan 2024
Unique Number : 10820466 **Diagnostician** : Jonathan Hester
Test Package : COOL- (Additional Tests: COOL, TAN Man, TBN)

CUBE DISTRICT ENERGY - MAS GEORGIA LFG PLANT SITE
 5691 S RICHLAND CREEK RD
 BUFORD, GA
 US 30518
 Contact: RYAN INGALLS
 ryan.ingalls@cubedistrictenergy.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: