




# OIL ANALYSIS REPORT

Sample Rating Trend

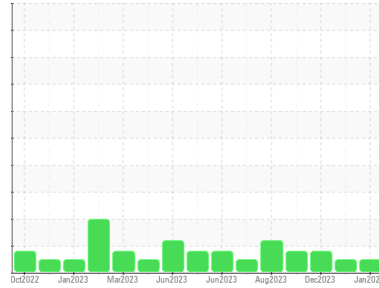

**NORMAL**



Area  
**Paper Side**  
 Machine Id  
**PM 2 MAIN BOWSER**  
 Component  
**Bearing Lube**  
 Fluid  
**SHELL PM S2 M 220 (3500 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORMATION |             | method      | limit/base | current            | history1    | history2    |
|--------------------|-------------|-------------|------------|--------------------|-------------|-------------|
| Sample Number      | Client Info |             |            | <b>PE0001463</b>   | PE0001469   | PE0001451   |
| Sample Date        | Client Info |             |            | <b>03 Jan 2024</b> | 13 Dec 2023 | 06 Dec 2023 |
| Machine Age        | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Age            | hrs         | Client Info |            | <b>0</b>           | 0           | 0           |
| Oil Changed        | Client Info |             |            | <b>N/A</b>         | N/A         | N/A         |
| Sample Status      |             |             |            | <b>NORMAL</b>      | NORMAL      | ATTENTION   |

| CONTAMINATION |           | method | limit/base | current    | history1 | history2 |
|---------------|-----------|--------|------------|------------|----------|----------|
| Water         | WC Method |        | >0.2       | <b>NEG</b> | NEG      | NEG      |






| WEAR METALS |     | method      | limit/base | current   | history1 | history2 |
|-------------|-----|-------------|------------|-----------|----------|----------|
| PQ          |     | ASTM D8184  |            | <b>10</b> | 15       | 16       |
| Iron        | ppm | ASTM D5185m | >120       | <b>0</b>  | 0        | 0        |
| Chromium    | ppm | ASTM D5185m | >5         | <b>0</b>  | 0        | 0        |
| Nickel      | ppm | ASTM D5185m | >20        | <b>0</b>  | 0        | 0        |
| Titanium    | ppm | ASTM D5185m |            | <b>0</b>  | <1       | <1       |
| Silver      | ppm | ASTM D5185m |            | <b>0</b>  | <1       | 0        |
| Aluminum    | ppm | ASTM D5185m | >4         | <b>0</b>  | 0        | 0        |
| Lead        | ppm | ASTM D5185m | >30        | <b>0</b>  | <1       | <1       |
| Copper      | ppm | ASTM D5185m | >17        | <b>5</b>  | 5        | 4        |
| Tin         | ppm | ASTM D5185m | >10        | <b>0</b>  | <1       | 0        |
| Vanadium    | ppm | ASTM D5185m |            | <b>0</b>  | <1       | 0        |
| Cadmium     | ppm | ASTM D5185m |            | <b>0</b>  | 0        | 0        |

| ADDITIVES  |     | method      | limit/base | current     | history1 | history2 |
|------------|-----|-------------|------------|-------------|----------|----------|
| Boron      | ppm | ASTM D5185m |            | <b>0</b>    | 0        | 0        |
| Barium     | ppm | ASTM D5185m |            | <b>0</b>    | 0        | 0        |
| Molybdenum | ppm | ASTM D5185m |            | <b>0</b>    | 0        | <1       |
| Manganese  | ppm | ASTM D5185m |            | <b>0</b>    | <1       | 0        |
| Magnesium  | ppm | ASTM D5185m |            | <b>0</b>    | 0        | 0        |
| Calcium    | ppm | ASTM D5185m |            | <b>70</b>   | 89       | 78       |
| Phosphorus | ppm | ASTM D5185m |            | <b>624</b>  | 739      | 853      |
| Zinc       | ppm | ASTM D5185m |            | <b>828</b>  | 1004     | 1174     |
| Sulfur     | ppm | ASTM D5185m |            | <b>4890</b> | 5684     | 6324     |

| CONTAMINANTS |     | method      | limit/base | current   | history1 | history2 |
|--------------|-----|-------------|------------|-----------|----------|----------|
| Silicon      | ppm | ASTM D5185m | >25        | <b>0</b>  | 2        | 3        |
| Sodium       | ppm | ASTM D5185m |            | <b>19</b> | 24       | 20       |
| Potassium    | ppm | ASTM D5185m | >20        | <b>0</b>  | 0        | 2        |

| FLUID CLEANLINESS |  | method       | limit/base | current         | history1 | history2   |
|-------------------|--|--------------|------------|-----------------|----------|------------|
| Particles >4µm    |  | ASTM D7647   | >2500      | <b>560</b>      | 1132     | 2077       |
| Particles >6µm    |  | ASTM D7647   | >640       | <b>131</b>      | 201      | ▲ 695      |
| Particles >14µm   |  | ASTM D7647   | >160       | <b>14</b>       | 15       | 54         |
| Particles >21µm   |  | ASTM D7647   | >40        | <b>3</b>        | 4        | 12         |
| Particles >38µm   |  | ASTM D7647   | >10        | <b>0</b>        | 0        | 0          |
| Particles >71µm   |  | ASTM D7647   | >3         | <b>0</b>        | 0        | 0          |
| Oil Cleanliness   |  | ISO 4406 (c) | >18/16/14  | <b>16/14/11</b> | 17/15/11 | ▲ 18/17/13 |

# OIL ANALYSIS REPORT

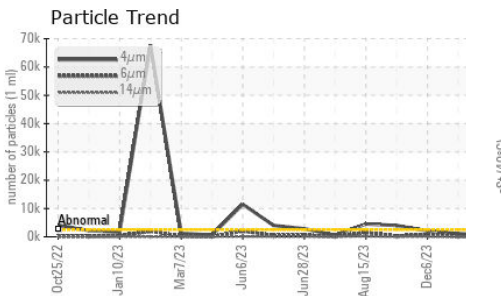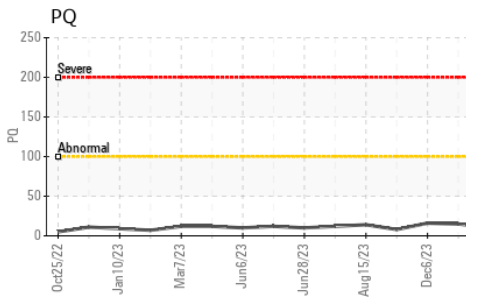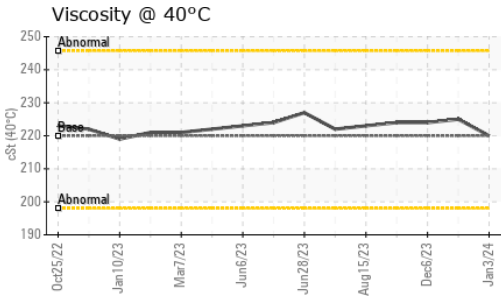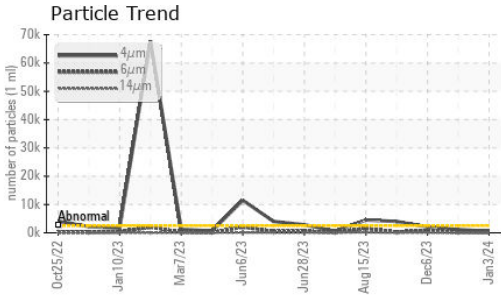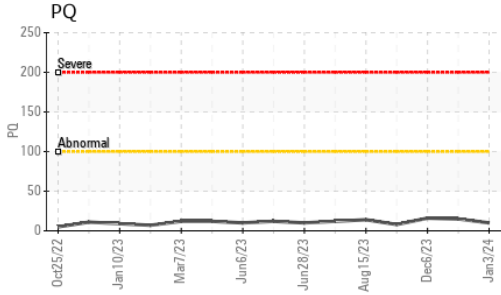


| FLUID DEGRADATION |          | method     | limit/base | current     | history1 | history2 |
|-------------------|----------|------------|------------|-------------|----------|----------|
| Acid Number (AN)  | mg KOH/g | ASTM D8045 |            | <b>0.59</b> | 0.69     | 0.71     |






| VISUAL           |        | method  | limit/base | current      | history1 | history2 |
|------------------|--------|---------|------------|--------------|----------|----------|
| White Metal      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Yellow Metal     | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Precipitate      | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Silt             | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Debris           | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Sand/Dirt        | scalar | *Visual | NONE       | <b>NONE</b>  | NONE     | NONE     |
| Appearance       | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Odor             | scalar | *Visual | NORML      | <b>NORML</b> | NORML    | NORML    |
| Emulsified Water | scalar | *Visual | >0.2       | <b>NEG</b>   | NEG      | NEG      |
| Free Water       | scalar | *Visual |            | <b>NEG</b>   | NEG      | NEG      |

| FLUID PROPERTIES |     | method    | limit/base | current    | history1 | history2 |
|------------------|-----|-----------|------------|------------|----------|----------|
| Visc @ 40°C      | cSt | ASTM D445 | 220        | <b>220</b> | 225      | 224      |

### SAMPLE IMAGES

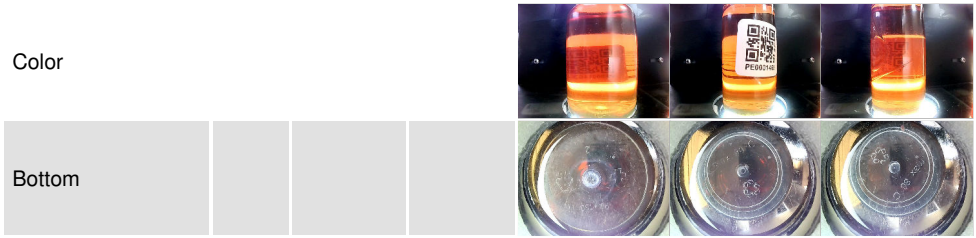

### GRAPHS

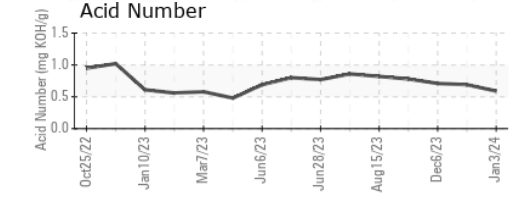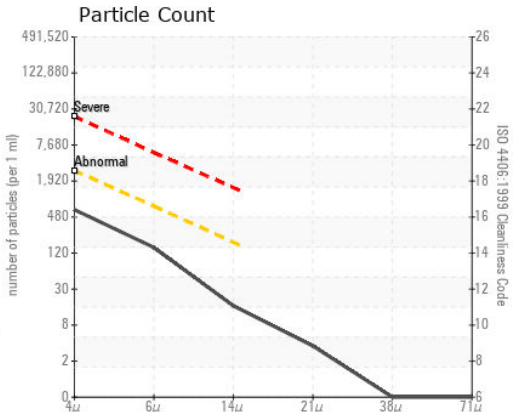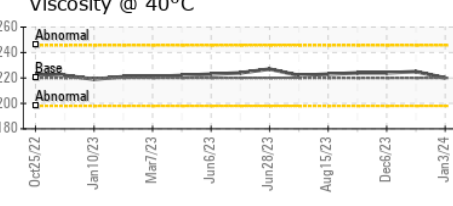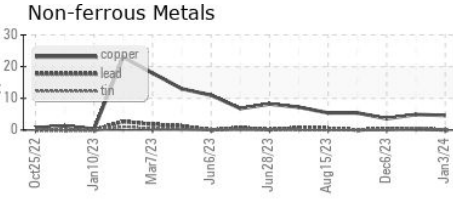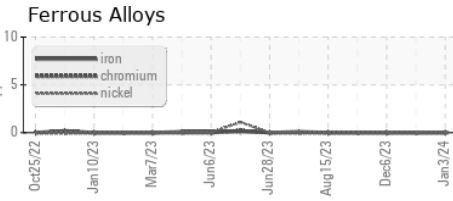

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PE0001463 **Received** : 08 Jan 2024  
**Lab Number** : **06054781** **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10820730 **Diagnostician** : Don Baldrige  
**Test Package** : PLANT ( Additional Tests: ICP, KV40, PQ, PrtCount, SCREEN )

**MCKINLEY PAPER COMPANY**  
 1902 MARINE DR  
 PORT ANGELES, WA  
 US 98363  
 Contact: CHAD GALLAUHER  
 chad.gallauher@biopappel.com  
 T: (360)457-4474  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)