

OIL ANALYSIS REPORT


AZURE SKY [200007684]

T-34

Component

Wind Turbine Gearbox

FUCHS RENOLIN UNISYN CLP 320 (650 LTR)

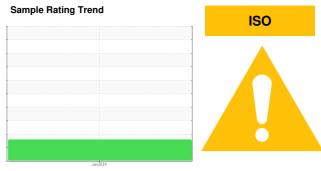

DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

R)				Jan 2024		
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		NX06054818		
Sample Date		Client Info		07 Jan 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>40	15		
Iron	ppm	ASTM D5185m	>55	6		
Chromium	ppm	ASTM D5185m	>2	0		
Nickel	ppm	ASTM D5185m	>2	0		
Titanium	ppm	ASTM D5185m	>10	0		
Silver	ppm	ASTM D5185m		0		
Aluminum	ppm	ASTM D5185m	>15	0		
Lead	ppm	ASTM D5185m	>3	<1		
Copper	ppm	ASTM D5185m	>7	<1		
Tin	ppm	ASTM D5185m		0		
Vanadium	ppm	ASTM D5185m	70	0		
Cadmium		ASTM D5185m		0		
	ppm					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		7		
Barium	ppm	ASTM D5185m		0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		16		
Phosphorus	ppm	ASTM D5185m		200		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		4756		
CONTAMINANT	S	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>35	10		
Sodium	ppm	ASTM D5185m		4		
Potassium	ppm	ASTM D5185m	>20	<1		
Water	%	ASTM D6304	>0.02	0.002		
ppm Water	ppm	ASTM D6304	>200	20		
FLUID CLEANLII	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		5056		
Particles >6µm		ASTM D7647	>320	<u> </u>		
Particles >14µm		ASTM D7647	>40	<u> </u>		
Particles >21µm		ASTM D7647	>10	<u> </u>		
Particles >38µm		ASTM D7647	>3	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/15/12	<u>^</u> 20/18/14		
FLUID DEGRAD	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	ma KO∐/a	VSTM D804E	0.6	0.35		



OIL ANALYSIS REPORT

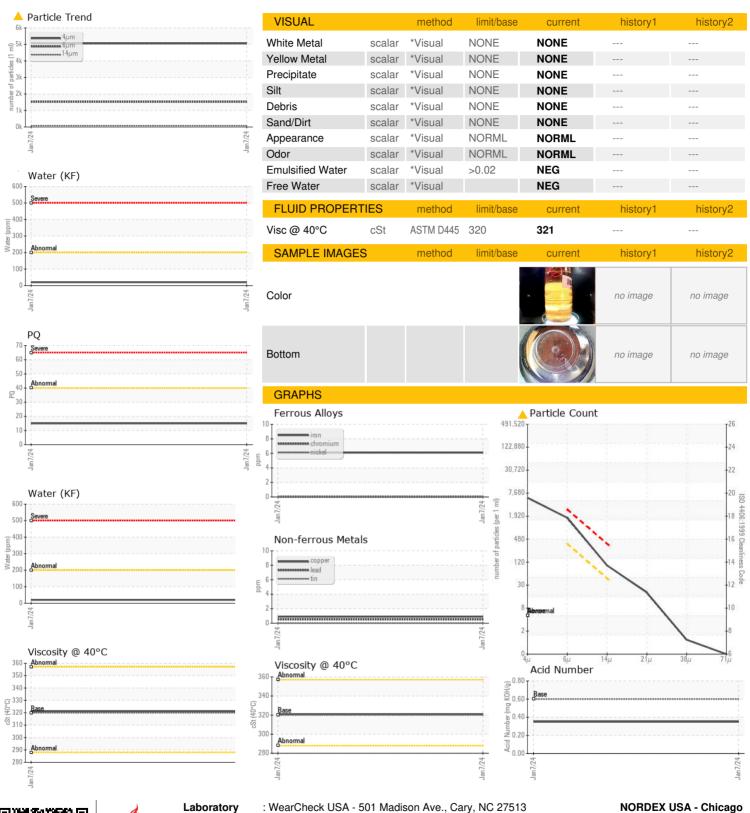



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: 06054818 : 10820767

: NX06054818

Recieved Diagnosed

: 08 Jan 2024 : 10 Jan 2024

Diagnostician : Don Baldridge **Test Package**: IND 2 (Additional Tests: KF, PQ, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

NORDEX USA - Chicago

300 SOUTH WACKER DRIVE, SUITE 1500 CHICAGO, IL

US 60606

Contact: DEVIN LINEHAN DLinehan@nordex-online.com

T: (312)386-4124 F: (312)386-7102

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)