


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

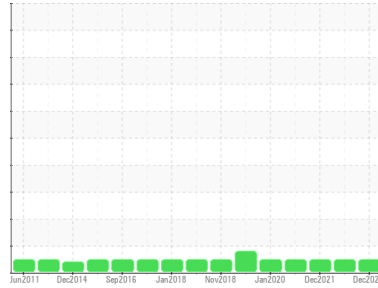

Area
(NCR 7479)
Machine Id
C102 (S/N 6412-02)

Component
Wind Turbine Gearbox
Fluid
MOBIL MOBILGEAR SHC XMP 320 (74 GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			MHI026247	MHI017164	MHI019131
Sample Date	Client Info			01 Dec 2023	21 Nov 2022	02 Dec 2021
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		26247	89280	83696
Oil Changed	Client Info			N/A	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184	>200	19	8	18
Iron	ppm	ASTM D5185m	>200	1	4	5
Chromium	ppm	ASTM D5185m	>3	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>10	0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>30	0	0	0
Lead	ppm	ASTM D5185m	>15	0	0	0
Copper	ppm	ASTM D5185m	>75	1	50	29
Tin	ppm	ASTM D5185m	>10	0	0	<1
Antimony	ppm	ASTM D5185m	>5	---	---	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	2
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		0	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	485	408	349	411
Zinc	ppm	ASTM D5185m	0	0	17	11
Sulfur	ppm	ASTM D5185m		4020	3697	3521

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>+30	0	0	0
Sodium	ppm	ASTM D5185m	>15	1	0	0
Potassium	ppm	ASTM D5185m	>20	<1	0	0
Water	%	ASTM D6304	>0.1	0.003	0.016	0.004
ppm Water	ppm	ASTM D6304	>1000	37	165.3	41.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>20000	2585	519	89
Particles >6µm		ASTM D7647	>5000	159	87	20
Particles >14µm		ASTM D7647	>640	9	13	4
Particles >21µm		ASTM D7647	>160	2	6	1
Particles >38µm		ASTM D7647	>40	0	1	0
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>21/19/16	19/14/10	16/14/11	14/11/9

OIL ANALYSIS REPORT

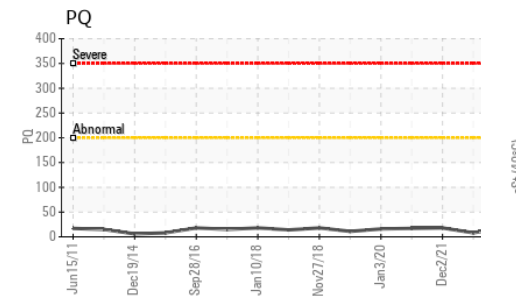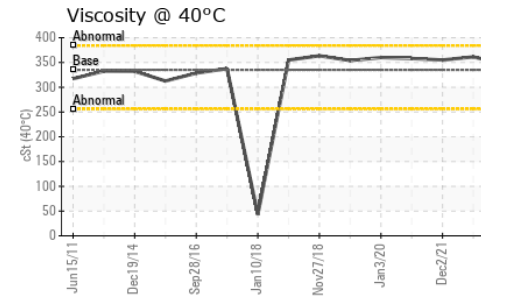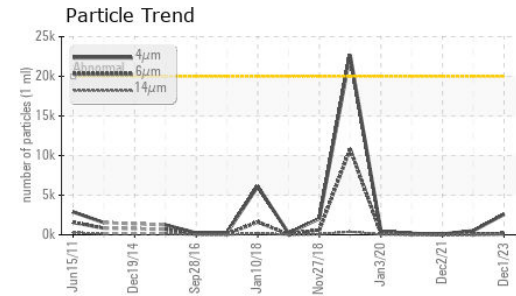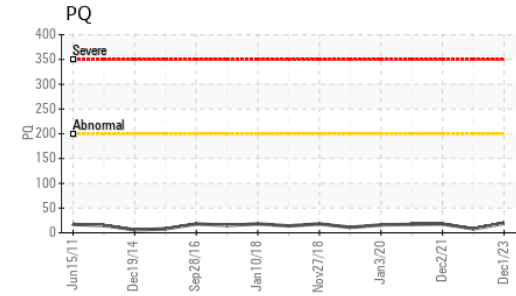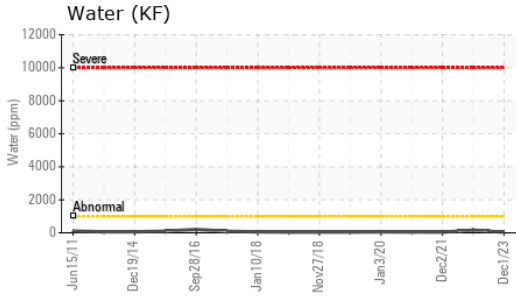


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.85	0.71	1.07	1.15





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	335	347	361.3	355

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

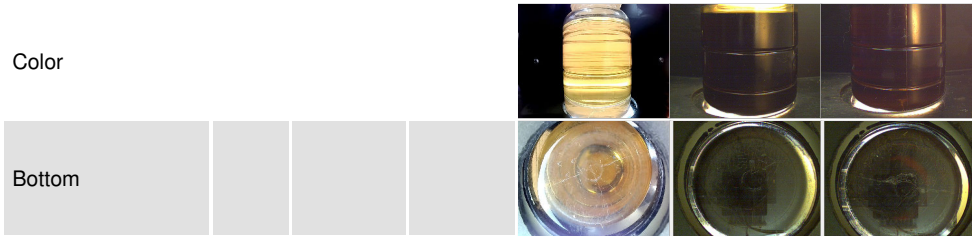

GRAPHS

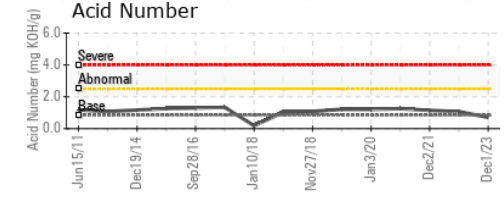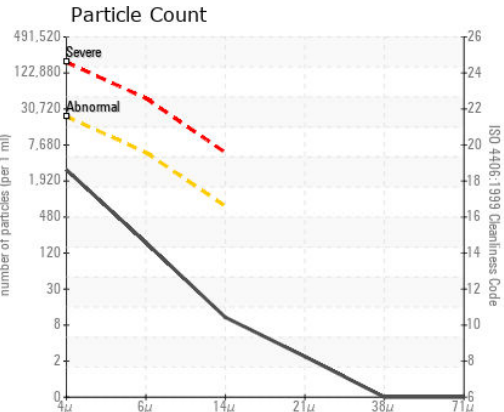

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MH1026247 **Received** : 08 Jan 2024
Lab Number : 06054888 **Diagnosed** : 10 Jan 2024
Unique Number : 10820837 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, PQ, PrtCount)

DIAMOND WTG - DILLON
P.O. BOX 880
DESERT HOT SPRINGS, CA
US 92240
Contact: DANIEL BOYD
daniel.boyd@diamondwtg.com
T: (760)329-7171
F: (760)329-7122

To discuss this sample report, contact Customer Service at 1-800-237-1369.
* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)