




# OIL ANALYSIS REPORT

Sample Rating Trend

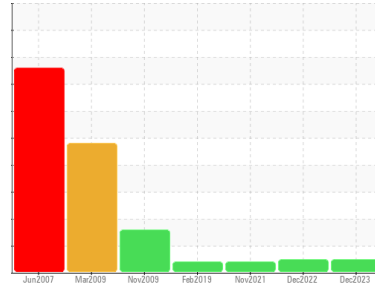

**NORMAL**



Machine Id  
**KAESER SX-6 2493714 (S/N 2803)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA011542</b>	KCP49874	KCP39526
Sample Date	Client Info		<b>27 Dec 2023</b>	30 Dec 2022	24 Nov 2021
Machine Age	hrs	Client Info	<b>11410</b>	16597	9635
Oil Age	hrs	Client Info	<b>0</b>	800	2271
Oil Changed	Client Info		<b>N/A</b>	Changed	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	0
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>10</b>	17	24
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>9</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185m 90	<b>87</b>	67	39
Calcium	ppm	ASTM D5185m 2	<b>&lt;1</b>	<1	0
Phosphorus	ppm	ASTM D5185m	<b>0</b>	30	0
Zinc	ppm	ASTM D5185m	<b>13</b>	16	11
Sulfur	ppm	ASTM D5185m	<b>16701</b>	19528	16171

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	2	0
Sodium	ppm	ASTM D5185m	<b>31</b>	33	15
Potassium	ppm	ASTM D5185m >20	<b>2</b>	6	0
Water	%	ASTM D6304 >0.05	<b>0.018</b>	0.020	0.013
ppm Water	ppm	ASTM D6304 >500	<b>182</b>	202.1	134.1






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>2364</b>	3229	---
Particles >6µm	ASTM D7647 >1300		<b>465</b>	552	---
Particles >14µm	ASTM D7647 >80		<b>33</b>	28	---
Particles >21µm	ASTM D7647 >20		<b>9</b>	9	---
Particles >38µm	ASTM D7647 >4		<b>0</b>	0	---
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	<b>18/16/12</b>	19/16/12	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.42</b>	0.301	0.338


# OIL ANALYSIS REPORT

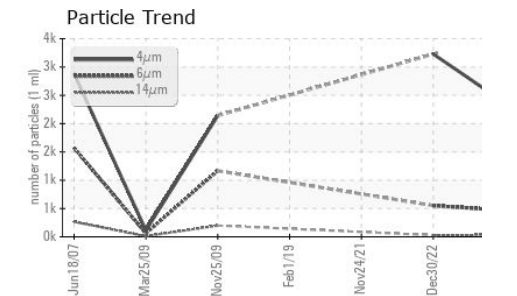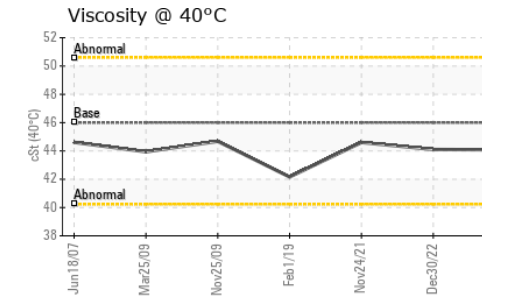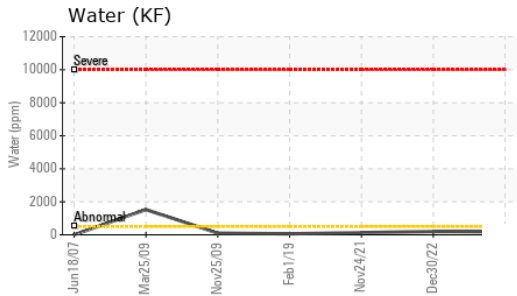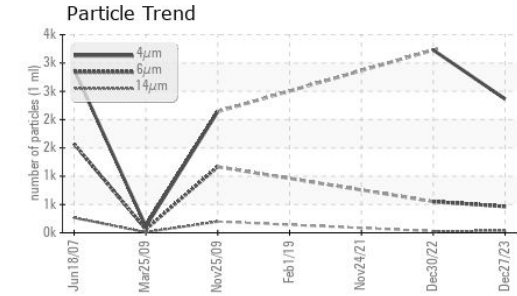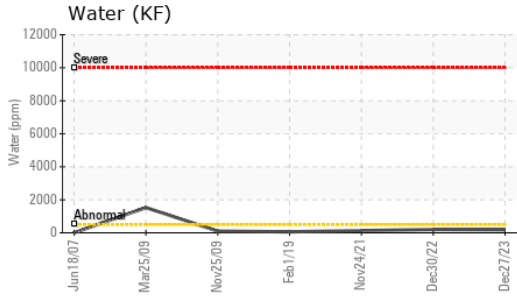






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.08	44.1	44.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

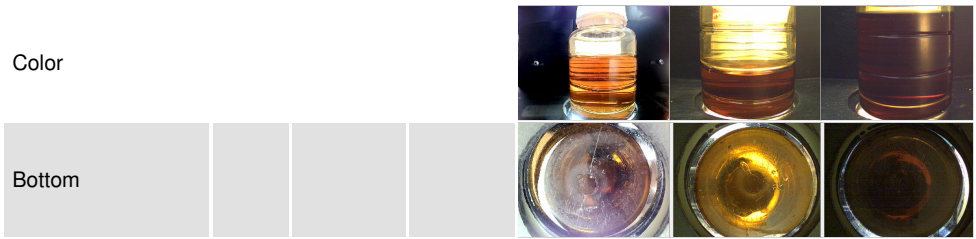

## GRAPHS

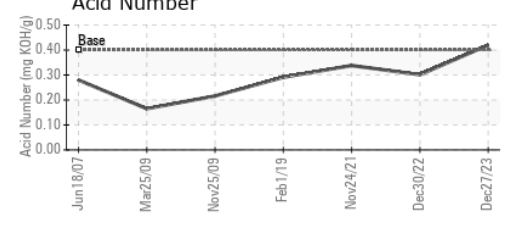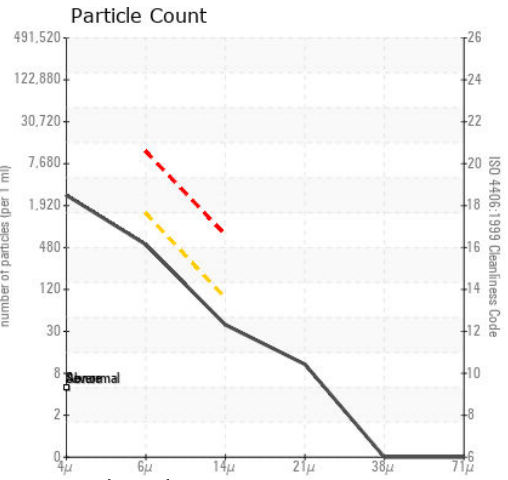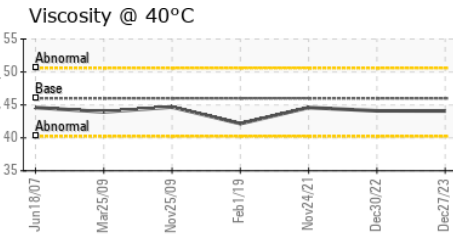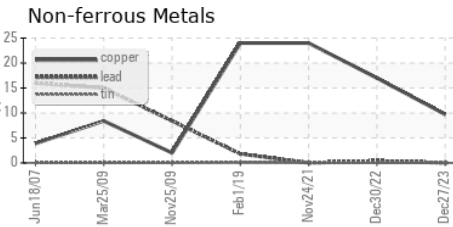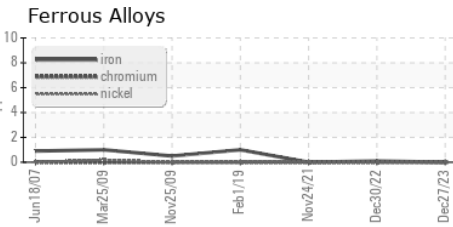

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA011542 **Recieved** : 08 Jan 2024  
**Lab Number** : 06054927 **Diagnosed** : 11 Jan 2024  
**Unique Number** : 10820876 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**NEW ENGLAND TECH**  
 2500 POST RD  
 WARWICK, RI  
 US 02886  
 Contact: B GOULET  
 BGOULET@NEIT.EDU  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)