

# **OIL ANALYSIS REPORT**

Sample Rating Trend



Machine Id 8615282 (S/N 1891) Component

Compressor Fluid {not provided} (--- QTS)

#### DIAGNOSIS

## Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

## Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC104743		
Sample Date		Client Info		29 Dec 2023		
Machine Age	hrs	Client Info		3136		
Oil Age	hrs	Client Info		1538		
Oil Changed		Client Info		Changed		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	3		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		16		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m		66		
Calcium	ppm	ASTM D5185m		<1		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		3		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		11		
Potassium	ppm	ASTM D5185m	>20	10		
Water	%	ASTM D6304	>0.05	0.016		
ppm Water	ppm	ASTM D6304	>500	164		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		2668		
Particles >6µm		ASTM D7647	>1300	773		
Particles >14µm		ASTM D7647	>80	44		
Particles >21µm		ASTM D7647	>20	13		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.33		



# **OIL ANALYSIS REPORT**

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

cSt

\*Visual

\*Visual

\*Visua

\*Visual

\*Visual

\*Visual

\*Visual

\*Visual

ASTM D445

scalar \*Visual

scalar \*Visual

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

>0.05

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

43.9

Particle Count

Acid Number

491,52

122,880

30.720 7,680

480

120

30

@<sup>0.40</sup>

HOX 0.30

0.20

0.10 Acid

0.00

lec29

Jec29/23

Dec29/23

Dec29/23

: 08 Jan 2024

: 10 Jan 2024

per 1 1,920 no image

no image

no image

no image

4406

:1999 Cle

14

White Metal

Yellow Metal

Precipitate

Silt

Debris

Odor

Color

Sand/Dirt

Appearance

Free Water


Visc @ 40°C


**Emulsified Water** 


FLUID PROPERTIES

SAMPLE IMAGES

lead





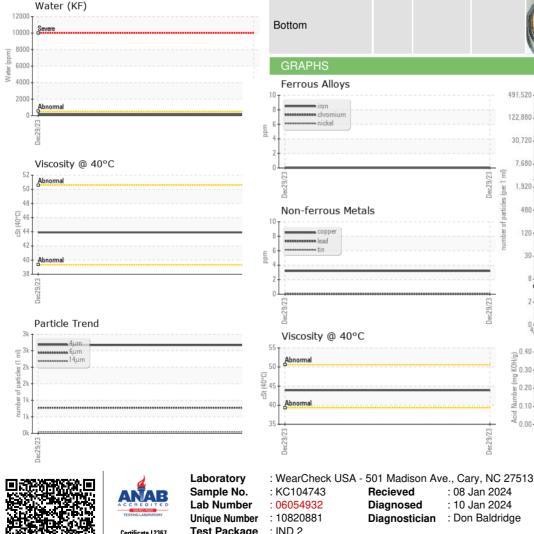

: 10820881 : Don Baldridge Diagnostician Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Recieved

Diagnosed

21µ

PEAK NUTRITIONAL PRODUCTS

5416 W SLIGH AVE, SUITE 112

Contact: Service Manager

38

Page 2 of 2

TAMPA, FL

US 33634