

# **OIL ANALYSIS REPORT**

## Sample Rating Trend



KAESER 101265.2

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

#### DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## Wear

All component wear rates are normal.

# Contamination

There is a moderate amount of particulates present in the oil.


#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Jan2024		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC121140		
Sample Date		Client Info		05 Jan 2024		
Machine Age	hrs	Client Info		4645		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ATTENTION		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	10		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		0		
Magnesium	ppm	ASTM D5185m	90	14		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		0		
Zinc	ppm	ASTM D5185m		72		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0		
Sodium	ppm	ASTM D5185m		3		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.006		
ppm Water	ppm	ASTM D6304	>500	61		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4504		
Particles >6µm		ASTM D7647	>1300	<b>1</b> 301		
Particles >14µm		ASTM D7647	>80	<b>110</b>		
Particles >21µm		ASTM D7647	>20	<b>2</b> 6		
Particles >38µm		ASTM D7647	>4	2		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>17/13	<b>18/14</b>		
FLUID DEGRADA		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35		





## Built for a lifetime."



VIOLIAI





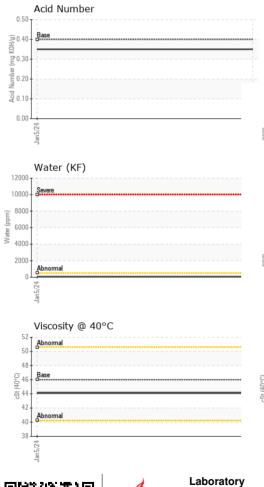

VISUAL		method				history2
White Metal	scalar	*Visual	NONE	NONE		
Yellow Metal	scalar	*Visual	NONE	NONE		
Precipitate	scalar	*Visual	NONE	NONE		
Silt	scalar	*Visual	NONE	NONE		
Debris	scalar	*Visual	NONE	NONE		
Sand/Dirt	scalar	*Visual	NONE	NONE		
Appearance	scalar	*Visual	NORML	NORML		
Odor	scalar	*Visual	NORML	NORML		
Emulsified Water	scalar	*Visual	>0.05	NEG		
Free Water	scalar	*Visual		NEG		
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1		
SAMPLE IMAGES	\$	method	limit/base	current	history1	history2
Color				. 8	no image	no image
Bottom			(		no image	no image
GRAPHS						
Ferrous Alloys				Particle Coun	t	
iron 1			491,520	I		1 <sup>26</sup>
non			122,880	-		-24
			30,720			22
			30,720			-22
			7,680			-20
Jan5/24			Jan5/24 (per 1 ml)			-18
Non-ferrous Metals	5		Jan5/24 Jan5/24 150 150 150 150 150 150 150 150 150 150			-20 -18 -16 -14
copper			120	-		-14
tin			30	-		-12
			8	<b>Bibrese</b> mal	/	-10
Jan5/24			Jan5/24			
LE L						
Viscosity @ 40°C			0	<sup>4μ</sup> 6μ Acid Number	14µ 21µ	38µ 71µ
Viscosity @ 40°C				<sup>4μ</sup> 6μ Acid Number	14μ 21μ	38µ 71µ
Viscosity @ 40°C				<sup>4μ</sup> 6μ Acid Number	14μ 21μ	38µ 71µ
Viscosity @ 40°C				<sup>4μ</sup> 6μ Acid Number	14μ 21μ	38µ 71µ
Viscosity @ 40°C				<sup>4μ</sup> 6μ Acid Number	14µ 21µ	38µ 71µ
Viscosity @ 40°C Abnomal Base Abnomal			(B) 0.50 (B) 0.40 (B) 0.30 (B) 0.20 (B) 0.10 (B) 0.10 (B) 0.10	Acid Number	14µ 21µ	
Viscosity @ 40°C			(P. 0.50 b) 0.40 E 0.30 au 0.20 b) 0.10 b) 0.10 b) 0.10	<sup>4μ</sup> 6μ Acid Number	14μ 21μ	38µ 71µ



Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

: 06054934

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnosed

Diagnostician

: 10 Jan 2024

: Don Baldridge

Sample No.

Lab Number

Unique Number : 10820883

Contact/Location: GREG PAMPES - CARLEXKC

LEXINGTON, NC

Contact: GREG PAMPES

GREG.PAMPES@SCHUETZ.NET

US 27295

T:

F: