


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

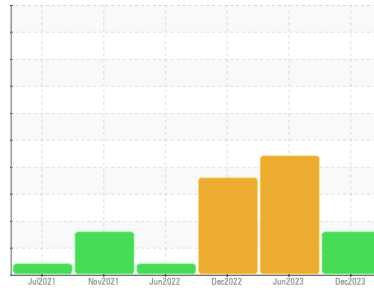

Machine Id
KAESER 1432476 (S/N 3610978)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA010988	KCPA002009	KCP47537D
Sample Date	Client Info	22 Dec 2023	21 Jun 2023	22 Dec 2022
Machine Age	hrs	54936	34735	54286
Oil Age	hrs	0	0	3000
Oil Changed	Client Info	N/A	N/A	Changed
Sample Status		ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	<1	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	1	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	<1	1	1
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 90	5	30	25
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 100	52	55	63
Calcium	ppm	ASTM D5185m 0	2	5	3
Phosphorus	ppm	ASTM D5185m 0	5	7	23
Zinc	ppm	ASTM D5185m 0	48	23	91
Sulfur	ppm	ASTM D5185m 23500	16953	23036	21373

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	1
Sodium	ppm	ASTM D5185m	9	2	7
Potassium	ppm	ASTM D5185m >20	16	3	14
Water	%	ASTM D6304 >0.05	0.009	▲ 0.343	▲ 0.050
ppm Water	ppm	ASTM D6304 >500	96	▲ 3430	▲ 500.1






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	9497	---	39773
Particles >6µm	ASTM D7647 >1300	▲ 1651	---	▲ 11256
Particles >14µm	ASTM D7647 >80	▲ 82	---	▲ 599
Particles >21µm	ASTM D7647 >20	▲ 22	---	▲ 115
Particles >38µm	ASTM D7647 >4	1	---	▲ 8
Particles >71µm	ASTM D7647 >3	0	---	1
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/18/14	---	▲ 22/21/16

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.36	0.43	0.43


OIL ANALYSIS REPORT

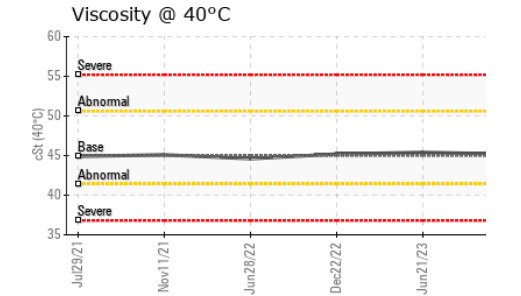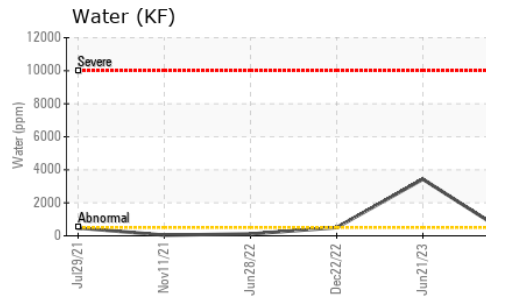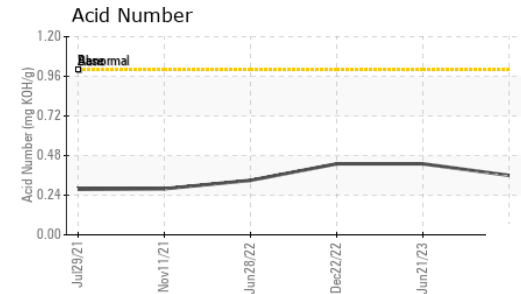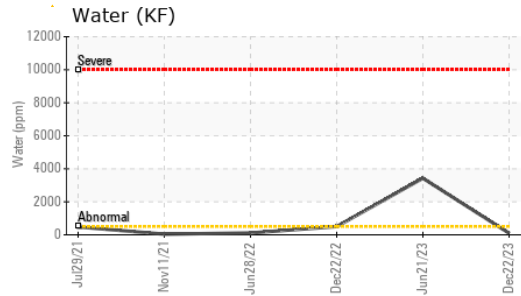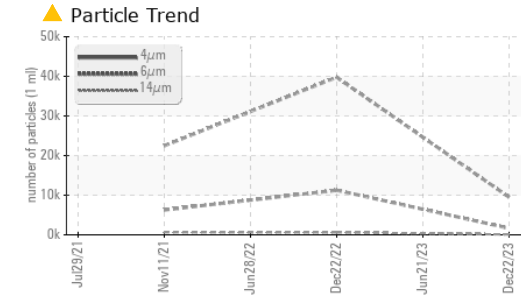





PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	▲ HAZY	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	▲ 0.2%	NEG
Free Water	scalar	*Visual		▲ 10.0	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	45.2	45.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

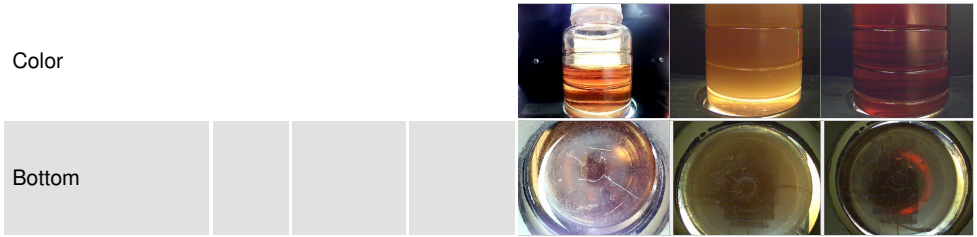

GRAPHS

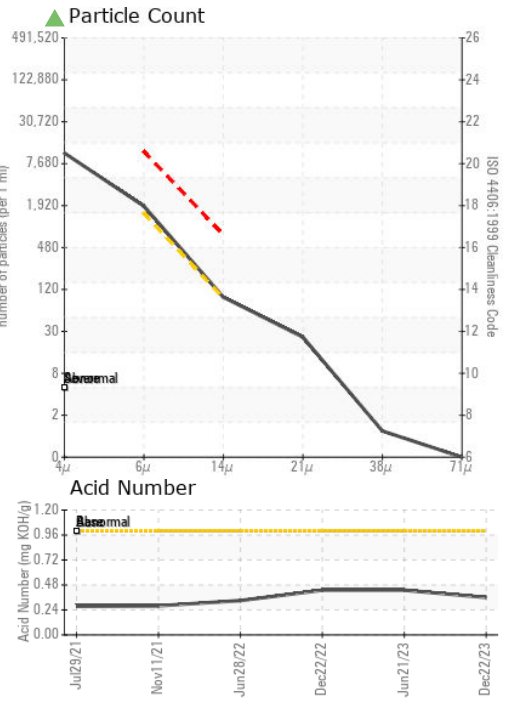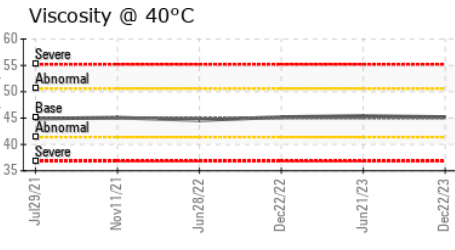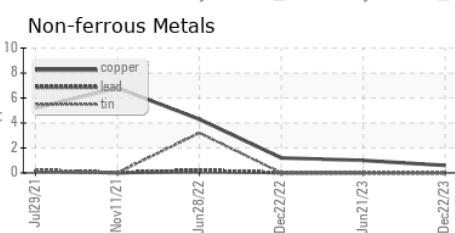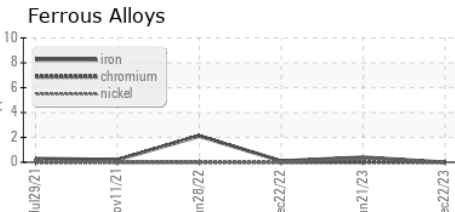

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA010988 **Recieved** : 08 Jan 2024
Lab Number : 06054936 **Diagnosed** : 10 Jan 2024
Unique Number : 10820885 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

POMPS TIRE SERVICE
 4160 REARDON RD
 DE FOREST, WI
 US 53532
 Contact: JEFFREY STIEREN
 JEFFREY.STIEREN@POMPSTIRE.COM
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)