




# OIL ANALYSIS REPORT

Sample Rating Trend

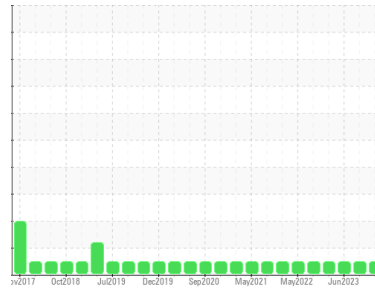

**NORMAL**



Machine Id  
**BLUE SKID**

Component  
**Hydraulic System**

Fluid  
**ESSO NUTO H ISO 46 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP0005175</b>	USPM29534	USP250515
Sample Date	Client Info		<b>20 Dec 2023</b>	30 Aug 2023	12 Jun 2023
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>5</b>	4	2
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>0</b>	0	0
Lead	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Copper	ppm	ASTM D5185m >20	<b>17</b>	13	10
Tin	ppm	ASTM D5185m >20	<b>1</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 0	<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m 0	<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m 5	<b>6</b>	6	6
Calcium	ppm	ASTM D5185m 50	<b>75</b>	68	73
Phosphorus	ppm	ASTM D5185m 330	<b>468</b>	386	400
Zinc	ppm	ASTM D5185m 410	<b>531</b>	458	482
Sulfur	ppm	ASTM D5185m 2700	<b>1936</b>	1641	1738

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	1	<1
Sodium	ppm	ASTM D5185m	<b>4</b>	1	2
Potassium	ppm	ASTM D5185m >20	<b>2</b>	<1	<1
Water	%	ASTM D6304 >0.05	<b>0.005</b>	0.014	0.005
ppm Water	ppm	ASTM D6304 >500	<b>57</b>	146.2	59.8

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	<b>424</b>	430	77
Particles >6µm	ASTM D7647	>1300	<b>80</b>	94	27
Particles >14µm	ASTM D7647	>160	<b>8</b>	9	5
Particles >21µm	ASTM D7647	>40	<b>4</b>	4	2
Particles >38µm	ASTM D7647	>10	<b>0</b>	1	0
Particles >71µm	ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	<b>16/13/10</b>	16/14/10	13/12/10

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.45	<b>0.43</b>	0.48	0.46




# OIL ANALYSIS REPORT

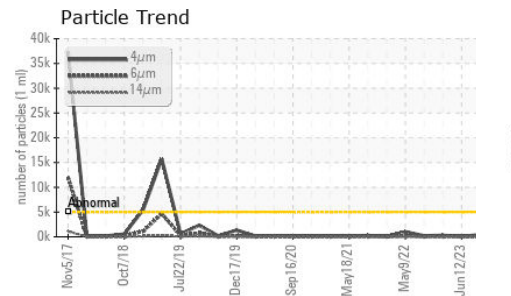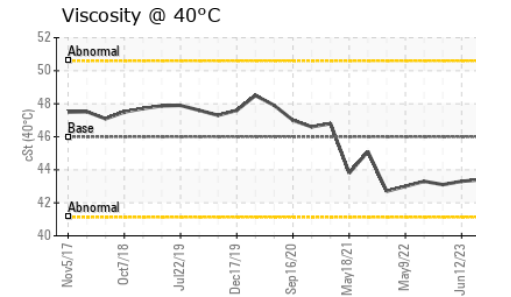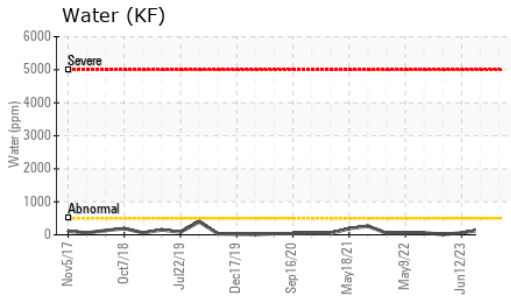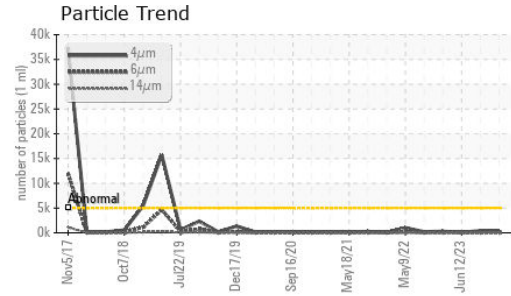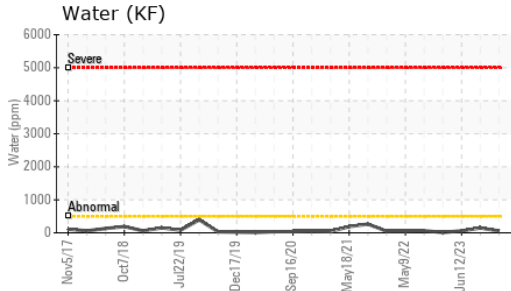






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	43.6	43.4	43.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

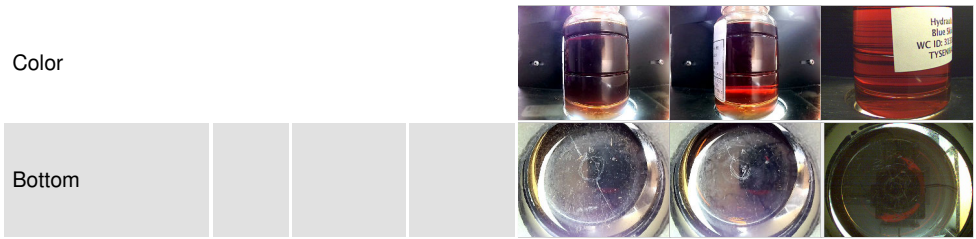

## GRAPHS

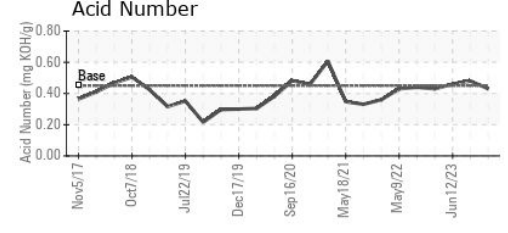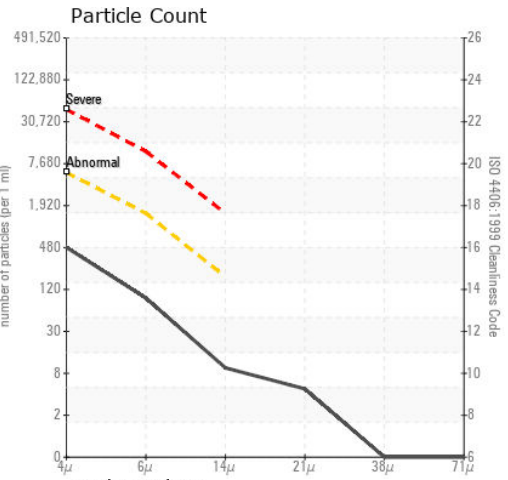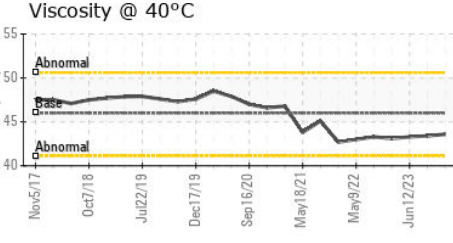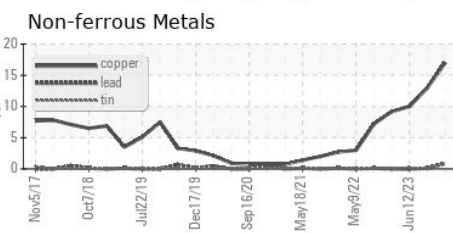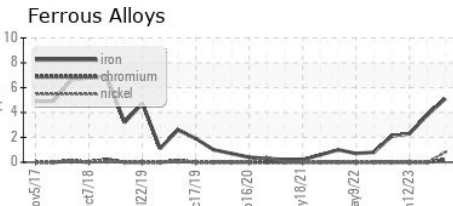

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP0005175 **Received** : 08 Jan 2024  
**Lab Number** : 06054954 **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10820903 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON ADVANCEPIERRE FOODS**  
 201 S RALEIGH RD  
 ENID, OK  
 US 73701  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: