OIL ANALYSIS REPORT

Sample Rating Trend

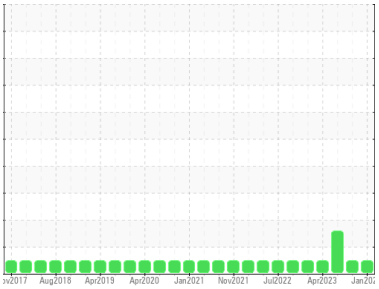

NORMAL

Area
87
Machine Id
[87] A87 FES
Component
Center Refrigeration Compressor
Fluid
BVA ALKYL 300 (83 GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor. (Customer Sample Comment: BVA Alkyl 300)

Wear
All component wear rates are normal.

Contamination
The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**HPL0003002**	HPL0003271	HPL0002809
Sample Date		Client Info		**03 Jan 2024**	02 Oct 2023	06 Jul 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**1220**	80	10980
Oil Changed		Client Info		**Not Changd**	Changed	Not Changd
Sample Status				**NORMAL**	NORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	**<1**	<1	2
Chromium	ppm	ASTM D5185m	>2	**<1**	0	0
Nickel	ppm	ASTM D5185m		**<1**	0	0
Titanium	ppm	ASTM D5185m		**<1**	0	<1
Silver	ppm	ASTM D5185m	>2	**0**	0	0
Aluminum	ppm	ASTM D5185m	>3	**2**	0	<1
Lead	ppm	ASTM D5185m	>2	**<1**	0	0
Copper	ppm	ASTM D5185m	>8	**<1**	<1	0
Tin	ppm	ASTM D5185m	>4	**1**	<1	<1
Vanadium	ppm	ASTM D5185m		**0**	0	0
Cadmium	ppm	ASTM D5185m		**<1**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		**0**	0	0
Barium	ppm	ASTM D5185m		**0**	0	0
Molybdenum	ppm	ASTM D5185m		**<1**	0	0
Manganese	ppm	ASTM D5185m		**<1**	0	0
Magnesium	ppm	ASTM D5185m		**0**	0	3
Calcium	ppm	ASTM D5185m		**0**	0	0
Phosphorus	ppm	ASTM D5185m		**21**	0	2
Zinc	ppm	ASTM D5185m		**0**	0	7
Sulfur	ppm	ASTM D5185m		**0**	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	**<1**	<1	<1
Sodium	ppm	ASTM D5185m		**0**	0	<1
Potassium	ppm	ASTM D5185m	>20	**1**	0	0
Water	%	ASTM D6304	>0.01	**0.003**	0.003	▲ 0.043
ppm Water	ppm	ASTM D6304	>100	**37**	38.7	▲ 430

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974		**0.014**	0.013	0.014

OIL ANALYSIS REPORT

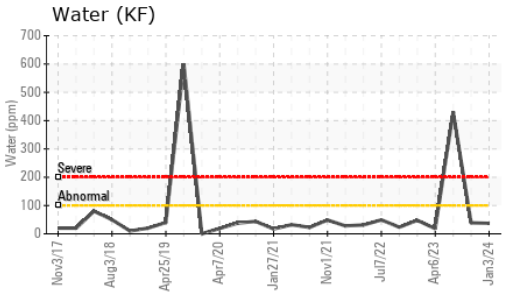

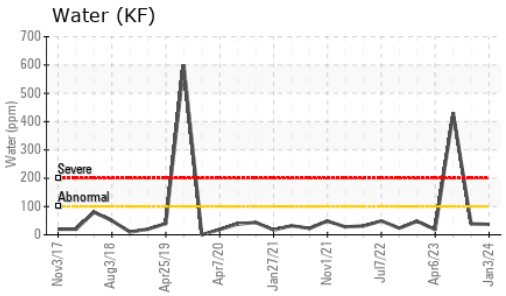

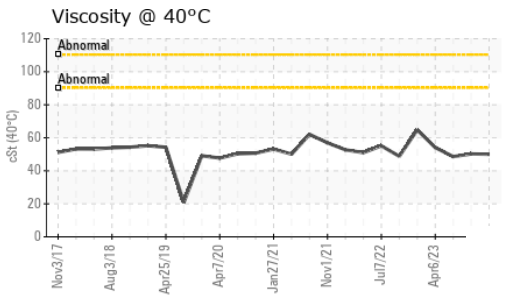

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**LIGHT**	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.01	**NEG**	NEG	▲ 0.2%
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		**50.0**	50.2	48.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

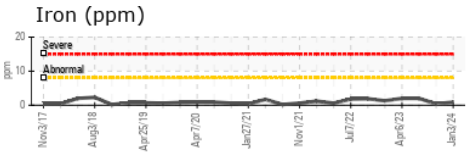

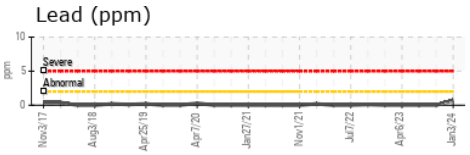

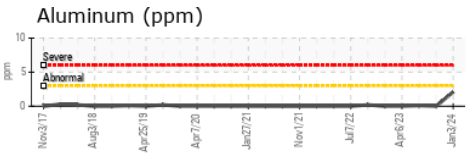

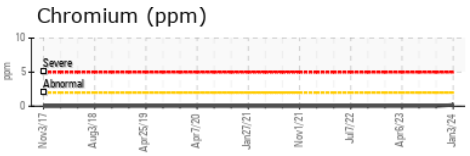

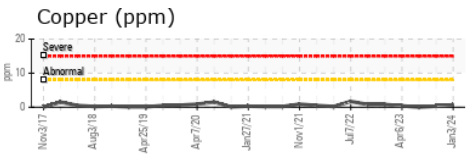

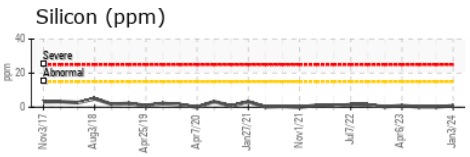

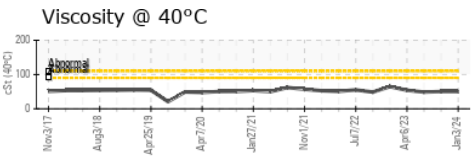

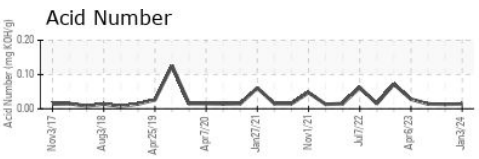

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : HPL0003002 **Recieved** : 08 Jan 2024
Lab Number : 06054984 **Diagnosed** : 10 Jan 2024
Unique Number : 10820933 **Diagnostician** : Jonathan Hester
Test Package : MOB 2 (Additional Tests: KF)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

KENSING
2525 S KENSINGTON RD
KANKAKEE, IL
US 60901
Contact: TIM HUBERT
timothy.hubert@kensingsolutions.com
T: (815)939-8918
F: x: