




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**DEPT 300 [975078]**  
 Machine Id  
**QUINCY 1 (S/N 10AA026)**  
 Component  
**Compressor**  
 Fluid  
**{not provided} (40 GAL)**

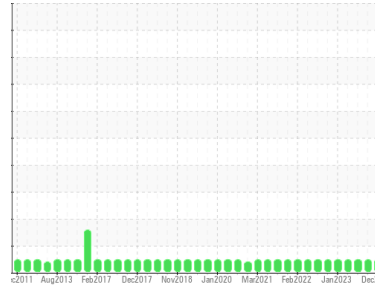

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0852641</b>	WC0852647	WC0816141
Sample Date	Client Info	<b>28 Dec 2023</b>	06 Oct 2023	13 Jul 2023
Machine Age	hrs	Client Info	<b>0</b>	0
Oil Age	hrs	Client Info	<b>0</b>	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>3</b>	6	10
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	<1
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>180</b>	232	367
Zinc	ppm	ASTM D5185m	<b>23</b>	33	102
Sulfur	ppm	ASTM D5185m	<b>0</b>	39	0

## CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>2</b>	<1	1
Potassium	ppm	ASTM D5185m >20	<b>0</b>	0	0





## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	<b>1444</b>	---	---
Particles >6µm	ASTM D7647 >2500	<b>408</b>	---	---
Particles >14µm	ASTM D7647 >320	<b>39</b>	---	---
Particles >21µm	ASTM D7647 >80	<b>8</b>	---	---
Particles >38µm	ASTM D7647 >20	<b>0</b>	---	---
Particles >71µm	ASTM D7647 >4	<b>0</b>	---	---
Oil Cleanliness	ISO 4406 (c) >20/18/15	<b>18/16/12</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.31</b>	0.37	0.62


# OIL ANALYSIS REPORT

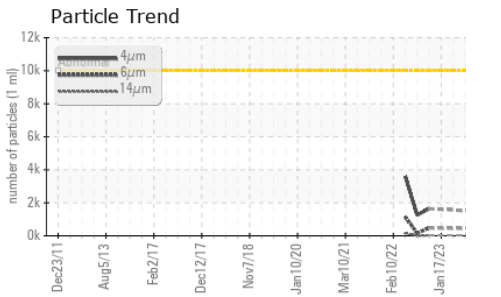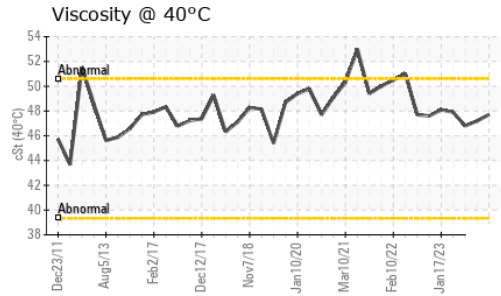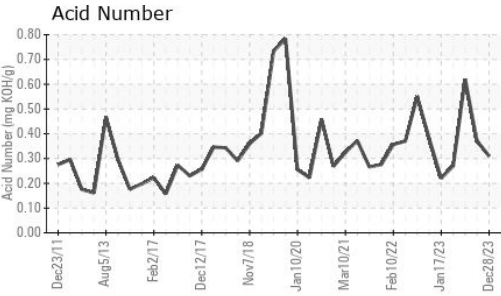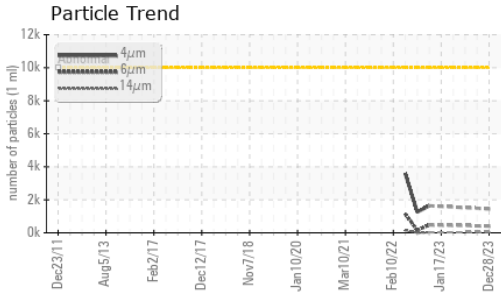






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>47.7</b>	47.2	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

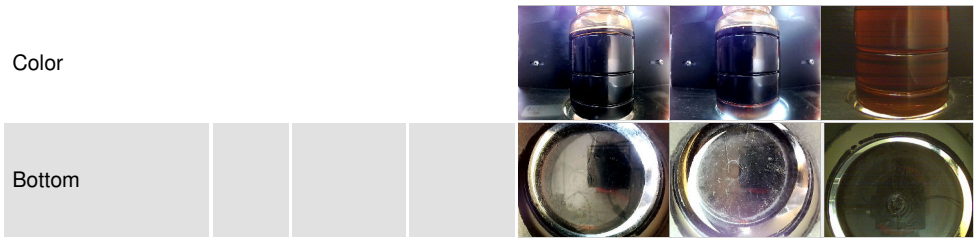

## GRAPHS

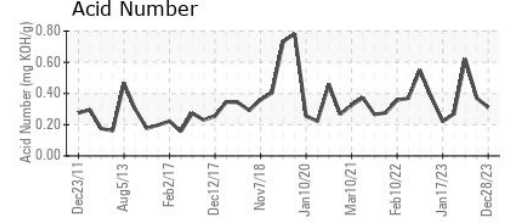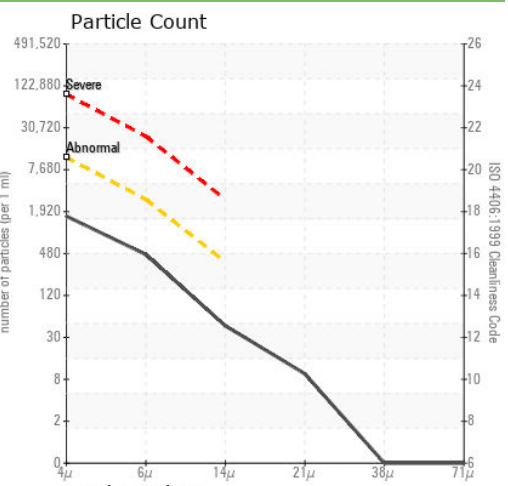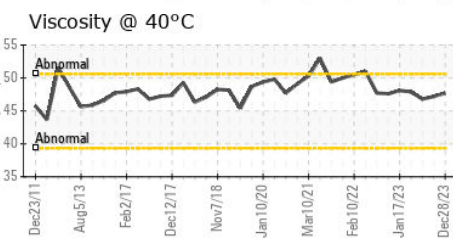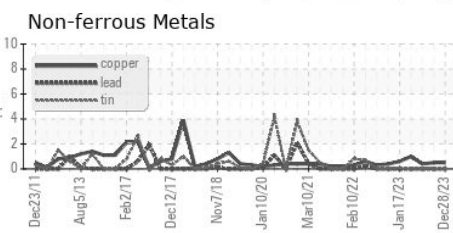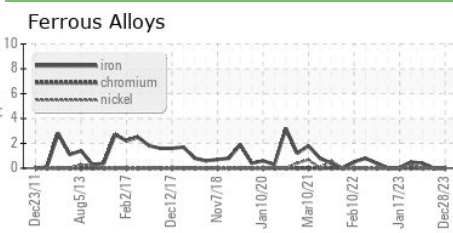

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0852641 **Received** : 09 Jan 2024  
**Lab Number** : 06055362 **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10821311 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: PrtCount )

**BALDWIN FILTERS INC**  
 4400 HIGHWAY 30 EAST  
 KEARNEY, NE  
 US 68847-0724  
 Contact: JAY FAHRENBRUCH  
 jay.fahrenbruch@parker.com  
 T:  
 F: (800)828-4453

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)