

OIL ANALYSIS REPORT

Sample Rating Trend



COMPRESSOR 4

Component Air Compressor Fluid USPI 5000 AIR 46 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM26864	USPM26813	USP146577
Sample Date		Client Info		04 Jan 2024	25 Jul 2023	18 Aug 2022
Machine Age	hrs	Client Info		37152	34621	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>4	0	0	0
Nickel	ppm	ASTM D5185m	>4	0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>20	0	<1	0
Copper	ppm	ASTM D5185m	>40	0	0	0
Tin	ppm	ASTM D5185m	>5	0	0	0
Antimony	ppm	ASTM D5185m				
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	1	<1
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		0	0	<1
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		0	0	0
Zinc	ppm	ASTM D5185m		0	0	0
Sulfur	ppm	ASTM D5185m		0	4	6
CONTAMINANTS			limit/base	-		-
		method	limit/base	current	history1	history2
Silicon	ppm		>25	0	<1	<1
Sodium	ppm	ASTM D5185m	00	<1	0	0
Potassium	ppm	ASTM D5185m		0	<1	0
Water	%	ASTM D6304		0.007	0.005	0.003
ppm Water	ppm	ASTM D6304	>6000	73	53.3	39.7
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	261	211	▲ 28835
Particles >6µm		ASTM D7647		87	69	782
Particles >14µm		ASTM D7647	>640	12	12	29
Particles >21µm		ASTM D7647		4	4	13
Particles >38µm		ASTM D7647	>40	0	1	0
Particles >71µm		ASTM D7647	>10	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	15/14/11	15/13/11	<u>22/17/12</u>
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		0.11	0.04	0.117
0.48.54) Pov: 1				Contact/Las	ation: TIM ELON	

Report Id: MAXJAC [WUSCAR] 06055390 (Generated: 01/10/2024 12:48:54) Rev: 1

Contact/Location: TIM FLOWERS - MAXJAC

Page 1 of 2



Feb18/22

30

Ê²⁵⁾

20k

-He 15

늄 10k

5

0

٦đ

Particle Trend

vug18/22

und 18/25

OIL ANALYSIS REPORT

scalar

scalar

scalar

scalar

scalar

scalar

scalar

scalar

*Visual

*Visual

*Visua

*Visual

*Visual

*Visua

*Visual

*Visual

scalar *Visual

scalar *Visual

NONE

NONE

NONE

NONE


NONE


NONE

NORML

NORML

>0.6

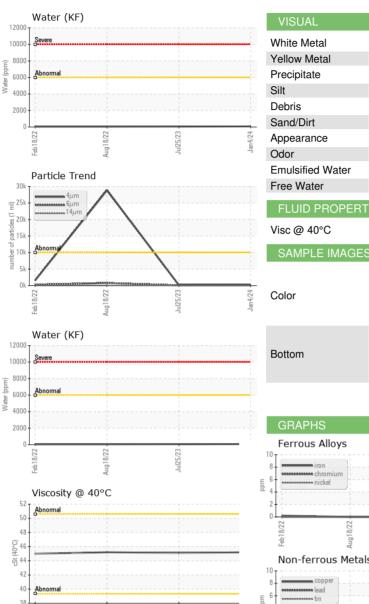

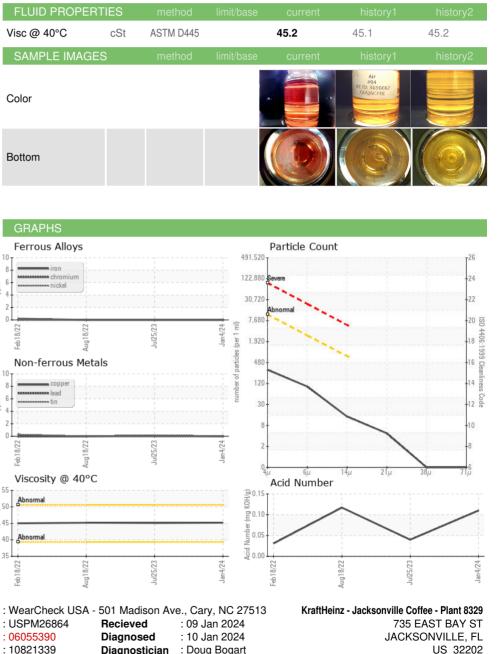

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

NONE

NONE

NONE

NONE

NONE

NONE

NORML

NORML

NEG

NEG

Certificate L2367

ŝ

: 10821339

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: IND 2

Diagnostician

: Doug Bogart

Laboratory

Sample No.

Lab Number

Unique Number

Test Package

Contact/Location: TIM FLOWERS - MAXJAC

F:

Contact: TIM FLOWERS

T: (904)632-4073

timothy.flowers@kraftfoods.com