



# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**



Area  
**PG46 [260066]**  
 Machine Id  
**S023973 - VILLAGE OF 3RD LAKE**  
 Component  
**Compressor**  
 Fluid  
**{not provided} (--- GAL)**



## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>UFD06055423</b>	---	---
Sample Date	Client Info		<b>16 Oct 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed		Client Info	<b>N/A</b>	---	---
Sample Status			<b>NORMAL</b>	---	---

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<b>0</b>	---	---
Titanium	ppm	ASTM D5185m	<b>0</b>	---	---
Silver	ppm	ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	---	---
Lead	ppm	ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	---	---
Tin	ppm	ASTM D5185m >15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	---	---
Barium	ppm	ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	---	---
Manganese	ppm	ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<b>0</b>	---	---
Calcium	ppm	ASTM D5185m	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<b>318</b>	---	---
Zinc	ppm	ASTM D5185m	<b>41</b>	---	---
Sulfur	ppm	ASTM D5185m	<b>0</b>	---	---




## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m >20	<b>0</b>	---	---
Water	%	ASTM D6304 >0.1	<b>0.042</b>	---	---
ppm Water	ppm	ASTM D6304 >1000	<b>420</b>	---	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.29</b>	---	---

# OIL ANALYSIS REPORT

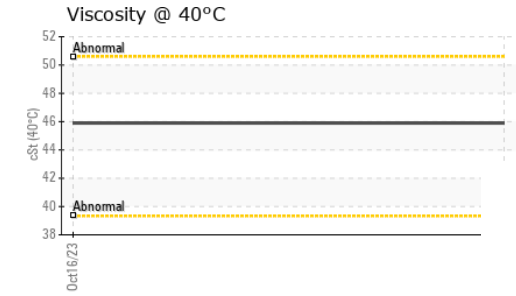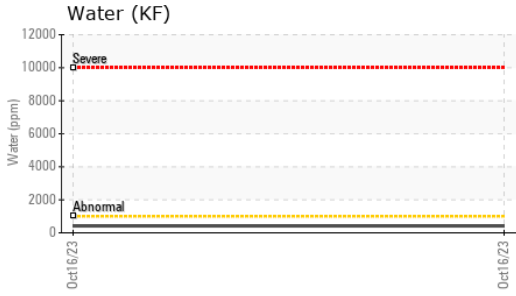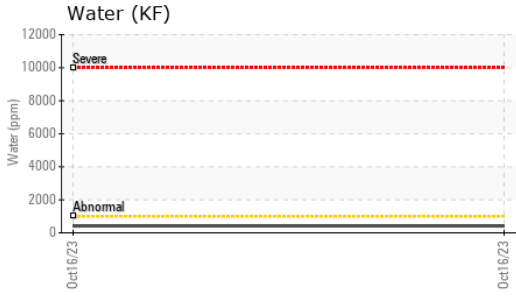






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>MODER</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>0.2%</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>45.9</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

### GRAPHS

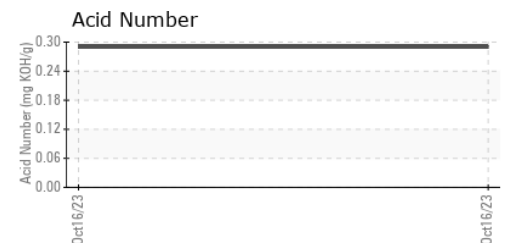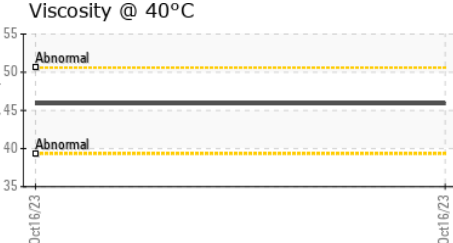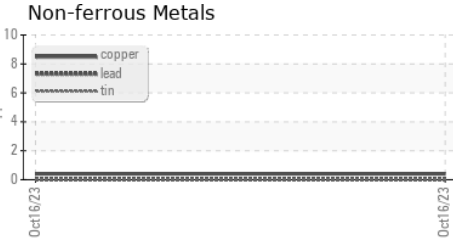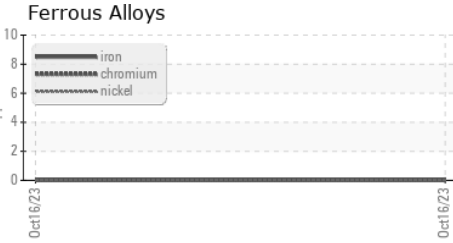

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UFD06055423    **Received** : 09 Jan 2024  
**Lab Number** : 06055423    **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10821372    **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

**FLUID-AIRE DYNAMICS**  
 550 ALBION AVE  
 SCHAUMBURG, IL  
 US 60193  
 Contact: ED DIENER  
 ed.diener@fluidairedynamics.com  
 T: (847)678-8388  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)