




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

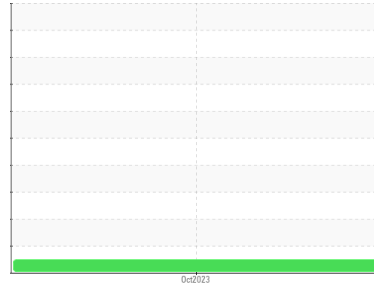

Area  
**PG46 [263165]**  
 Machine Id  
**1276 - VANS INDUSTRIAL**  
 Component  
**Compressor**  
 Fluid  
**{not provided} (--- GAL)**

## DIAGNOSIS

**Recommendation**  
 Resample at the next service interval to monitor.

**Wear**  
 All component wear rates are normal.

**Contamination**  
 There is no indication of any contamination in the oil.

**Fluid Condition**  
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>UFD06055439</b>	---	---
Sample Date	Client Info	<b>24 Oct 2023</b>	---	---
Machine Age	hrs Client Info	<b>0</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>Changed</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<b>0</b>	---	---
Chromium	ppm ASTM D5185m >10	<b>0</b>	---	---
Nickel	ppm ASTM D5185m	<b>0</b>	---	---
Titanium	ppm ASTM D5185m	<b>0</b>	---	---
Silver	ppm ASTM D5185m	<b>0</b>	---	---
Aluminum	ppm ASTM D5185m >25	<b>0</b>	---	---
Lead	ppm ASTM D5185m >25	<b>0</b>	---	---
Copper	ppm ASTM D5185m >50	<b>1</b>	---	---
Tin	ppm ASTM D5185m >15	<b>0</b>	---	---
Vanadium	ppm ASTM D5185m	<b>0</b>	---	---
Cadmium	ppm ASTM D5185m	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	<b>0</b>	---	---
Barium	ppm ASTM D5185m	<b>0</b>	---	---
Molybdenum	ppm ASTM D5185m	<b>0</b>	---	---
Manganese	ppm ASTM D5185m	<b>0</b>	---	---
Magnesium	ppm ASTM D5185m	<b>0</b>	---	---
Calcium	ppm ASTM D5185m	<b>0</b>	---	---
Phosphorus	ppm ASTM D5185m	<b>323</b>	---	---
Zinc	ppm ASTM D5185m	<b>5</b>	---	---
Sulfur	ppm ASTM D5185m	<b>1840</b>	---	---




## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	<b>0</b>	---	---
Sodium	ppm ASTM D5185m	<b>&lt;1</b>	---	---
Potassium	ppm ASTM D5185m >20	<b>0</b>	---	---
Water	% ASTM D6304 >0.1	<b>0.039</b>	---	---
ppm Water	ppm ASTM D6304 >1000	<b>390</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045	<b>0.26</b>	---	---

# OIL ANALYSIS REPORT

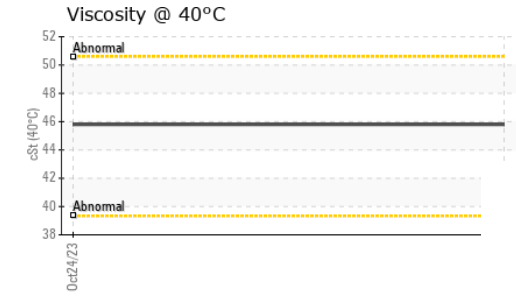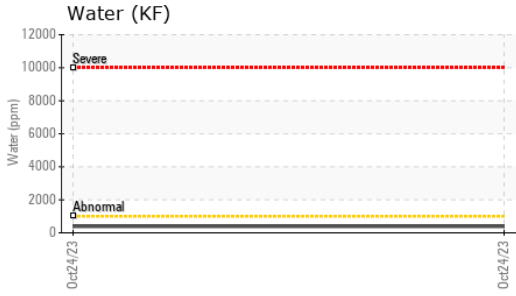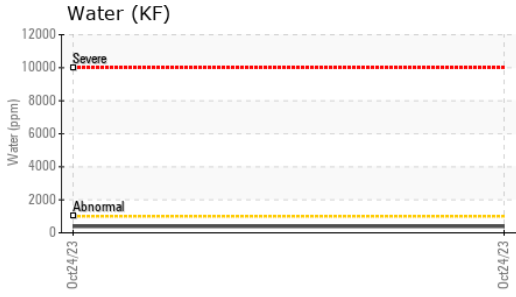





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.1	<b>0.2%</b>	---	---
Free Water	scalar	*Visual		<b>NEG</b>	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>45.8</b>	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

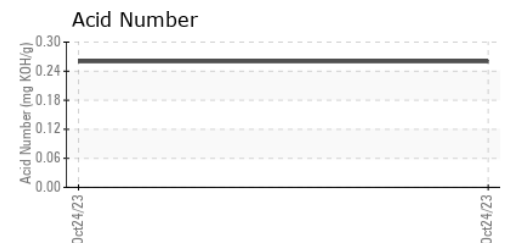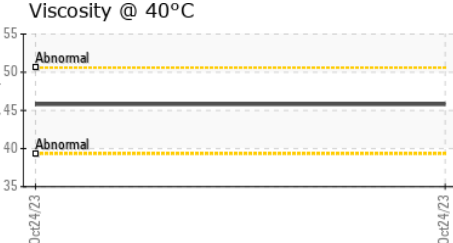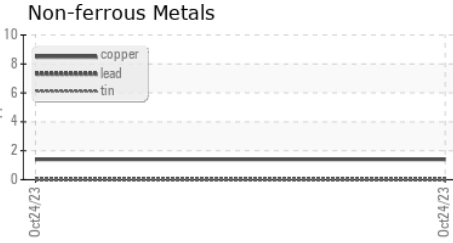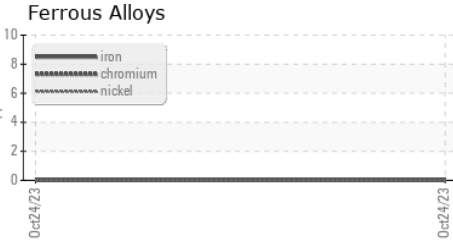

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UFD06055439    **Received** : 09 Jan 2024  
**Lab Number** : **06055439**    **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10821388    **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**FLUID-AIRE DYNAMICS**

550 ALBION AVE  
 SCHAUMBURG, IL  
 US 60193  
 Contact: ED DIENER  
 ed.diener@fluidairedynamics.com  
 T: (847)678-8388  
 F: