


# PROBLEM SUMMARY

Sample Rating Trend



DEGRADATION

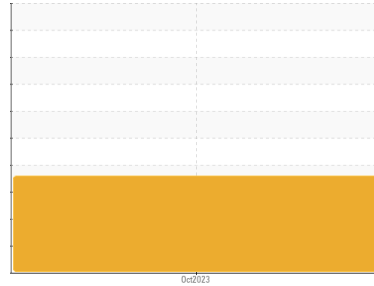


Area  
**SFG 200 [263372]**  
 Machine Id  
**1606140001 - SCHOLLE IPN**  
 Component  
**Compressor**  
 Fluid  
**{not provided} (--- GAL)**

## COMPONENT CONDITION SUMMARY

### Acid Number



### Viscosity @ 40°C

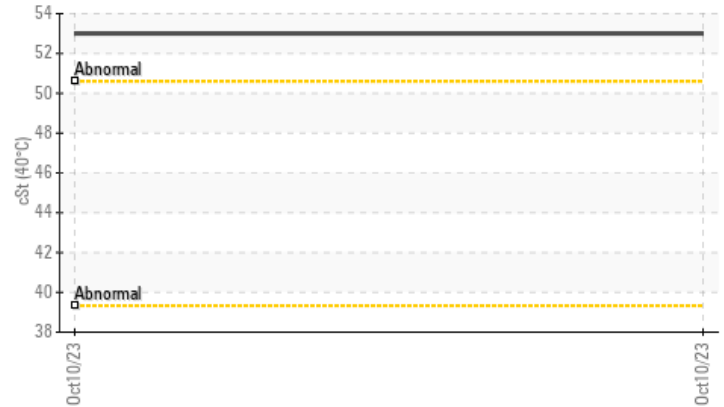

## RECOMMENDATION

We advise that you check for a possible overheat condition. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>SEVERE</b>	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	5.76	---	---
Visc @ 40°C	cSt	ASTM D445	53.0	---	---

Customer Id: UCFLUSCH  
 Sample No.: UFD06055441  
 Lab Number: 06055441  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Jonathan Hester +1 919-379-4092 x4092  
[jhester@wearcheckusa.com](mailto:jhester@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Check For Overheating	---	---	?	We advise that you check for a possible overheat condition.

## HISTORICAL DIAGNOSIS

Area  
**SFG 200 [263372]**  
 Machine Id  
**1606140001 - SCHOLLE IPN**  
 Component  
**Compressor**  
 Fluid  
**{not provided} (--- GAL)**



**DIAGNOSIS**

- Recommendation**  
 We advise that you check for a possible overheat condition. Oil and filter change at the time of sampling has been noted. We recommend an early resample to monitor this condition.
- Wear**  
 All component wear rates are normal.
- Contamination**  
 There is no indication of any contamination in the oil.
- Fluid Condition**  
 The AN level is above the recommended limit. The oil viscosity is higher than normal. TAN level indicates possible presence of varnish.

**SAMPLE INFORMATION**    method    limit/base    current    history1    history2

Sample Number	Client Info		<b>UFD06055441</b>	---	---
Sample Date	Client Info		<b>10 Oct 2023</b>	---	---
Machine Age	hrs	Client Info	<b>0</b>	---	---
Oil Age	hrs	Client Info	<b>0</b>	---	---
Oil Changed		Client Info	<b>Changed</b>	---	---
Sample Status			<b>SEVERE</b>	---	---

**CONTAMINATION**    method    limit/base    current    history1    history2

Water	WC Method	>0.1	<b>NEG</b>	---	---
-------	-----------	------	------------	-----	-----

**WEAR METALS**    method    limit/base    current    history1    history2

Iron	ppm	ASTM D5185m	>50	<b>0</b>	---	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m		<b>0</b>	---	---
Titanium	ppm	ASTM D5185m		<b>0</b>	---	---
Silver	ppm	ASTM D5185m		<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>25	<b>7</b>	---	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>50	<b>3</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	---	---
Cadmium	ppm	ASTM D5185m		<b>0</b>	---	---

**ADDITIVES**    method    limit/base    current    history1    history2

Boron	ppm	ASTM D5185m		<b>0</b>	---	---
Barium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	---	---
Manganese	ppm	ASTM D5185m		<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Calcium	ppm	ASTM D5185m		<b>2</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>548</b>	---	---
Zinc	ppm	ASTM D5185m		<b>4</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>116</b>	---	---



**CONTAMINANTS**    method    limit/base    current    history1    history2

Silicon	ppm	ASTM D5185m	>25	<b>0</b>	---	---
Sodium	ppm	ASTM D5185m		<b>2</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>5</b>	---	---

**FLUID DEGRADATION**    method    limit/base    current    history1    history2

Acid Number (AN)	mg KOH/g	ASTM D8045		<b>5.76</b>	---	---
------------------	----------	------------	--	-------------	-----	-----

# OIL ANALYSIS REPORT

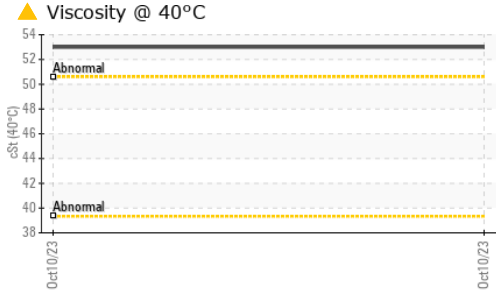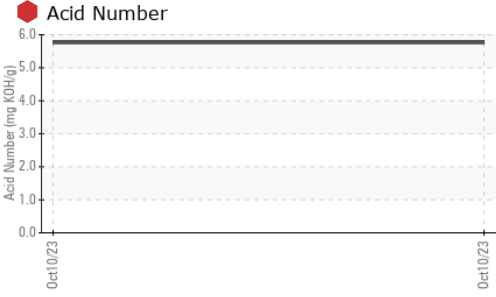





VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Precipitate	scalar	*Visual	NONE	NONE	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---
Free Water	scalar	*Visual		NEG	---	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	▲ 53.0	---	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color		no image	no image
Bottom		no image	no image

## GRAPHS

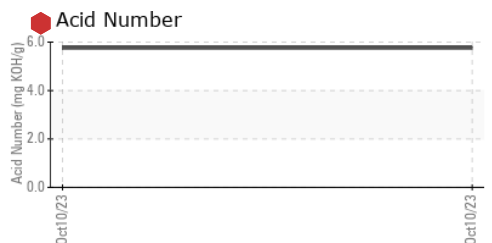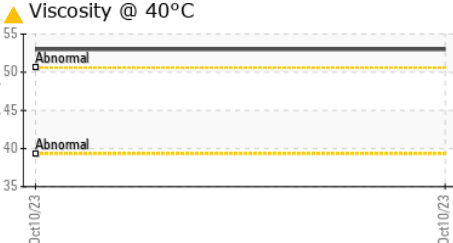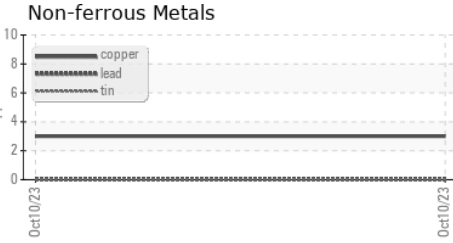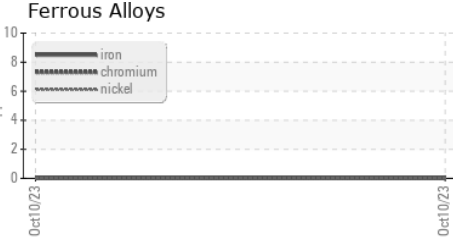

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UFD06055441 **Recieved** : 09 Jan 2024  
**Lab Number** : 06055441 **Diagnosed** : 11 Jan 2024  
**Unique Number** : 10821390 **Diagnostician** : Jonathan Hester  
**Test Package** : IND 2

**FLUID-AIRE DYNAMICS**  
 550 ALBION AVE  
 SCHAUMBURG, IL  
 US 60193  
 Contact: ED DIENER  
 ed.diener@fluidairedynamics.com  
 T: (847)678-8388  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)