


OIL ANALYSIS REPORT

PALEXTRA 44

SULLIVAN PALATEK 23FE004196 - TWIN CITY FAN

Component

Compressor





Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the


Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


SAMPLE INFORM	MATION	method				history2
Sample Number		Client Info		UCS06055442	UCS05974205	
Sample Date		Client Info		03 Jan 2024	04 Oct 2023	
Machine Age	hrs	Client Info		2056	819	
Oil Age	hrs	Client Info		2056	819	
Oil Changed		Client Info		Not Changd	Not Changd	
Sample Status				NORMAL	NORMAL	
CONTAMINATIO	V	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m		0	0	
Nickel	ppm	ASTM D5185m	>10	0	0	
Titanium	ppm	ASTM D5185m		0	0	
Silver	ppm	ASTM D5185m		0	0	
Aluminum	ppm	ASTM D5185m	>25	0	0	
Lead	ppm	ASTM D5185m	>25	0	0	
Copper	ppm	ASTM D5185m	>50	0 <1	<1	
Tin	ppm	ASTM D5185m	>15	0	0	
Vanadium	ppm	ASTM D5185m	>10	0	0	
Cadmium	ppm	ASTM D5185m		0	0	
	ррпп					
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	0.3	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m	0.3	0	0	
Magnesium	ppm	ASTM D5185m	0.4	0	<1	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	689	564	652	
Zinc	ppm	ASTM D5185m	0	0	0	
Sulfur	ppm	ASTM D5185m	1237	472	1048	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	3	8	
Sodium	ppm	ASTM D5185m		<1	0	
Potassium	ppm	ASTM D5185m	>20	0	1	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	0.23	0.081	


Sullivan

OIL ANALYSIS REPORT

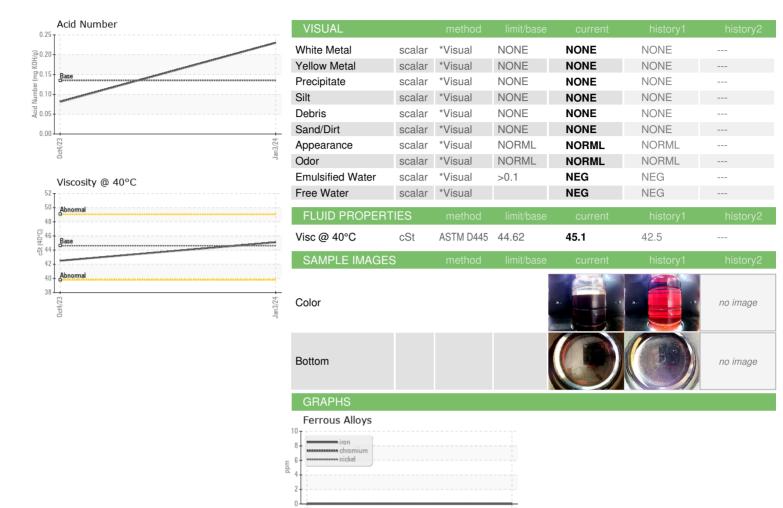











Certificate L2367

Laboratory Sample No. Lab Number Test Package : IND 2

Unique Number

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 : UCS06055442 : 06055442

Recieved : 10821391

Diagnosed Diagnostician

: 09 Jan 2024 : 10 Jan 2024 : Don Baldridge

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

LIFT PRO EQUIPMENT CO

SIOUX FALLS, SD US 57104 Contact: REUBEN tim@liftproequipment.com T: (605)339-6494