




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

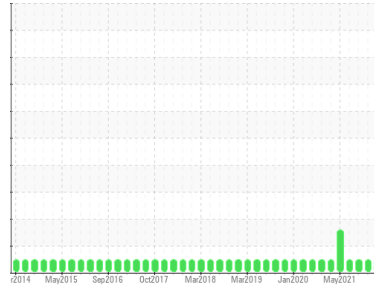

Area  
**MACHINE SHOP**  
 Machine Id  
**0-6500-2101 KATOLIGHT GENERATOR**  
 Component  
**Diesel Engine**  
 Fluid  
**SHELL ROTELLA S 10W40 (12 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>WC0867041</b>	WC0770096	WC0692306
Sample Date	Client Info			<b>03 Jan 2024</b>	03 Apr 2023	12 Jul 2022
Machine Age	hrs	Client Info		<b>543</b>	519	497
Oil Age	hrs	Client Info		<b>543</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Fuel	WC Method	>5		<b>&lt;1.0</b>	<1.0	<1.0
Water	WC Method	>0.2		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>NEG</b>	NEG	NEG

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>100	<b>2</b>	5	4
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	1	<1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>40	<b>6</b>	6	5
Copper	ppm	ASTM D5185m	>330	<b>2</b>	3	2
Tin	ppm	ASTM D5185m	>15	<b>2</b>	2	1
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	1	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	<1	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>166</b>	189	210
Barium	ppm	ASTM D5185m		<b>0</b>	0	2
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	3	1
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	2	<1
Magnesium	ppm	ASTM D5185m	291	<b>11</b>	20	19
Calcium	ppm	ASTM D5185m	392	<b>2107</b>	2005	2231
Phosphorus	ppm	ASTM D5185m	535	<b>997</b>	882	982
Zinc	ppm	ASTM D5185m	557	<b>1173</b>	1125	1175
Sulfur	ppm	ASTM D5185m		<b>3587</b>	3828	4160



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>7</b>	8	6
Sodium	ppm	ASTM D5185m		<b>4</b>	4	2
Potassium	ppm	ASTM D5185m	>20	<b>6</b>	9	8

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>6.6</b>	6.1	7.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.9</b>	17.9	21.4

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>16.8</b>	15.4	18.0
Base Number (BN)	mg KOH/g	ASTM D2896	5.2	<b>7.54</b>	12.16	7.28







# OIL ANALYSIS REPORT

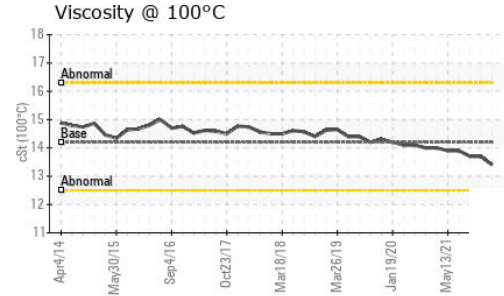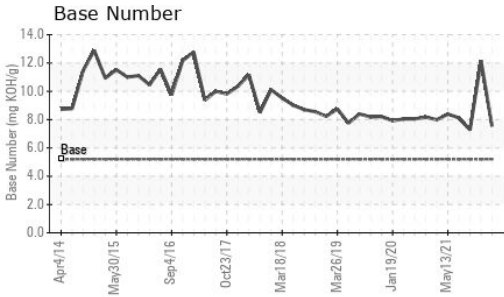

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D445	14.2	<b>13.4</b>	13.7

## GRAPHS

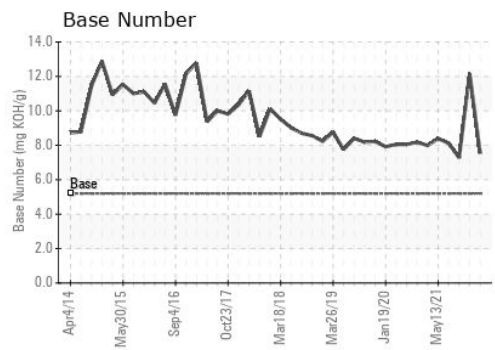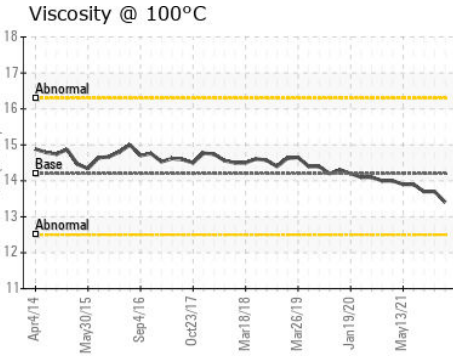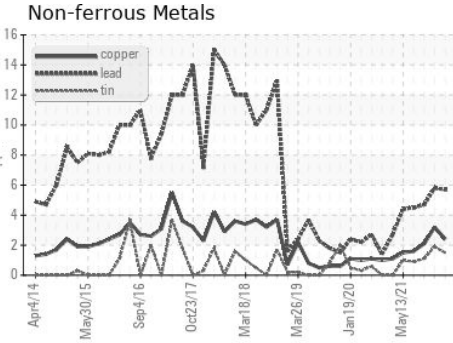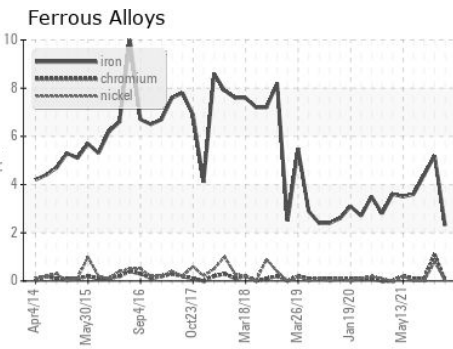

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0867041 **Received** : 09 Jan 2024  
**Lab Number** : **06055535** **Diagnosed** : 10 Jan 2024  
**Unique Number** : 10821484 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ALLVAC - MACHINE SHOP**  
 2020 ASHCRAFT AVE  
 MONROE, NC  
 US 28110  
 Contact: mark eilerman  
 mark.eilerman@atimaterials.com  
 T: (704)292-4051  
 F: (704)282-0665

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)