


OIL ANALYSIS REPORT

Sample Rating Trend



ISO

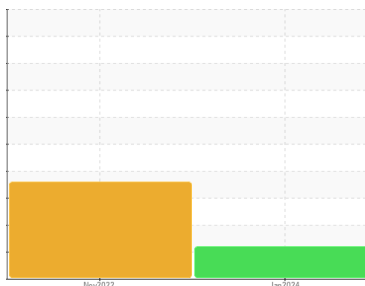

Machine Id
KAESER SK 15T 8121325 (S/N 1398)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA011963	KCP45893	---
Sample Date	Client Info	04 Jan 2024	23 Nov 2022	---
Machine Age	hrs	11630	4026	---
Oil Age	hrs	0	4000	---
Oil Changed	Client Info	N/A	Changed	---
Sample Status		ATTENTION	ABNORMAL	---

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >3	0	0	---
Titanium	ppm	ASTM D5185m >3	0	0	---
Silver	ppm	ASTM D5185m >2	0	0	---
Aluminum	ppm	ASTM D5185m >10	0	<1	---
Lead	ppm	ASTM D5185m >10	0	<1	---
Copper	ppm	ASTM D5185m >50	8	7	---
Tin	ppm	ASTM D5185m >10	0	<1	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m 90	6	5	---
Molybdenum	ppm	ASTM D5185m	0	0	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m 90	52	55	---
Calcium	ppm	ASTM D5185m 2	0	<1	---
Phosphorus	ppm	ASTM D5185m	0	10	---
Zinc	ppm	ASTM D5185m	0	2	---
Sulfur	ppm	ASTM D5185m	16448	21416	---

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	2	---
Sodium	ppm	ASTM D5185m	15	15	---
Potassium	ppm	ASTM D5185m >20	3	10	---
Water	%	ASTM D6304 >0.05	0.021	▲ 0.050	---
ppm Water	ppm	ASTM D6304 >500	219	▲ 502.5	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	4558	26315	---
Particles >6µm	ASTM D7647 >1300	▲ 1784	▲ 13591	---
Particles >14µm	ASTM D7647 >80	▲ 110	▲ 869	---
Particles >21µm	ASTM D7647 >20	13	▲ 50	---
Particles >38µm	ASTM D7647 >4	0	▲ 6	---
Particles >71µm	ASTM D7647 >3	0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 19/18/14	▲ 22/21/17	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.33	0.32	---


OIL ANALYSIS REPORT

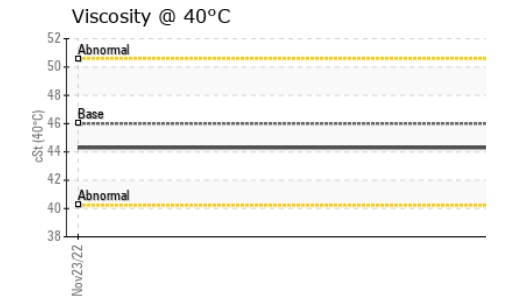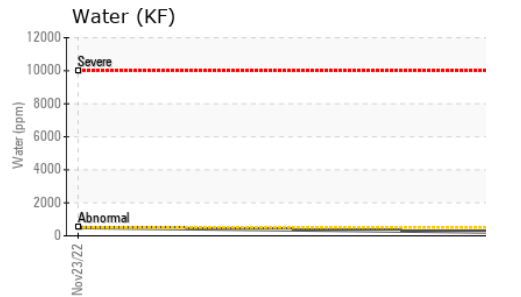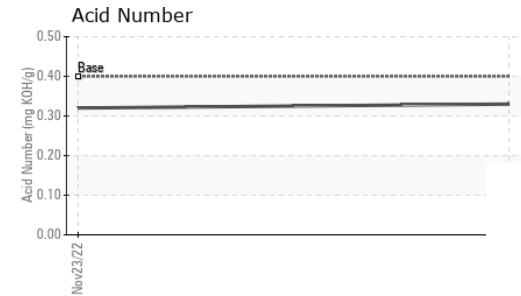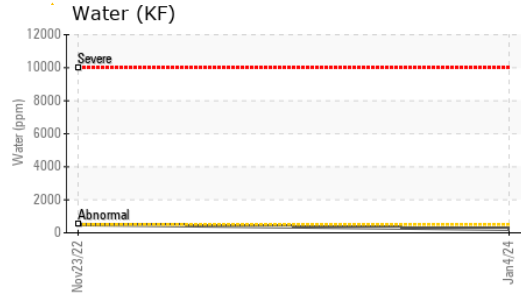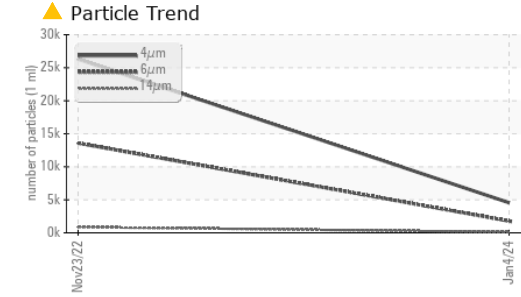





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.3	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

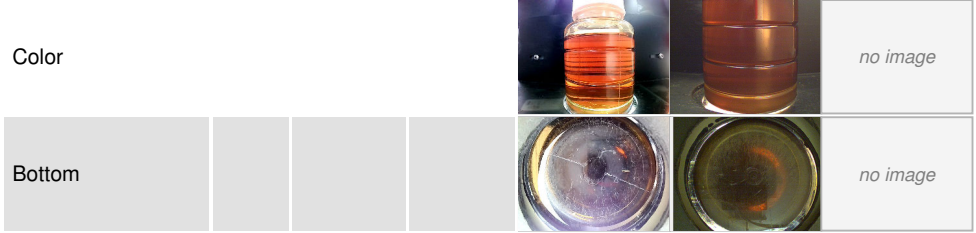

GRAPHS

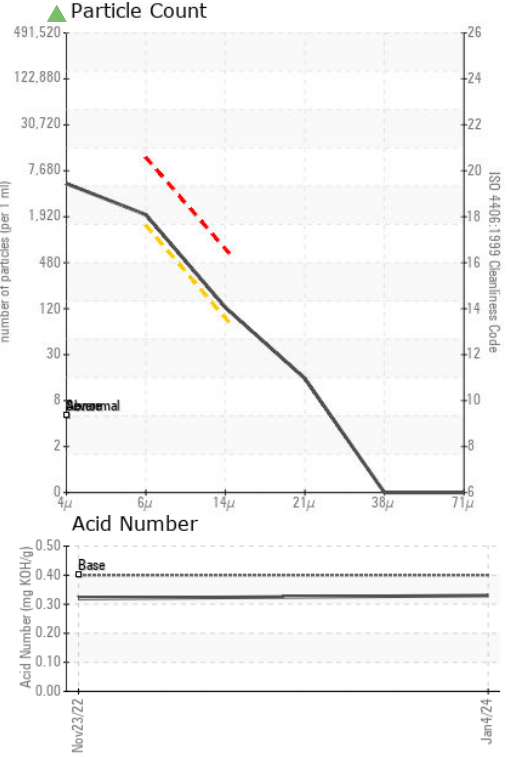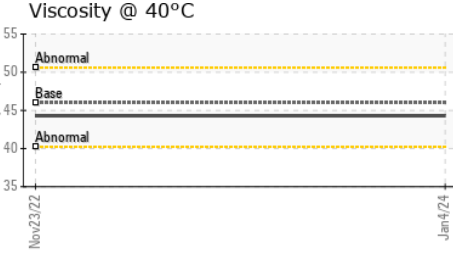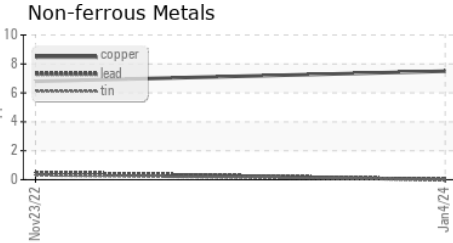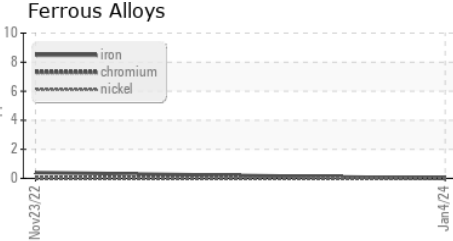

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA011963 **Received** : 09 Jan 2024
Lab Number : 06055912 **Diagnosed** : 10 Jan 2024
Unique Number : 10821861 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

TOOL TECHNOLOGIES
 639 CLYMER RD
 MARYSVILLE, OH
 US 43040
 Contact: ADMIN
 admin@tooltechohio.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)