

# **OIL ANALYSIS REPORT**

Sample Rating Trend

ISO



Machine Id 1835

Component Compressor

KAESER SIGMA (OEM) S-460 (--- QTS)

## **DIAGNOSIS**

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

## Contamination

There is a high amount of particulates present in the oil.

#### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

				Nov2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC06056649		
Sample Date		Client Info		08 Nov 2023		
Machine Age	hrs	Client Info		6907		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	8		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	36		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	58		
Calcium	ppm	ASTM D5185m	2	6		
Phosphorus	ppm	ASTM D5185m		4		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	8		
Sodium	ppm	ASTM D5185m		18		
Potassium	ppm	ASTM D5185m	>20	11		
Water	%	ASTM D6304	>0.05	0.015		
ppm Water	ppm	ASTM D6304	>500	151		
FLUID CLEANLIN	NESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		38970		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	<b>▲</b> 385		
Partialas > 21um		ACTM D7647	. 20	A 74		

ASTM D7647 >20

ASTM D7647 >4

ASTM D7647 >3

ISO 4406 (c)

method

mg KOH/g ASTM D8045 0.4

2

0

22/21/16

0.30

current

>--/17/13

limit/base

Particles >21µm

Particles >38µm

Particles >71µm

Oil Cleanliness

Acid Number (AN)


**FLUID DEGRADATION** 

history1

history2



## **OIL ANALYSIS REPORT**

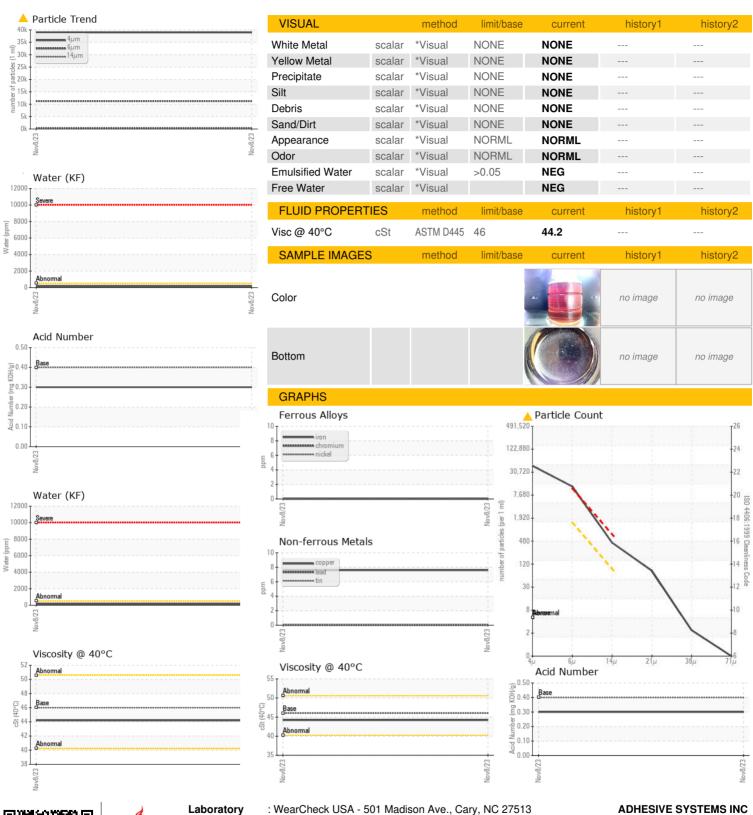



Certificate L2367

Laboratory Sample No. Lab Number **Unique Number** Test Package

: KC06056649 . 06056649

: 10822598

Recieved Diagnosed Diagnostician

: 10 Jan 2024 : 11 Jan 2024 : Doug Bogart 14410 WOODROW WILSON ST DETROIT, MI

US 48238 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: