


OIL ANALYSIS REPORT

Sample Rating Trend



ISO



7410620 (S/N 1042)

Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

OAMBLE INCOM	AATION	Aug2021	Dec2021 Apr2022		Dec2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA008714	KC111224	KC107351
Sample Date		Client Info		15 Dec 2023	07 Jul 2023	24 Aug 2022
Machine Age	hrs	Client Info		16909	15229	11475
Oil Age	hrs	Client Info		0	4175	8000
Oil Changed		Client Info		N/A	Not Changd	Changed
Sample Status				ATTENTION	ABNORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	<1	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	2	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	10	12	8
Tin	ppm	ASTM D5185m	>10	<1	0	0
Vanadium	ppm	ASTM D5185m		0	<1	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	100	0	9	<1
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	4	<1	0
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	23500	16116	20537	18498
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		2	7	0
Potassium	ppm	ASTM D5185m	>20	<1	2	1
Water	%	ASTM D6304	>0.05	0.007	0.009	0.004
ppm Water	ppm	ASTM D6304	>500	78	95.9	49.9
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		2976		1949
Particles >6µm		ASTM D7647	>1300	1173		496
Particles >14µm		ASTM D7647	>80	146		68
Particles >21µm		ASTM D7647	>20	42		24
Particles >38μm		ASTM D7647	>4	2		3
Particles >71μm		ASTM D7647	>3	0		0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/14		18/16/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
A a lad Nilousala aur (ANI)	VOLV-	ACTM D0045	1.0	0.25	0.00	0.05

Acid Number (AN)

mg KOH/g ASTM D8045 1.0


0.36

0.35

0.35



OIL ANALYSIS REPORT

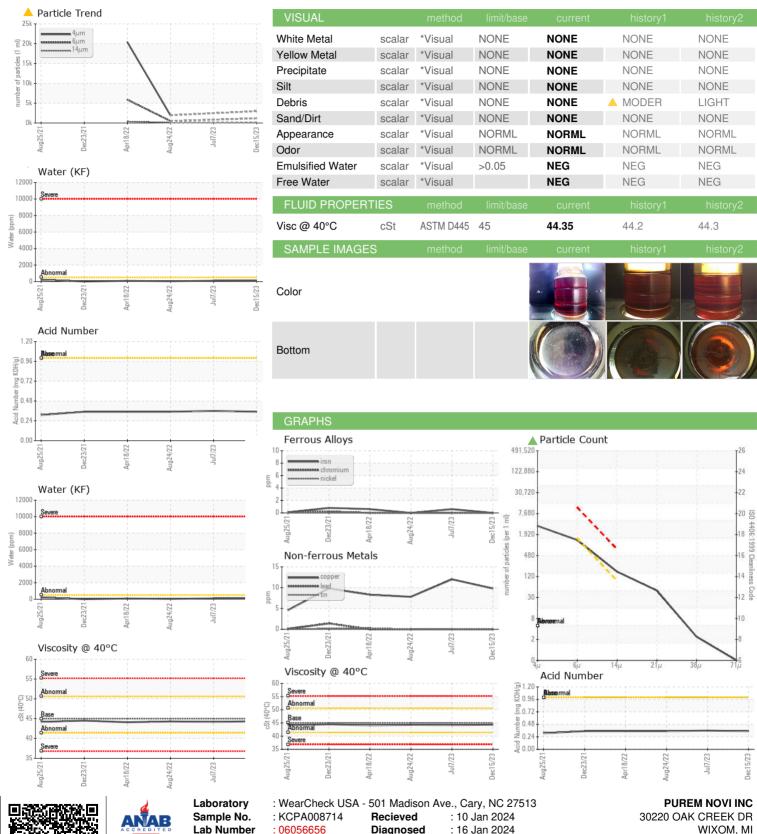





Certificate L2367

Lab Number **Unique Number**

: 06056656 : 10822605

Diagnosed

: 16 Jan 2024

Diagnostician : Jonathan Hester

Test Package : IND 2 (Additional Tests: KF, PrtCount) To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

US 48393

T: F:

Contact: Service Manager