

ISO



Built for a lifetime."

Machine Id 1970

Component Compressor KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

A Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124352		
Sample Date		Client Info		08 Nov 2023		
Machine Age	hrs	Client Info		6844		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	0		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	11		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES	I- I-	method	limit/base	current	history1	history2
Boron	nom	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	42		
	ppm		90	42 0		
Molybdenum	ppm	ASTM D5185m ASTM D5185m		0 <1		
Manganese Magnesium	ppm	ASTM D5185m	90	< 1 59		
Calcium	ppm	ASTM D5185m	2	59 <1		
	ppm		2	4		
Phosphorus	ppm	ASTM D5185m		-		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1		
Sodium	ppm	ASTM D5185m		19		
Potassium	ppm	ASTM D5185m	>20	10		
Water	%	ASTM D6304	>0.05	0.018		
ppm Water	ppm	ASTM D6304	>500	180		
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		130886		
Particles >6µm		ASTM D7647	>1300	<u> </u>		
Particles >14µm		ASTM D7647	>80	1542		
Particles >21µm		ASTM D7647	>20	<u> </u>		
Particles >38µm		ASTM D7647	>4	<mark> 8</mark>		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	4/23/18		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.30		





Built for a lifetime

OIL ANALYSIS REPORT





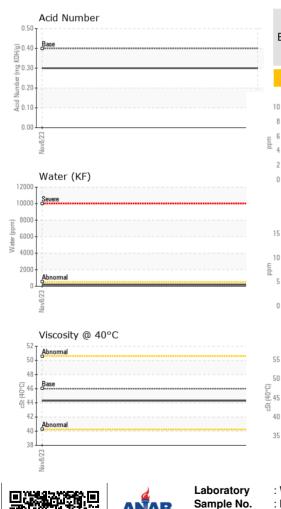

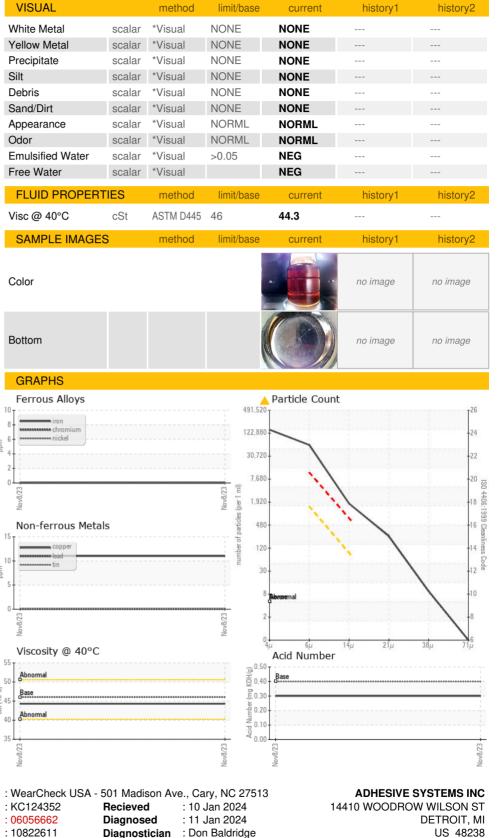

US 48238 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367

Lab Number

Unique Number

Test Package

Contact/Location: Service Manager - ADHDET

^{* -} Denotes test methods that are outside of the ISO 17025 scope of accreditation.